


95% confidence interval of difference in power from control

Difference in power from baseline

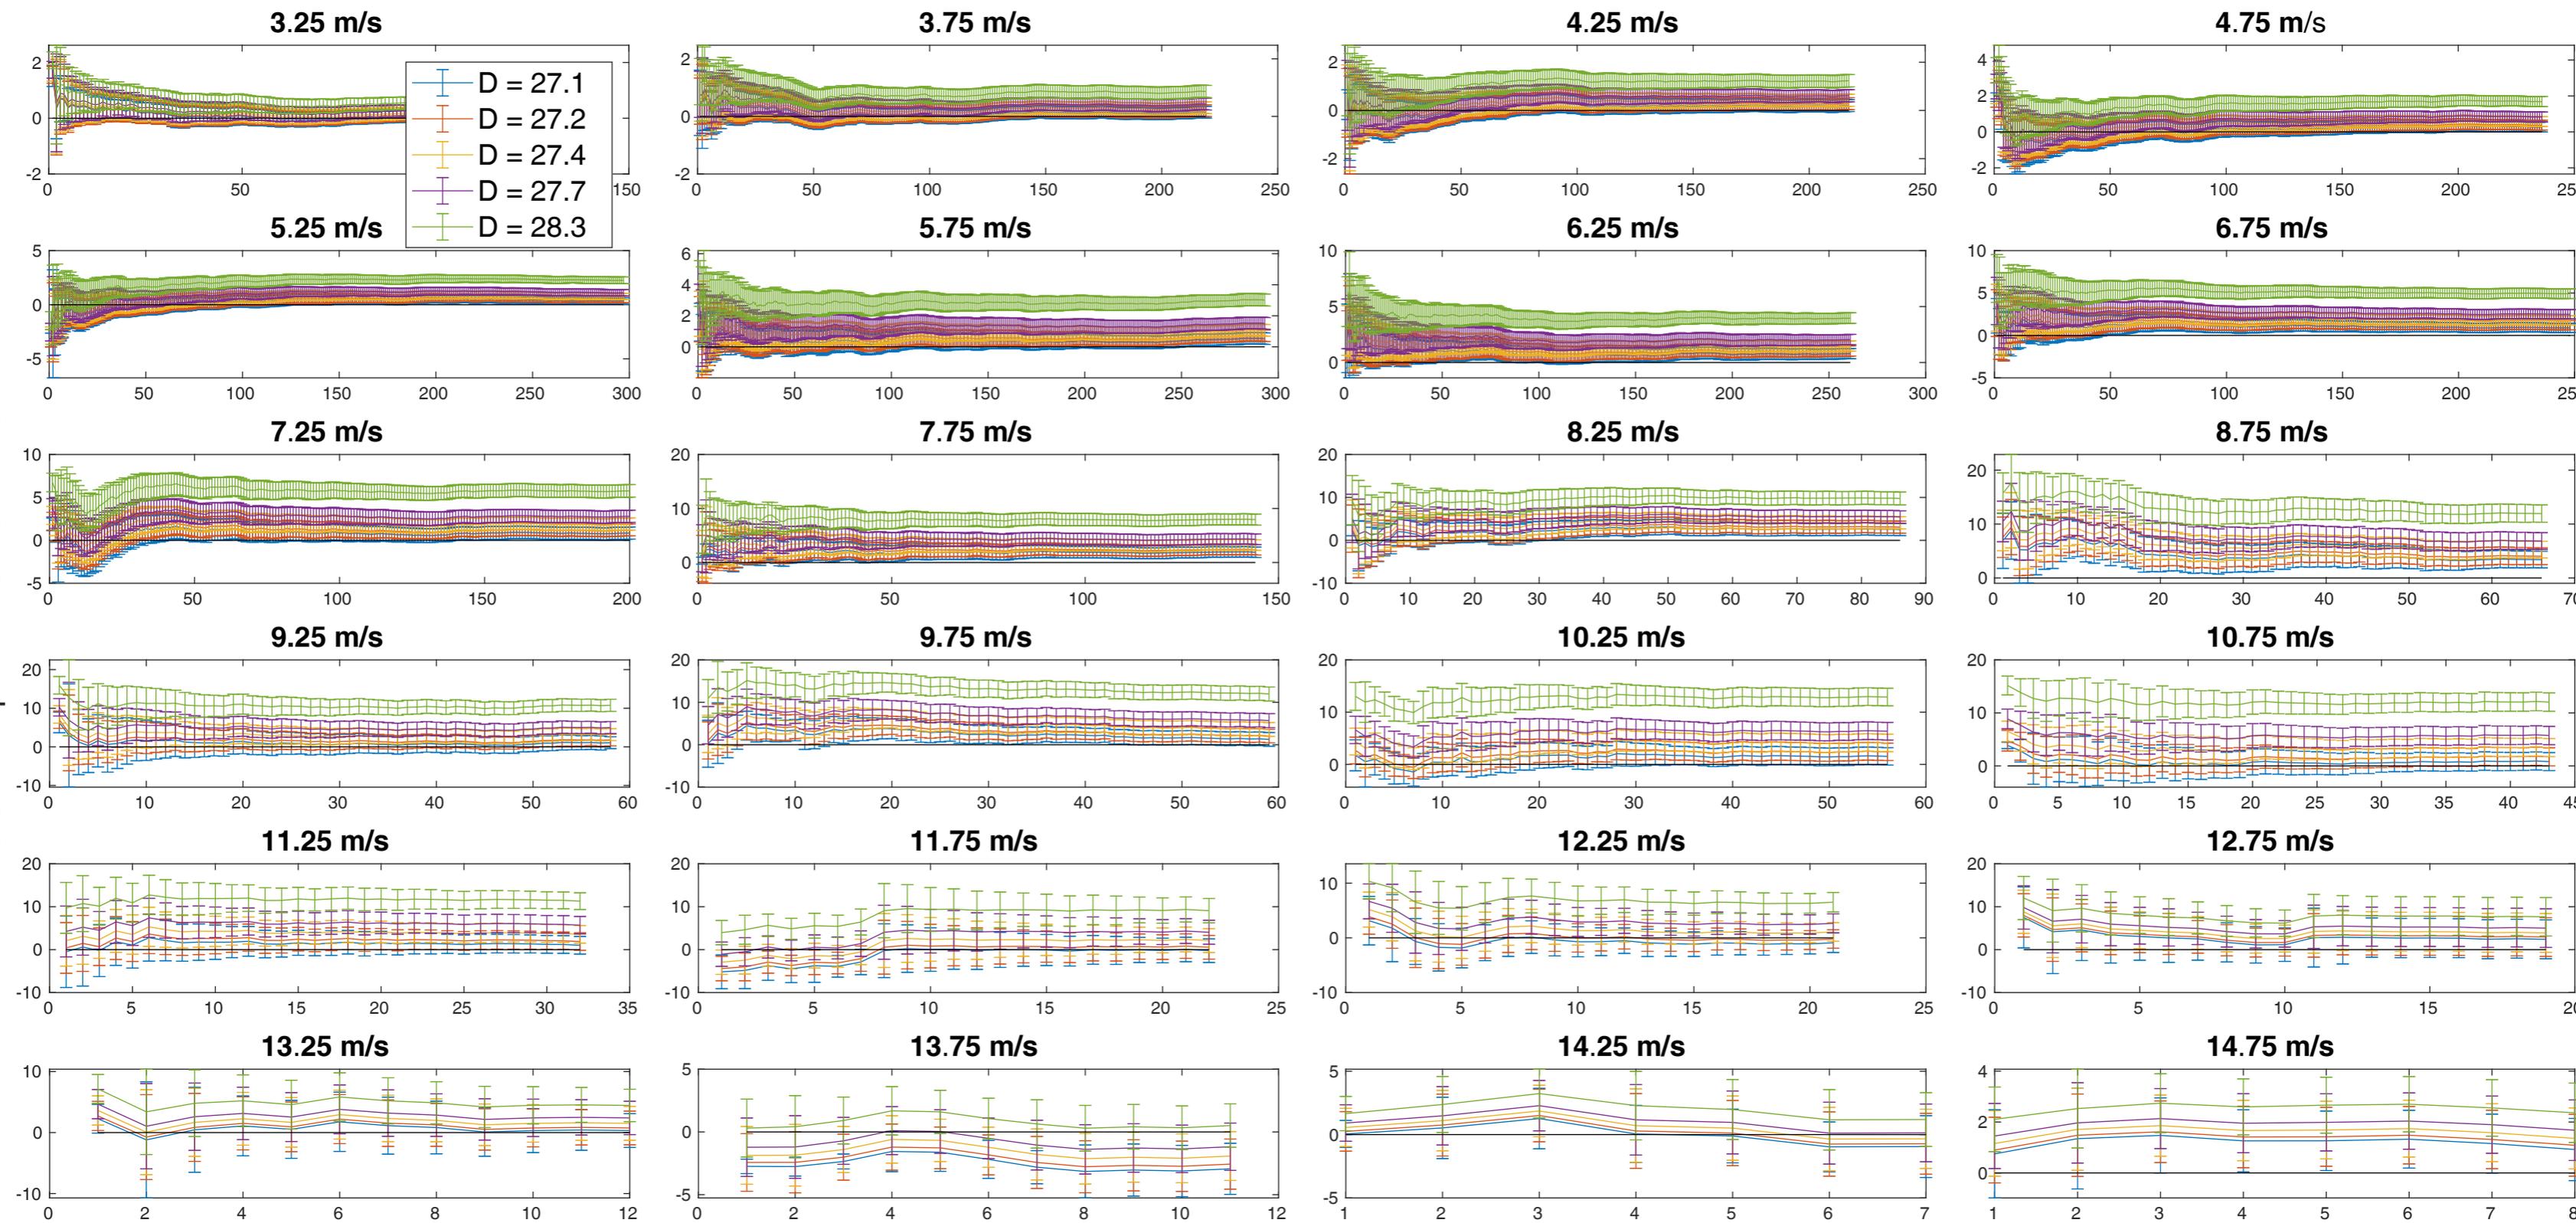

Number of samples