

Grand challenges of Wind Energy Science – Meeting the needs and services of the power system

Mark O'Malley¹, Hannele Holttinen², Nicolaos Cutululis³, Til Kristian Vrana⁴, Jennifer King⁵, Vahan Gevorgian⁵, Xiongfei Wang⁶, Fatemeh Rajaei-Najafabadi¹, Andreas Hadjileonidas¹

¹Department of Electrical and Electronic Engineering, Imperial College, Exhibition Rd, South Kensington, London SW7 2BX, United Kingdom

²Recognis Oy, Espoo, 02200, Finland

³DTU, Department of Wind and Energy Systems, Risø Frederiksborgvej 399 DK- 4000 Roskilde, Denmark

⁴SINTEF Energy Research, Sem Sælands vei 11, 7034 Trondheim, Norway

⁵NREL, Power Systems Engineering Center, 15013 Denver West Parkway Golden, CO 80401, United States

⁶Department of Electrical Engineering, KTH Royal Institute of Technology, Stockholm, 114 28, Sweden

Correspondence to: Mark O'Malley (m.omalley@imperial.ac.uk)

Abstract: The share of wind power in power systems is increasing dramatically and this is happening in parallel with increased penetration of solar photovoltaics, storage, other inverter-based technologies, and electrification of other sectors. Recognising the fundamental objective of power systems, maintaining supply demand balance reliably at least cost. Integrating all these technologies in a cost effective manner while maintaining (or improving) power system reliability is a significant research challenge that is driving radical changes to planning and operations of power systems globally. In this changing environment Wind power can maximise its long-term value to the power system by balancing the needs it imposes on the power system with its contribution to addressing these needs with services. A needs and services paradigm is adopted here to highlight these research challenges which Research in wind power should also be guided by a this-balanced approach and by concentrating on its advantages over competitors. The research challenges within the wind technology itself are many and varied with control and coordination internally being a focal point in parallel with a strong recommendations need for a holistic approach targeted at where wind has an advantage over its competitors and in coordination with research in other technologies such as storage, power electronics and power systems.

1 Introduction

It is widely accepted that the near-term focus for rapid and substantial emissions reductions in the energy system is the decarbonisation of electricity and the electrification of other sectors of the economy (IEA, 2022). Wind and solar photovoltaic (PV¹) compared to the alternatives, i.e., costs and maturity of nuclear and/or carbon capture and storage, are dominating newly installed electricity capacity globally (EIA, 2022; IEA, 2022; Lazard, 2023;

¹ While this paper is focused on wind, solar PV has very similar characteristics and impacts on power systems and therefore they are dealt with together where appropriate so as the Solar PV community can also benefit. Wind and solar PV are sometimes collectively referred to as variable renewable energy (VRE) resources, but this collective term is only used in the paper where appropriate as the focus is on wind.

32 REN21, 2023). This dramatic increase in wind and solar PV has prompted a recent review of the status of these
33 two key technologies to determine their long-term research challenges (Haegel et al., 2019; Veers et al., 2019;
34 Veers et al., 2022; EAWC, 2023). These papers arose out of an International Energy Agency (IEA) initiative
35 (Dykes et al., 2019). They identified a common research challenge, grid integration², the all-important task of
36 ensuring that with increased penetration of wind and solar PV in power systems³ the primary objective of
37 maintaining supply demand balance reliably and at least cost is met (O'Malley, 2011).

38

39

40

41 Increases in wind, solar PV, and electrification of other energy carriers (e.g., hydrogen) and sectors (e.g., industry)
42 are also driving a rapid increase in other complementary technologies. These include flexible demand, electric
43 vehicles, sector coupling which more broadly includes heat pumps, storage (batteries, power to heat, and power
44 to hydrogen etc.), as well as changes to the grid infrastructure including offshore grids and increased high voltage
45 direct current (HVDC) grids (National Academies of Sciences and Medicine, 2021; Pineda and Vannoorenberghe,
46 2023). Many of these technologies come with their own integration challenges and opportunities (Matevosyan et
47 al., 2021). All these simultaneous changes lead to a high dimensional situation where meeting the primary
48 objective is not a simple problem of “wind integration” but rather a multidimensional energy systems integration
49 challenge (O'Malley et al., 2016).

50

51 Wind power in this rapidly changing environment needs to adapt competitively where it can, by reducing any
52 negative impacts and contributing positively to meeting the power system' primary objective. That is, wind power
53 can become part of the solution instead of being part of the problem.

54

55 Instantaneous penetration levels of 100 % wind have already been reached in some regions (e.g., Denmark) but
56 have not been reached on a country scale synchronous power system⁴ (Söder et al., 2020). At current rates of

² When the challenge is related to a specific technology sometimes the specific technology is specified i.e., wind integration. Although wind is the focus here, we will not use the term as one of the key messages is that wind or any technology cannot be treated in isolation from an integration perspective because there are so many changes happening simultaneously.

³ There is a plethora of terminology that can be confusing, including grid, power grid, network, power system, electricity system etc. Without defining them strictly the grid, power grid and network are all similar and refer to the network of transmission and distribution lines and associated equipment i.e., the “wires”. The power system and electricity system are similar, power system being the more colloquial in the engineering community, and includes in addition to the grid the generation and demand etc. Therefore, the grid and wind are part of the power system. However, grid has been adopted as the term of common use even when power system may strictly be more correct. Here both terms grid and power system are used throughout with best endeavours to avoid ambiguity.

⁴ Synchronous power systems are dominated by synchronous machines (mainly generators) whose mechanical speeds of rotation are all synchronised together as if they were all mechanically coupled, but this coupling is achieved electrically. Virtually all power systems are synchronous, but it is not necessarily defined by a geographical, political and/or commercial boundary but by a technical boundary. Denmark's power system is part of two synchronous power systems one in the west (part of the much larger European Continental synchronous area) and one in the east (part of the larger Nordic synchronous area). Ireland and Great Britain have their own synchronous power system.

57 deployment and considering the stated targets, instantaneous penetrations of 100 % wind in synchronous power
58 systems will be a common event in coming years with 100% wind energy penetrations being approached in the
59 coming decades, e.g., Ireland (Denholm et al., 2021; Ireland, 2021). Over the past few years there have been many
60 papers on the topic of 100 % renewables which typically do not delve into the power systems challenges and are
61 therefore of limited utility. The reader is cautiously directed to many papers on the topic, see for example (Breyer
62 et al., 2022).

63

64 Maintaining supply demand balance reliably and at least cost in high penetrations of wind (and solar PV) comes
65 with significant integration challenges (Hodge et al., 2020; Holttinen et al., 2020; Denholm et al., 2021). To
66 describe the opportunities for wind power in this integration challenge, a systematic framework that coincides
67 with planning, operational and market practices is required to define a set of power system needs and power
68 system services (Chaudhuri et al., 2023). Historically the needs and services paradigm were inherently embedded
69 into the vertically integrated utility concept and was not explicitly stated and more recently it formed the basis of
70 electricity markets (Schweppe et al., 2013; Kirschen and Strbac, 2018). Most fossil fuel, nuclear and hydro
71 generation are interfaced to the grid using synchronous machines (SMs)⁵ and are the main providers of most of
72 the power system services. When these SMs are in synchronism with one another, they form a synchronous power
73 system. SMs are well known and understood for decades, and they are at the heart of power systems, their
74 planning, and operations (Glover et al., 2012). Increased wind power and the other technologies are changing
75 existing power systems and therefore the needs and if they replace other technologies e.g. SMs there is a reduction
76 in the supply of some services. This requires wind power, and all other technologies connected to the grid to meet
77 these changing needs with services (EirGrid, 2023).

78

79 The IEA initiative (Dykes et al., 2019) has evolved, and this paper is part of a The Grand Challenges of Wind
80 Energy publication series (Veers et al., 2022) focussed on research challenges for wind technology that address
81 the integration challenges. By their nature integration challenges can be technological, market based, policy
82 related, standards related, legal and/or societal (Ahmed et al., 2020; Diógenes et al., 2020; Zhou and Solomon,
83 2020; Susskind et al., 2022; Kirkegaard et al., 2023REF)). Here we focus only on research challenges related to
84 the wind technology only. The remainder of this paper is organised as follows. Section 2 introduces the
85 integration of wind into power systems and the services paradigm which is the basis of the assessment of the
86 research challenges that are detailed in Sections 3 to 6. Section 7 is a discussion with some recommendations and
87 Section 8 concludes. Section 2 considers Energy and Capacity, Section 3 Frequency and Voltage Control, Section
88 4 Synchronisation and Damping and Section 5 Protection and Restoration. Section 6 has a Discussion and
89 Conclusions.

90

⁵ Most SMs in capacity terms in power systems are synchronous generators but other SMs include synchronous condensers and synchronous motors that have very similar characteristics from a services perspective.

24.1 Integration of wind power in impact of wind power on power systems

From an integration perspective the characteristics of wind and solar PV (ESIG, 2019; Denholm et al., 2021) fall into two broad areas:

(1) the operational variability, uncertainty, and distributed nature of the primary energy source that impacts the economics ~~and reliability of the power system as penetration levels increase of the power system but also on the reliability as penetration levels increase~~

(2) the interface of most of the wind and solar PV to the grid is not by SMs but by power electronic inverters/converters⁶ that are highly controllable, non-synchronous⁷ and have limited overloading capabilities that mainly impact on the reliability of the power system.

The operational variability, uncertainty, and distributed nature of the primary energy resource is a major difference of wind and solar PV when compared to other primary sources such as fossil fuel, nuclear generation, and hydro with pondage (Bird et al., 2013). It is not a case that these other primary sources are not variable, uncertain, and distributed, they are, but the characteristics are different. These differences are all related to the fact that these primary energy sources can all be easily stored, hence the variability and uncertainty can be buffered. Fossil and nuclear fuel can also be transported to take advantage of economies of scale at a centralised location. In the case of wind and solar PV the primary energy source cannot be stored and hence the generation is more distributed, and the full variability and uncertainty needs to be balanced internally by wind and solar PV by curtailing or by other parts of the power system such as other generation, demand, or storage which are described in the literature as the need for flexibility (Lannoye et al., 2012). Curtailing wind and solar PV (or storing it) need the right economic incentives and can therefore be part of the solution providing flexibility instead of solely demanding flexibility from the system (Morales-España et al., 2021).

In the early days of the wind industry (1980s to 2000s), from a reliability point of view the “do-no-harm” philosophy was adopted, i.e., if there were problems on the power system the wind power would invariably just disconnect so as not to cause any further reliability issues (Christensen, 2010; Lauby et al., 2011; Zavadil et al., 2011). Therefore, wind power did not impose any additional needs on the power system and the only service wind provided was energy that was dependent on the wind availability on the day, with little or no operational planning to account for wind variability and uncertainty with a forecast. At that time, driving down Levelized Cost of Energy (LCOE) was the major objective of the wind industry as it still needed heavy subsidies. This modality of operation was pervasive until around one/two decades ago when wind power started to represent a significant portion of energy provision on some power systems. Inevitably some needs driven by wind were recognised, and

⁶ Converters go from alternating current (AC) to direct current (DC) and inverters go from DC to AC. Modern wind generation for technical reasons produces AC ~~and some or all of this that~~ is then converted to DC and is then inverted to AC that is injected into the AC grid. Inverter and converter are sometimes used interchangeably.

⁷ The simple definition of non-synchronous is that they are not synchronous machines and do not have the inherent physical characteristic of coupling (synchronizing) their mechanical rotation i.e. the power electronics decouples the mechanical inertia of the wind turbine from the grid. However, in a synchronous power system the electrical frequency of voltages and currents must be coupled to the electrical frequency of the power system (50 or 60 Hz) and this is achieved by the power electronic controls.

123 additionally some services were required and/or incentivised from wind power such as forecasting, fault-ride-
124 through, active power regulation for frequency control, and local voltage control that had been adopted in several
125 power systems (Mohseni and Islam, 2012; EirGrid, 2019; IRENA, 2022).

126
127 During this period the concept of calculating the so-called integration costs was mooted (Smith et al., 2007;
128 Ueckerdt et al., 2013). There is a wide literature in this area even though it can be easily shown it is impossible to
129 calculate in an absolute sense the integration cost of a specific technology e.g., wind, and remains a controversial
130 subject (Müller et al., 2018). Relative integration cost can be calculated by comparing two different portfolios,
131 i.e., two power systems with different portfolios of generation and other technologies that serve the same demand
132 with equal reliability can have their costs compared (EirGrid, 2008; Holttinen et al., 2019). The portfolio cost is
133 highly system dependent and can increase rapidly as penetration levels of wind increase (Cochran et al., 2014).
134 For example, in a power system that is inherently flexible the cost of operational variability and uncertainty, while
135 maintaining reliability may be negligible up to a point where the flexibility saturates, portfolio costs can then rise
136 rapidly (Figure 1). These costs can and do occur throughout the power system and can range from being directly
137 part of the cost of the wind or costs elsewhere in the power system, but as stated above it is impossible to allocate
138 these costs to a specific technology.

139


140 **2.11.2 Wind technology for power system integration**

141

142 There exist four distinct wind turbine generator technology classifications (Figure 2). Type I & II dominated the
143 early years but are no longer deployed at scale. Power electronics began appearing in wind turbines around 20
144 years ago with the development of Type III wind turbines that employs a wound rotor induction generator with
145 a four-quadrant power converter. This addition affords the capacity to regulate rotor circuit currents, resulting in
146 an expanded operational range compared to Type I & II. Type III is also labelled as Doubly Fed Induction
147 Generator (DFIG), is characterised by flux-vector control, effectively decoupling active and reactive power
148 components to optimise output power. DFIGs have many advantages over Type I & II

149

150

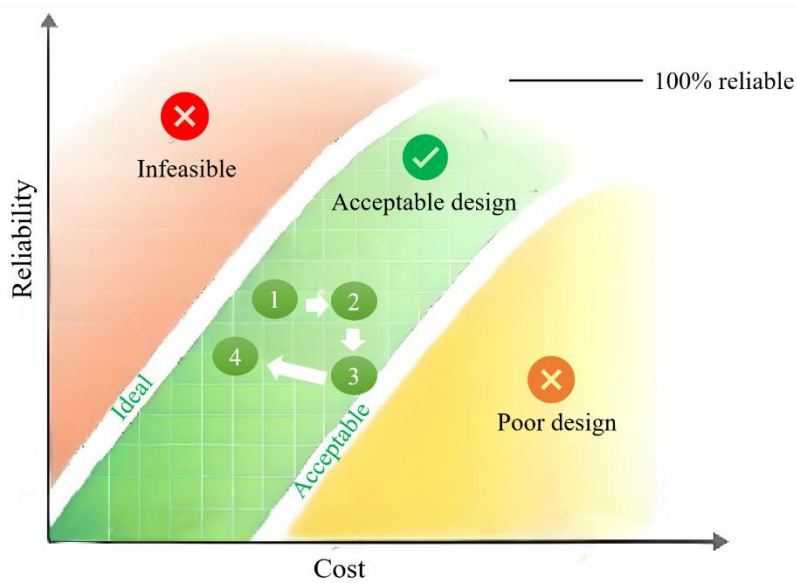

151

152

153 **Figure 1: Cost-reliability plane for power system design. The ideal design boundary is inherently maximising the**
 154 **benefit by minimising the cost subject to a required level of reliability. Above this ideal there is an infeasible region**
 155 **and there is also an acceptable design boundary below which the power system design is deemed to be poor and not**
 156 **acceptable. Between the ideal and acceptable boundaries is the acceptable design region where the design is deemed**
 157 **to meet the primary objective. Impact of variable renewable energy (VREs) resources, wind and/or solar PV may**
 158 **deteriorate the reliability and may incur some additional costs. The progression from 1 A through 4D represents a**
 159 **possible trajectory that is reflective of the evolution of designs as VRE penetrations increase. From and as for example**
 160 **services from VREs evolve. For example from 1 to 2 there is a cost decline e.g. to do with VRE competitive economics,**
 161 **from 2 to 3 is a decline in reliability due to the impact of increasing VRE (e.g. lower inertial response) at 3 to prevent**
 162 **moving into an unacceptable region a new service (e.g. fast frequency response) is introduced and moves the power**
 163 **system to 4 where it is close to the ideal boundary. dependent on research.**


164

165 including lower cost, lower weights, and the ability to control both active and reactive power (Ackermann, 2012).
 166 Type IV involves either a synchronous or induction generator, connected to a full-scale back-to-back frequency
 167 converter isolates electrical generator dynamics from the grid (Singh and Santoso, 2011).

168 **Variable speed wind turbines (Type III and IV) are is now the dominant technology. Type III is the most installed**
 169 **onshore, while Type IV dominates the offshore market (WindEurope, 2023). Type IV wind turbine has additional**
 170 **advantages such as optimised operation over all wind speeds, full control of active and reactive power production,**
 171 **augmented transients handling capability and improved power quality (Chen et al., 2009).**

172 ¶

173

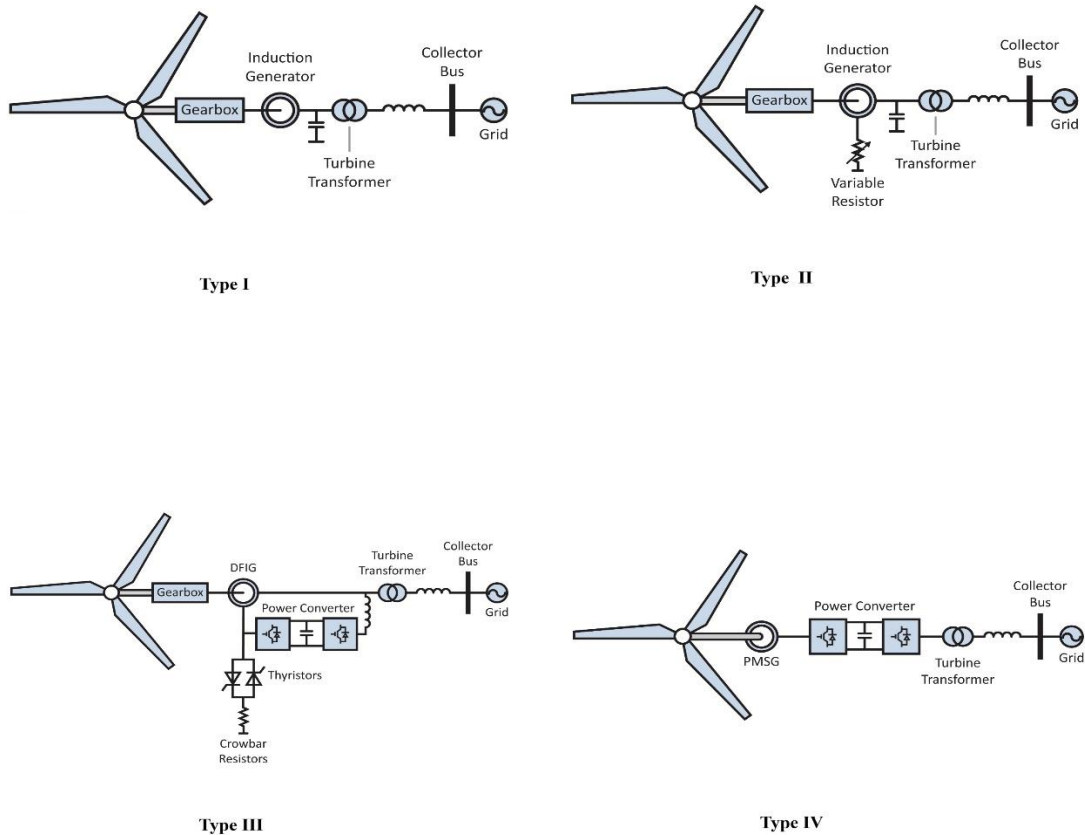

174

175

176 **Figure 2: The four types of wind turbine generator technology. Type I: squirrel cage induction generator model.**
 177 **Type II: squirrel cage wound rotor induction generator with external rotor resistance model.** Type III: double-fed
 178 **nonsynchronous generator model.** Type IV: full power converter generator model ((Osman et al., 2018), used with
 179 **permission).**

180

181 The power electronic inverters/converters that connect wind and solar PV to the grid have fundamentally different
 182 characteristics than SMs with respect to their ability to, e.g., maintain the frequency of the power system within
 183 stable limits. Other new technologies that are similarly interfaced to the grid by power electronics may add to
 184 these challenges include batteries, HVDC etc. Inverter Based Resources (IBR) is used to collectively describe
 185 these technologies that are interfaced to the grid by power electronic inverters/converters (Lin et al., 2022). The
 186 penetration levels of wind and solar PV are now so high in many power systems that they are beginning to replace
 187 fossil fuel generation (and even nuclear in some cases) in planning and operational time frames (Chaudhuri et al.,
 188 2023). Therefore, there is a trend towards the disappearance of SMs and their replacement with IBRs. This trend
 189 has consequences: a change in the needs, and the supply of services, which may in the future be supplied by IBRs
 190 including wind. Power systems that will approach 100% renewable generation will face the dilemma of keeping
 191 SMs with significant cost implications to provide services or relying on wind and/or other IBR-based technologies
 192 (solar PV, battery etc.) to provide the services (Hodge et al., 2020). Simply keeping SMs is not in itself a perfect
 193 solution since they may not be at the correct location or may be too expensive (Appleby and Rositano, 2019).

194

195 Of note is the ability, via the controls, of IBRs to not just operate in grid following mode (that is, other
196 technologies, typically SMs in the power system setting the frequency and voltage for them to follow), but also
197 the ability to be grid forming (capability to set and maintain frequency and voltage) and can also combine
198 characteristics of both (Kroposki et al., 2017). This is an extremely active research field in the power systems and
199 power electronics domains (Ackermann et al., 2017; Kroposki et al., 2017). For example, there is significant
200 research activity to try and establish what is the best ratio of grid forming and grid following inverters in an IBR-
201 dominated system and the current estimates have the grid forming penetration at around 20 ~ 30% (Matevosyan
202 et al., 2021). While the fundamental principles of IBR controls are a research topic regardless of the host
203 technology, the implementation in wind turbines will need to be adjusted or tailored to their characteristics (Veers
204 et al., 2023). Similarly for other host technologies, power-electronics-related solutions will be developed for IBRs
205 such as solar PV and battery storage, and this blurring of the boundaries between the technologies is to be expected
206 as the power system becomes much more integrated, and the wind technologies become more heterogeneous.

207

208 Another example of this heterogeneity is the research challenges for planning and operating offshore grids
209 (Cutululis et al., 2021; Tande et al., 2022). These include optimising the stepwise offshore grid buildout including
210 offshore energy hubs and hybrid AC/DC grids, considering uncertainties and the long lifetime of the
211 infrastructure, future amount of connected wind capacity and hydrogen demand. Other additional considerations
212 are dynamic electrical cables for floating wind power plants, and either floating or subsea substations to connect
213 the wind power plant to the offshore transmission grid, as well as subsea collection systems for grid connection
214 of large floating wind power plants.

215

216 Hybrids are another good example of heterogeneity e.g. wind power combined with storage and solar PV which
217 can help to lower the impact of variability and uncertainty and hence reduce the need for some services (Stenclik
218 et al., 2022). In hybrid plants for example the addition of storage, across timescales from short duration to even
219 long duration storage in future, and the addition of solar PV, which may be a complementary resource to wind,
220 will help increase the plant's ability to provide services to meet the needs of the power system (Nema et al., 2009;
221 Stenclik et al., 2022). It is important to note that the advantages of combining the technologies come from shared
222 transmission capacity, quantity of power electronics and controls which can therefore, at a reduced cost, maintain
223 the performance and the overall quality of the services provided to the power system. There are also regulatory,
224 subsidy, commercial and market advantages and can be very system specific. There are no purely synergistic
225 technical advantages inherent in hybrids and from a services perspective there may be limitations imposed by
226 constraining the technologies to act in a coordinated manner (Stenclik et al., 2022; Kemp et al., 2023).

227 **2.21.3 Future needs and services an opportunity for wind power**

228 For the power system to meet its primary objective wind and other technologies need to either adapt to the power
229 system and/or the rest of the power system needs to adapt to them in much the same way as has occurred
230 historically with SMs (Figure 3). Wind no longer must be accommodated but rather the power system needs to
231 enable its increased penetration. The end destination in this process is far from clear but will be heavily influenced


232 by research and innovation in power systems and the technologies that make up the power system including wind
233 (Veers et al., 2019). In this changing environment, power system needs and services should be assessed to ensure
234 power system reliability at least cost and/or to avoid providing services that are no longer needed which can be
235 costly. Resources, policy environment and stage of development are different across the world and there is and
236 will be a wide variety of power systems with distinct characteristics and while most power system needs and
237 services will share a lot in common some of them will be system specific.
238




239
240 **Figure 3: Wind adapting to the power system and the power system adapting to wind - a pathway to a cost-**
241 **effective reliable power system.**

242
243 The required services can be found from different parts of the power system but here we focus on wind-based
244 solutions (Figure 4) that require significant research in the coming decades and that may have the potential to be
245 competitive against other sources of these services. For wind this translates into a multiscale research and design
246 challenge at the individual turbine, plant, hybrid level, with mechanical, electrically and/or control centric
247 solutions to the provision of services and a technical/economic comparison with other alternative sources for these
248 services to meet the power system needs (Figure 4). For other technologies such as solar PV and batteries this
249 translates similarly.

250
251
252
253

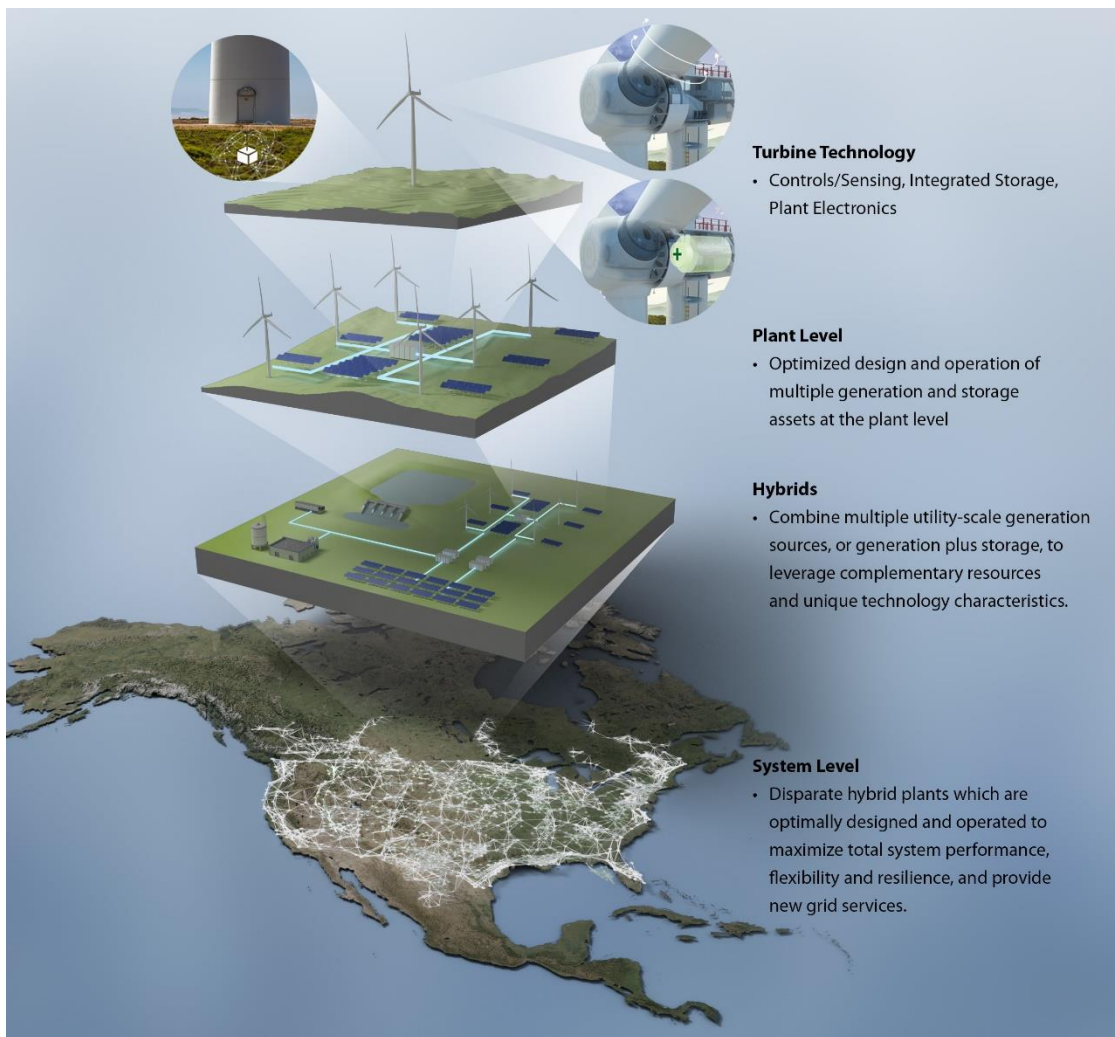

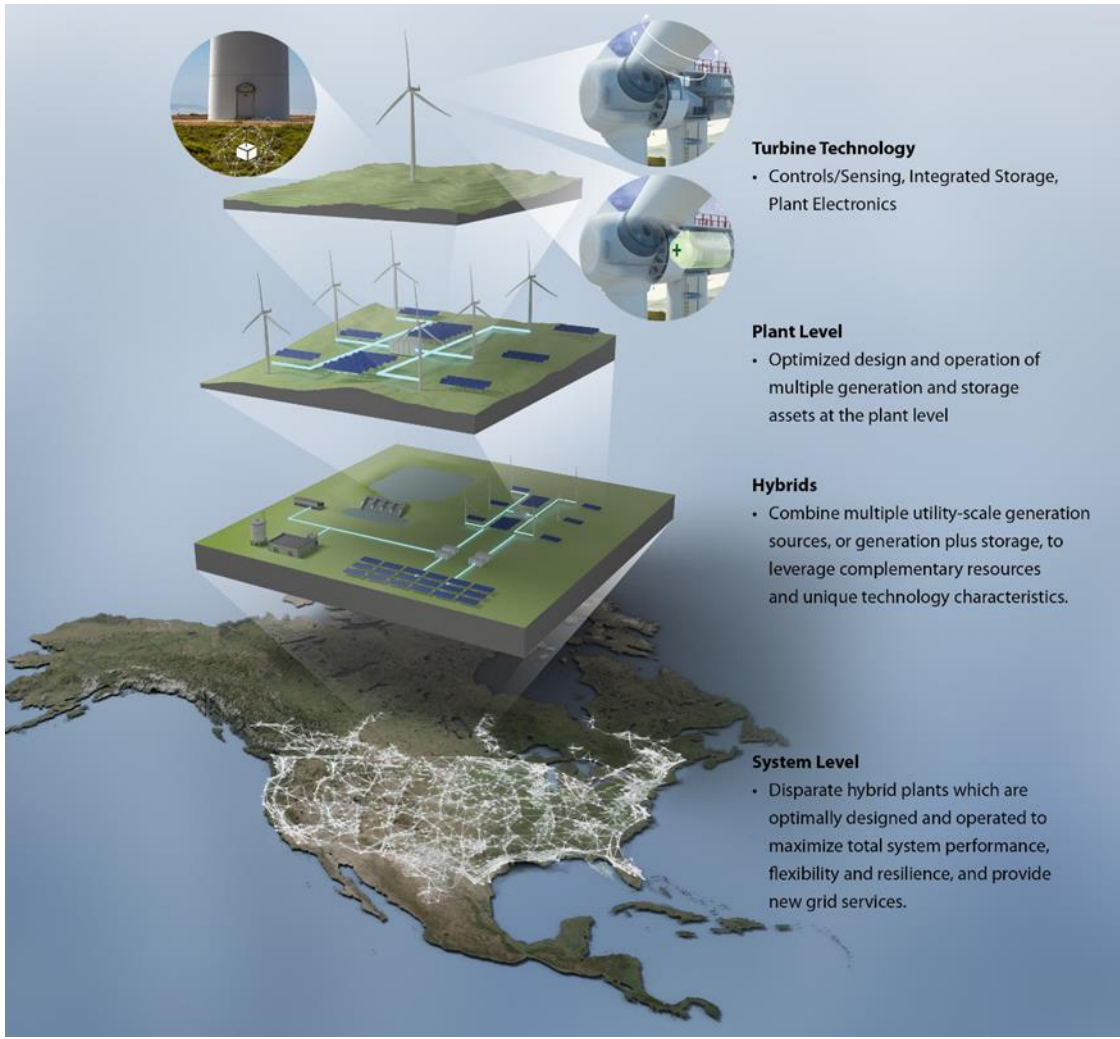

254
 255
 256
 257
 258
 259
 260
 261
 262
 263
 264
 265
 266
 267
 268
 269
 270

271
272
273
274
275
276
277
278
279
280
281
282
283
284
285
286
287
288
289
290
291
292
293
294
295
296
297
298
299
300
301
302
303
304
305

Figure 4: Wind turbine to plant to hybrid to power system level and the provision of services to meet the power system needs.

Procurement of services to meet the needs can range from a mandated capability (i.e. interconnection requirements/grid codes) to a capability that is paid for in a monopoly or a formal competitive market scenario and all the variations in between. In some cases, the need may be inherently met with no scarcity and hence no need for a mandate or incentives (Ela et al., 2019; Ela et al., 2021). This variation is evident in the range of services that exist in many of the electricity markets across the world (Rebours et al., 2007a, b). Procurement mechanisms are evolving in parallel to incentivise the services to meet the needs in an optimal manner (Hobbs et al., 2022). It is important that the wind industry is incentivised, by market signals, grid codes etc., through design and innovation to mitigating needs and/or providing competitive power system services. The wind industry needs the right incentives, so wind technology evolves to maximise its value to the system rather than solely maximising its power output. With wind and solar PV having near zero marginal cost this is also challenging electricity market and policy design (Neuhoff et al., 2023). Innovations in response to wind such as societal acceptance and lifestyle adaptations to energy availability are also changing (Schuitema et al., 2018; Steg et al., 2018). These non-technical challenges are not addressed in this paper.

There is no ideal way of cleanly defining needs and services as the power system is a highly integrated continuum of overlapping, interacting technical characteristics from a wide range of technologies all acting in unison to maintain supply demand balance reliably and at the lowest cost. Needs are not necessarily met by individual services, but by combinations, while other characteristics and functionalities enhance a service that meets a need or reduces a need. Furthermore, the needs themselves are uncertain into the future as they are a subject of the evolving research in the power systems community, the technical characteristics of the IBRs and other new technologies, and the reliability requirements which are also evolving as are technological methods that can actively maintain security standards (Hedman et al., 2011; Bialek et al., 2021; O'Malley, 2022). A good example of this evolution is the recent update by the classification of stability needs in power systems which is driven almost exclusively by IBRs (Hatzigiorgiou et al., 2020). Here we adopt the work of the Global Power System Transformation Consortium (G-PST), and the proposed structure of eight distinct ~~and their structure that highlights eight distinct~~ needs which broadly include the stability needs identified by (Hatzigiorgiou et al. (2020): energy & capacity, and the six technical needs further grouped into frequency & voltage control, synchronisation and damping, and protection and restoration (Figure 5).

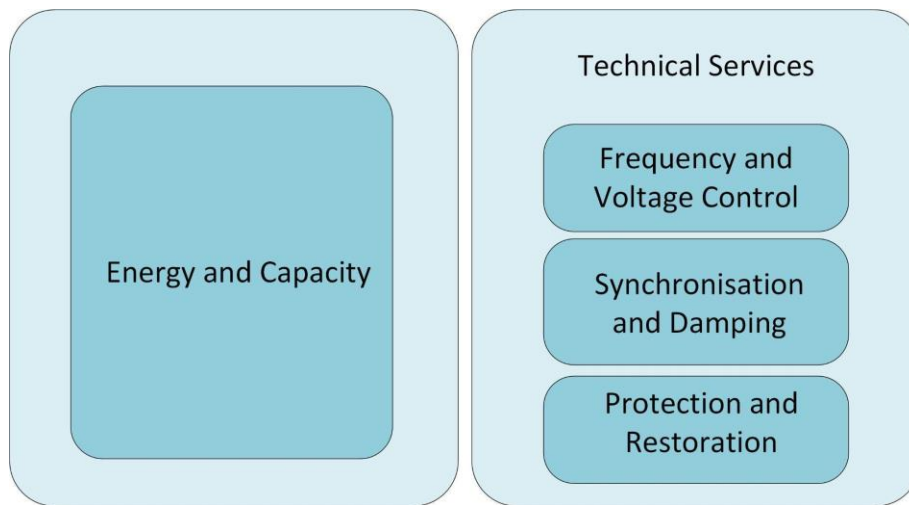


Figure 5: Power system services adapted from (Bialek et al., 2021).

In the following four sections wind technology is assessed with respect to meeting these needs in electricity systems driven by increasing penetration of wind and other technologies. The sections are organised logically around the grouping of the services indicated in Figure 5. This is achieved in the context of changing power system needs and the removal of technologies that provide the services to meet these needs, with the main example being the potential decline of SMs.

~~Section 2 considers Energy and Capacity, Section 3 Frequency and Voltage Control, Section 4 Synchronisation and Damping and Section 5 Protection and Restoration. Section 6 has a Discussion and Conclusions.~~

~~32.~~ Energy and Capacity

Energy and capacity are the two most basic power system needs as supply demand balance cannot be met if there is not enough energy, or if at any time instance or location there is not enough available capacity (generation, transmission grid, etc.). In many power systems, wind is providing a significant proportion of the energy needs. For example, in Denmark wind accounts for over 50 % of the electricity demand on average, more than 100% in some instances (Holtinen, 2023), and several jurisdictions are targeting 80 to 100 % annual energy from wind and solar PV, with wind being dominant in some cases such as in Ireland (SEAI, 2023). In many respects the energy need/service is the primary focus of the other papers in this Grand Challenges series which focus on lowering their costs and increasing their lifetime, reliability, and performance (Veers et al., 2022; Veers et al., 2023).

Resource adequacy, the ability to meet the demand, has traditionally been about capacity and is equivalent to having the generating capacity and transmission to serve the demand at every point in time and at every location (Schweppe et al., 2013). It could traditionally be approximated as the ability to meet peak demand, but wind and solar PV is changing this and moving the critical time to other periods of low wind and/or solar PV e.g. peak

332 aggregate net demand (demand less wind and solar PV). This is undermining some of the calculation
333 methodologies that were based on assumptions that may no longer be valid and may need to evolve (Stenclik et
334 al., 2021). Having abundant volumes of energy at times when demand from the consumer is low is of minimal
335 value and vice versa. Therefore, when the timing of energy from a technology correlates with demand, this
336 increases the capacity value of a technology and is fundamental to maintaining the reliability of the power system
337 (Keane et al., 2011). SMs with readily storable primary energy sources (e.g., fossil fuels, nuclear and hydro with
338 pondage⁸) are dispatchable and can therefore be available at peak times and have capacity values close to the
339 maximum of unity (the minimum is zero). However, the capacity value of wind (and solar PV) is relatively low
340 compared to SMs, ranging between 10-35% (Denholm et al., 2019; Holttinen et al., 2021).

341
342 The capacity value of wind reduces with wind penetration due to the correlation effect and it varies from year to
343 year depending on weather patterns (Hasche et al., 2010; Cradden et al., 2017). Therefore, with increasing wind
344 (and solar PV) penetration and the displacement of SMs the contribution of wind declines leading to an adequacy
345 deficit, which economically constitutes the single biggest challenge to very high penetration of wind and solar PV
346 (ESIG, 2019). Any design of wind power technology that improves the generation at lower wind speeds and
347 increases the number of running hours should improve the capacity value of wind. For example, low wind designs
348 with larger rotors may in the correct circumstances increase its capacity value (Dalla Riva et al., 2017; Wisser et
349 al., 2020; Swisher et al., 2022). In general, for best impact on capacity value, diversification of turbine types is
350 key as it reduces the correlation between their energy output, for example transmission capacity enables this
351 diversification as does mixing of onshore and offshore wind (EPRI, 2022a). An extreme version of this and a
352 long-term research topic is airborne wind power plants that can harness the wind resource at a high altitude that
353 is steadier than regular wind turbines with potentially far higher capacity values but face very significant research
354 challenges (Kolar et al., 2013; Cherubini et al., 2015; Bechtle et al., 2019).

355
356 As stated above, needs and services are overlapping and interacting. A good example of that is energy and capacity
357 as is evidenced in the debate around energy-only markets (where capacity is incentivised by high energy prices at
358 periods of scarcity) and capacity markets (where capacity is directly rewarded) (Hogan, 2005). The focus is now
359 shifting from minimising LCOE towards maximising the value of wind, which effectively captures all the services
360 (Denny and O'Malley, 2007; Dykes et al., 2020; Loth et al., 2022). It no longer matters that the cheapest possible
361 electrons are being put into the grid (as energy), but what matters is when and where those electrons are put into
362 the grid (requiring the energy and capacity) adding additional value to the system. Typically, energy and capacity
363 are the most valuable services but there are indications that as we approach higher penetrations of wind and solar
364 PV the more technical services, covered below and/or developed to meet future needs, could see their relative
365 value increase (Ela et al., 2017). Therefore, with the changing needs and services there is a need to strike a balance
366 between maximising the value of energy and capacity without potentially undermining the cost effectiveness or
367 ability of providing the technical services which could unduly increase the portfolio cost and/or degrade the

⁸ These primary energy sources can also be variable due to e.g. gas supply limitations, drought etc. This broadening out of what can impact resource adequacy is part of the evolution of the methodologies.

368 reliability of the power system (Figure 1). A good example of this can be found in this series of Grand Challenges
369 papers where plant controls can increase the energy yield of wind power plants, reducing wake losses and loading
370 of components and are also the way that wind can provide more cost-effective power system services (Meyers et
371 al., 2022; Veers et al., 2023). Energy management systems that seamlessly provide energy and other services
372 optimally are key to provide profitability of wind plants to owner operators while maximising value to the power
373 system when needed (Van Dijk et al., 2017). This is an ongoing research topic (IEA, 2023). These energy
374 management systems will need forecasting to determine the expected energy and other power system services
375 from wind and to do so in a coordinated manner, e.g., if wind is curtailed the wind capability after curtailment
376 needs to be estimated (Göçmen et al., 2018).

377
378 The use of wind-based hybrids together with solar resources (the less correlated with wind the better) can
379 maximise grid capacity and at the same time reduce the need to build out the grid and be beneficial. This approach
380 can result in higher aggregated capacity factors⁹ (average power output with respect to maximum rated output),
381 even if the shared point of interconnection can reduce the capacity factor of each individual technology (EPRI,
382 2022b). Hybrids with storage can make a significant contribution to the adequacy need and is an active area of
383 research and deployment (Murphy et al., 2021). The storage device can be used across timescales to move the
384 energy from less into more valuable time periods. This is true regardless of whether the storage device is co-
385 located with the wind or not; however, directly coupling wind with solar PV and storage can bring down costs,
386 especially when network constraints exist (Jorgenson et al., 2018; Mallapragada et al., 2020). Non-hybrid
387 solutions where wind and storage are not subject to the same constraint may be more beneficial (EPRI, 2022b).

388
389 The continuing development of power system coupling to other energy sectors gives rise to new opportunities
390 for using the energy generated from wind (Van Nuffel et al., 2018). Power-to-X solutions, producing hydrogen
391 and its derivatives, e-fuels like ammonium and methanol, synthetic gases, may in future occur locally at wind
392 power plants, if the grid is congested, and providing storage for wind (Singlitico et al., 2020).

393
394 Future weather dependent power and energy systems require more data and improved tools, in which wind energy
395 needs to be well represented. Wind and solar PV impacts on power systems give rise to consideration of energy
396 adequacy (not enough energy resources for generation even if installed capacity is adequate) and the adequacy of
397 other services (EPRI, 2022b). In the future, as not only power generation but also demand will be increasingly
398 weather dependent due to electric heating and cooling, correlated events caused by common weather patterns need
399 to be considered more carefully when determining resource adequacy at the planning of energy systems
400 (Novacheck et al., 2021; Stenlik et al., 2021). Different weather authorities are working on improving seasonal
401 weather forecasts. The focus of their work lies on calculating the forecast uncertainty using probabilistic ensemble
402 forecasts instead of improving the expectation value of the forecast (Leutbecher and Palmer, 2008). Seasonal

⁹ Not to be confused with capacity value, defined above. Capacity factor is a metric that is more related to minimising the LCOE whereas capacity value is directed towards maximising value.

403 demand shifting of industrial loads also has potential but is nascent in its research and development (Yang et al.,
404 2020).

405

406 Research to drive down LCOE is now being overtaken by the need to maximise the value of the wind with respect
407 to evolving energy and capacity needs and other services, which are themselves evolving. To achieve this, the
408 research focus is being pushed outside the wind technology and towards storage technologies and e.g. Power- to-
409 X that needs to work in a coordinated manner with the core wind technology. The balance between these becomes
410 a higher dimensional co-optimisation problem, in which all potential value streams are accounted for including
411 the six more technical needs/services of the power system. These six technical needs/services focus primarily on
412 the reliability of the power system starting with the power system's two most important attributes, frequency, and
413 voltage.

414

415

416

417

418

419

420

421

422 **Table 1: Brief summary of wind's status and opportunity to provide energy and capacity services.**

Service	Status	Challenge	Research and development needs
Energy and Capacity	Currently provided.	<p>Availability of active power which is affected by weather and leads to variable output of wind power plants.</p> <p>Low-capacity value (availability of wind at right timing).</p> <p>A correct metric for resource adequacy in power systems dominated by wind and solar PV.</p>	<p>Forecasting: especially seasonal weather forecast accuracy.</p> <p>Diversity to wind turbine technology: low wind turbines and long term potentially airborne wind power plants.</p> <p>Long-duration storage in wind and hybrid power plants, including direct power-to-X application at wind plants.</p>

423

424 **43. Frequency and Voltage control**

425 The primary technical attributes of a power system are its frequency and voltage. The frequency is a global
426 attribute that should be kept within preferred limits around a nominal value (typically 50 or 60Hz) throughout the
427 grid. The voltage is a local attribute that should be kept close to constant, which is different in different locations
428 (ranging from a few hundred volts to just over one million volts). Controlling the frequency and voltage around
429 their nominal values is critical to maintain reliability of the power system.

430 **43.1 Frequency control**

431 Frequency control directly addresses flexibility. Too little supply or too much demand reduces frequency and
432 requires an increase in generation or a decrease in demand; too much supply or too little demand increases the
433 frequency and requires a decrease in generation or increase in demand to maintain frequency within its preferred
434 limits. Frequency control will be impacted both by variability and uncertainty of aggregate net demand as well as
435 by the relative number of SMs and IBRs online. There is considerable beneficial smoothing of variability and
436 predictability (in normalised metrics), but increased wind and solar PV will result in a more variable and less
437 predictable net demand. This drives the need for frequency control and more flexibility resources throughout the
438 power system. The power electronics and most importantly its control that interfaces wind to the grid typically

439 decouples the mechanical inertia of the wind turbine from the grid. Inertial response from SMs is inherent,
440 instantaneous, and impossible to prevent and with large numbers of SMs (mainly synchronous generators) on a
441 power system traditionally it was abundant and there was no need to reward it (Eto et al., 2010; Muljadi et al.,
442 2012). If SMs are replaced by IBRs this will lead to a reduced inertial response and the frequency control need
443 may not be met, and alternatives need to be found (Doherty et al., 2005; Ela et al., 2013; NGESO, 2023). This
444 inertia issue has had significant research attention recently although in some smaller systems it has been central
445 for several decades, emphasising the point that every system is different (Mullane and O'Malley, 2005; Doherty
446 et al., 2005; Mullane and O'Malley, 2006; Denholm et al., 2020). On larger systems with pockets of IBRs and a
447 lack of SMs can also exhibit localised low inertia type behaviour during faults (Abdul Wahab and Mohamed,
448 2012; Badesa et al., 2021).
449

450 The time scales of variability & predictability and inertial response are different. The variability & predictability
451 results in a need for relatively slow frequency control while the inertia issue results in the need for faster frequency
452 control. Frequency control goes from very fast “inertia” like response times (seconds and below), to fast frequency
453 response (seconds), to “primary frequency response” or “governor response” (seconds to minutes), to “regulation
454 reserve” or “automatic generation control reserve” to slower “flexibility reserve” or “load following” (minutes
455 and beyond) – eventually frequency control merges with the energy service (Ela et al., 2019). This highlights that
456 these needs lie on a continuum and the overlapping nature of the services as for example faster frequency response
457 reduces the need for inertial response (Delille et al., 2012).
458

459 Wind turbines can provide frequency control services and have done so for at least a decade (Ela et al., 2014).
460 Wind turbines can be curtailed to decrease generation to decrease frequency and when curtailed wind can increase
461 generation to increase frequency. TypicallyTypically, wind turbines will control their pitch and torque to change
462 their power output. These control mechanisms operate in the order of seconds, something that allows them to
463 follow reference signals that operate in 4 second intervals for example, which is the time scale of automatic
464 generator control in many power systems (Bevrani and Hiyama, 2011). Therefore, wind can provide many aspects
465 of frequency control services but may not be competitive because of the energy losses due to curtailment of wind.
466 In some operational circumstances such as stability constraints and minimum generation constraints, wind may
467 already be partly curtailed making frequency control more competitive (Denholm et al., 2019). One way of
468 avoiding the curtailment of wind when providing frequency control in an upward direction is to use the energy
469 stored in the rotating blades that can provide frequency control by slowing down the blades, without any pre-
470 curtailment of wind energy. With this method, a wind turbine can provide a power boost of 5-10 % of its rated
471 power. While this effect may only be temporary (as there is a limit to how much you can slow down the blades),
472 it can work together with other mechanisms to help restore frequency to a stable level (Bonfiglio et al., 2018).
473 Wind as part of a hybrid with storage can also provide frequency control services. One of the challenges to be
474 addressed is the optimised control and operation of wind-based hybrids for frequency control support (Liu et al.,
475 2019).
476
477

478

479 The fast controls of wind power plants (operation in seconds) have proved to give good compliance support in
480 low inertia operation (Ela et al., 2014; Denholm et al., 2021). For faster responses, some open issues remain, like
481 the ability of measuring, computing, and transmitting the frequency signal to the wind turbine/plant controller fast
482 enough, with a response time in the 100s of milliseconds scale. Operating wind turbines power electronics in grid
483 forming mode would significantly decrease their reaction time and, to some extent, mitigate the challenge with
484 measuring, computing, and transmitting the frequency change. The enhanced static synchronous compensator (E-
485 STATCOM) that integrates supercapacitor and grid forming control emerges as promising technology for
486 furnishing wind farms with inertial power response (Zhao et al., 2023).

487

488 While initial field tests show the viability of such operation, they also highlight challenges, with the most
489 pronounced one being the limited energy stored in the wind turbine rotor which if not properly managed, can lead
490 to opposite effects, i.e., reducing the power infeed to zero (Roscoe et al., 2021). Also, grid forming operation of
491 wind turbines will most likely have an impact on the drivetrain, and the known mechanical impacts on wind
492 turbine drive trains that need to be addressed and can result in additional costs and reliability impacts that may
493 not be justified (Girsang et al., 2014; Gloe et al., 2021; Zhang et al., 2021; Chen et al., 2022; Nguyen et al., 2022).
494 Under certain grid disturbances, such as phase angle jumps, active power oscillations may be induced within grid
495 forming wind turbines, which tend to propagate to the drivetrain of wind turbines and even trigger torsional
496 vibrations, degrading the lifetime and reliability of mechanical components (Avazov et al., 2022; Lu et al., 2022).
497 The recent work in (Roscoe et al., 2020) has shown that without additional energy storage, grid forming wind
498 turbines have limited power responses under some unscheduled frequency disturbances of power grids. This
499 highlights that the provision of services can have an impact on the cost and reliability of the wind technology and
500 its performance. Another relevant example is when a turbine provides frequency control and changes its pitch
501 and/or torque, which has implications on their wakes that propagate downstream and impact downstream turbines.
502 These impacts can be modelled using wake models and can affect the performance of downstream turbines if not
503 ~~taken into account~~considered properly (Houck, 2022; Meyers et al., 2022). While most studies assume that wind
504 turbines are capable of accurately providing a short-term increase in their active power production, they usually
505 employ very simplified representations of the flow, e.g., turbulence is not represented, even if it can have a large
506 impact on the ability of the wind turbine in providing that extra active power (Veers et al., 2023). The energy
507 contained in the air flow field generally supports the provision of the desired short-term increase, as a power
508 increase from curtailed state to above available power is possible (until the resulting wake propagates to the
509 adjacent turbines), but the implications for service provision have not yet been investigated in detail. Plant control
510 and flow control can also take advantage of wake steering to distribute curtailments smarter and reduce losses
511 when providing services. Wake steering happens in the time scale of minutes, so this is not as useful for the fast
512 response services.

513

514 An important part of frequency control is the ability to maintain the desired level of response in accordance with
515 the service. Accurate wind power predictions are essential to offer such services reliably. Over or underestimates
516 of energy and/or frequency control capability will result in economic loss either through curtailment and/or

517 penalties. The wind industry can facilitate forecasting by the development of further systems and meteorological
518 measurements at the wind turbine and plant level and by providing these measurements in real-time to weather
519 services and forecast providers (Lin and Liu, 2020).

520

521 One research area that still needs to be addressed is the coordination of plants in a region. Currently, when
522 frequency control services are required from wind plants, multiple wind plants respond. Similarly, as with SMs,
523 this can create an oscillatory effect if the collective response is too strong and not properly designed/tuned. Impact
524 of locational delivery of frequency response suggests that depending on where in the network frequency response
525 is injected, it could have a positive or negative impact (e.g., additional congestion). As wind power plants are
526 distributed, this can help in optimising the system wide coordination of delivery of frequency response (Wu et al.,
527 2018).

528

529 As offshore wind development will be combined with the development of offshore infrastructure based on HVDC
530 converters, supplying frequency control, especially the inertial response with grid forming control, will require
531 proper coordination of control with the multiple converters in the loop, i.e., wind turbine, offshore HVDC, onshore
532 HVDC, etc. (Gu et al., 2020). For HVDC connected offshore wind power plants, the controllers of the multiple
533 converters need to be properly coordinated (Glasdam et al., 2013; Sakamuri et al., 2017).

534

535

536

537

538

539

540

541

542

543

544

545

546

547

548

549

550

551

552

553

554

555

556

557

558 **Table 2: Brief summary of wind’s status and opportunity to provide frequency control services.**

559

560

Service	Status	Challenge	Research and development needs
Frequency control	Currently provided in some locations.	<p>Availability of active power which is affected by weather and leads to variable output of wind power plants.</p> <p>Coordinating various services with the required energy.</p> <p>Revenue loss from Energy Curtailment for Frequency Services</p> <p>Mechanical impacts on drive trains when procuring inertia-like response.</p> <p>Potential frequency stability impacts.</p>	<p>Forecasting for frequency control services, including available power from wind power plants.</p> <p>Grid forming operation of wind turbines for rapid frequency response.</p> <p>Flow models and plant controls adequate for frequency control provision.</p> <p>Methods and models for integrated simulation & analysis of mechanical & electrical wind turbine components</p> <p>Wind-based hybrid systems for frequency support purposes.</p> <p>Regional plant coordination for frequency stability</p>

561
562
563
564
565
566
567
568
569
570
571

572
573
574
575
576
577
578
579
580
581
582
583
584
585
586
587
588
589
590
591
592
593
594
595
596
597

4.3.2 Voltage control

The effectiveness of voltage control is dependent on grid topology and location of the plant. Heavily loaded transmission systems increase the risk for voltage instability. The main factors contributing to the long-term voltage instability and subsequent voltage collapse are: i) stressed power systems with high active and reactive power loading; ii) inadequate reactive power resources; and iii) load characteristics with respect to demand side voltage (Van Cutsem and Vournas, 2007). The fluctuating nature of wind power can exacerbate the voltage instability, playing a significant role in decreasing the dynamic voltage stability margin of the system (Zhou et al., 2005).

Wind power plants can provide voltage control and have been doing so for many years. The impact of the distributed nature of the wind resources on voltage services: if the wind resource is on a distribution grid, instead of a transmission grid, can degrade its voltage control potential. Moreover, it is important to note that voltage control is a localised need. While wind power plants can be used to enhance the voltage control in some locations, there may be certain areas where the siting of wind turbines is not allowed.

Research is ongoing to better understand the limits and dynamic performance of reactive power provision from wind power plants and how to use and coordinate them in practice (Qiao et al., 2009; Ghosh et al., 2020). Grid forming operation of wind turbines will enhance their ability to provide voltage control, an intrinsic characteristic of grid forming operation. Research is still needed on optimising the use of all power electronic devices installed to gigawatt scale offshore wind farms (like Static Synchronous Compensator (STATCOM) installed at the onshore connection point) to improve the dynamic range of reactive power capability. This reflects the highly integrated nature of research in this area, i.e., the multitude of options to solve the challenges inside and/or outside the wind plant (Veers et al., 2022).

Frequency and voltage control are services that wind is already providing typically as part of a portfolio of other technologies such as SMs, and there are no specific long term research challenges for wind providing voltage control. As SMs disappear, the total reliance on wind and other IBR technologies will require additional innovations and coordination with other services, particularly frequency control. The loss of inertial response will require very fast frequency response using, e.g., grid forming controls which will also improve voltage control. However, the proliferation of a multitude of IBRs in combination with reduced inertia, will drive the need for services that address synchronisation and damping challenges, which are on the rise (Vittal et al., 2011) and are dealt with in the next section.

598
599
600

601 **Table 3: Brief summary of wind’s status and opportunity to provide voltage control services.**

602

Service	Status	Challenge	Research and development needs
Voltage control	Currently provided in some locations.	Coordinating various services with the required energy. Fluctuating nature of wind power.	Coordination of wind turbines to enhance voltage support capabilities. Wind turbine coordination for enhanced voltage support. Grid forming operation of wind turbines to provide voltage control. Investigating the operational efficiency of power electronic devices within large-scale offshore wind farms.

603 **5.4 Synchronisation and Damping**

604 Frequency and voltage control, described above, is to maintain frequency and voltage within given ranges around
605 their nominal values. These ranges typically allow large deviations for short periods of time, sudden events, and
606 tighter ranges when the system is in steady state. However, in steady state and during events there can be other
607 consequences that can be detrimental to the reliability of the power system, such as oscillations in the power
608 system that need to be damped and loss of synchronisation (Vittal et al., 2011; Wang and Blaabjerg, 2018).

609

610 **54.1 Synchronisation and angle stability**

611 As stated above SMs are at the heart of the synchronous AC power system that currently dominate worldwide. If
612 SMs decline and are replaced by IBRs including wind, this synchronous characteristic starts to diminish, and a
613 loss of synchronism may occur which can result in the disconnection of SMs and hence a catastrophic loss of
614 generation and a subsequent blackout. To avoid a loss of synchronisation and instabilities induced by loss of
615 torque due to large load angles between groups of SMs, typically due to a ~~large and abrupt supply demand~~
616 ~~imbalance events~~large and abrupt supply demand imbalance event, an increase in the active power output,
617 proportional to rotor or voltage angle deviation is needed (Boldea, 2005). For wind, the mechanism of loss of
618 synchronism can be significantly different from SMs, and it is highly dependent on the control method- grid
619 forming or grid following. With more changes in the grid following and grid forming wind, simple fault-ride-
620 through is not enough and understanding the synchronisation stability and the impact of power electronics
621 (current-limiting) and control is a challenge (Denis et al., 2018).

622

623 Synchronisation will be more critical in the transition phase when there will be significantly less SMs to provide
624 this service. For power systems where there will be no SMs left, this synchronisation need will not exist. There
625 may be a point in time in the transition, with very few SMs active in the system, when the challenge will be
626 temporarily very complex as the synchronous nature of the power system will give way to a non-synchronous
627 system. Hence this is a potentially transitory need and is all linked to the much bigger debate on the fundamental
628 nature of the power system going into the future and includes the debate around the ratio of grid forming to grid
629 following and needs and services with no SMs (Matevosyan et al., 2019; Bialek et al., 2021).

630

631 Synchronising service from wind is not provided today and is an emerging research area. IBR based wind power's
632 role in this challenge could be to mimic a SM, but this may not be the best approach and research effort should be
633 made to leverage the unique capabilities of the power electronics that interface the wind turbines to the grid (Pan
634 et al., 2020; Liu and Wang, 2021). The research challenge is mainly associated with the availability of the extra
635 active power needed during the re-synchronization period. The extra active power may also be needed
636 simultaneously for other services (frequency control, damping etc.) to meet other needs which makes the
637 coordination of the services from wind highly complex (Denholm et al., 2019). One solution could be to use some
638 of the overloading capabilities of wind turbines; however, this will depend on the duration and magnitude of the
639 disturbance and research is needed to understand the impact on expected performance and characteristics (Hansen
640 et al., 2014; Moawwad et al., 2014; Altin et al., 2018). Another approach can involve the use of an energy source,
641 either directly connected to the wind turbine/plant or as part of a hybrid plant.

642

643

644

645

646

647

648

649 **Table 4: Brief summary of wind’s status and opportunity to provide synchronisation.**

Service	Status	Challenge	Research and development needs
Synchronisation	Currently not provided.	<p data-bbox="810 757 1091 965">Availability of active power which is affected by weather and leads to variable output of wind power plants.</p> <p data-bbox="810 1025 1091 1151">Coordinating various services with the required energy.</p>	<p data-bbox="1118 757 1406 875">Wind turbine overloading capability for providing synchronisation.</p> <p data-bbox="1118 936 1406 1151">Optimised operation of wind-based hybrid systems and battery storage connected to the wind turbine/plant.</p>

650

651 **5.4.2 Damping**

652 Power oscillations are generated because of interconnected power systems and power transfer operations. As
653 modern power systems continue to become more and more interconnected to provide adequate power and access
654 to capacity constraint-based corridors, the propagation of these oscillations is required to be tackled for a reliable
655 and secure power system operation. They can be induced by: (1) step changes in load, (2) sudden change of
656 generator output, (3) transmission line switching, and (4) short circuit, (5) change in operating point. In existing
657 power systems these power oscillations are caused by SM rotor angle swings varying from 0.1 to 4 Hz (Rafique
658 et al., 2022). Today, SMs are equipped with additional control loops, called power system stabilisers, which are
659 used to enhance the damping of power system oscillations through excitation control.

660

661 With the increased share of IBRs like wind (and solar PV), with their different characteristics – no “natural” inertia
662 – and dependence on control can lead to more frequent oscillations (Denholm et al., 2021). DFIG wind turbines
663 can cause sub synchronous oscillation (SSO) phenomena caused by the interactions between their controllers and
664 series capacitor compensators (Xu et al., 2019). Similarly, to synchronisation, the main challenge is the availability
665 of active power and the coordination with other services.

666
667
668
669
670
671
672
673
674
675
676
677
678
679
680
681
682
683
684
685
686
687
688
689
690
691
692
693
694
695
696
697
698
699

There are some examples of power system oscillations that are not fully understood and do not originate from any clearly identifiable event but there is evidence that they are related to increased IBR penetrations, from wind and solar PV, (Cheng et al., 2022). One of the biggest challenges is trying to understand their source, something that also relates to the larger issue of having the correct models and tools to investigate these phenomena and to solve them, typically by controller tuning (Miller et al., 2021).

There is a relatively large pool of literature related to power oscillation damping (POD) capabilities from wind turbines and plants (Domínguez-García et al., 2012). The oscillations can be damped by injecting either active or reactive power modulated at the terminal of wind plants (Zeni, 2015). It has been demonstrated through testing that wind power can modulate their active and/or reactive power output based on different control algorithms to provide damping services to the power system (Domínguez-García et al., 2012). It has also been demonstrated that DFIG wind turbines operating in grid forming mode are less prone to SSO type instabilities due to the different nature of their impedance characteristic (Shah and Gevorgian, 2020). While multiple POD control approaches for wind turbines are presented in the literature, the capabilities have not been deployed or used in real life projects.

As stated above for frequency control and synchronisation, wind turbines are quite capable in modulating their active or reactive power output. The challenge associated with that is mostly related to the availability of the extra active power needed – if active power is chosen as the control variable. The coordination with other services is also a challenge and hybrids with storage can alleviate this challenge and enhance this capability. A more challenging issue is the possible impact of the active power modulation on the wind turbine drivetrain since the low frequency oscillations typically occur inside (or very close) to its natural frequencies (Ghasemi et al., 2013).

Providing synchronising power and/or damping is not fundamentally a challenge to wind turbines. The main research challenge will be related to the availability of the active power and, in the coordination of the control with the other assets and services. While the power electronics may have some limitations, their controllability gives additional capabilities that SMs cannot provide and may enable better operation of the power system (Gonzalez-Longatt et al., 2021). These limitations are also a dominant theme of the final two power system needs that are discussed below, protection and restoration, but the controllability may not bring significant advantage.

700
701
702
703
704

705 **Table 5: Brief summary of wind’s status and opportunity to provide damping services.**

Service	Status	Challenge	Research and development needs
Damping	Currently not provided.	<p data-bbox="810 831 1091 1043">Availability of active power which is affected by weather and leads to variable output of wind power plants.</p> <p data-bbox="810 1106 1091 1229">Coordinating various services with the required energy.</p> <p data-bbox="810 1292 1091 1458">Mechanical impacts on drive trains when procuring inertia-like response.</p>	<p data-bbox="1118 831 1415 996">Power system oscillations, finding their source, and providing correction methods.</p> <p data-bbox="1118 1059 1415 1272">Optimised operation of wind-based hybrid systems and battery storage connected to the wind turbine/plant.</p> <p data-bbox="1118 1335 1415 1458">Implementing power oscillation damping in the field.</p> <p data-bbox="1118 1520 1415 1644">Mitigating mechanical impacts to drive train from active power modulation.</p>

706

707 **6.5. Protection and Restoration**


708 Protection and restoration are extremely important needs for the power system. They protect human life and
 709 technologies including generation, transmission, transformers from severe damage and against cascading failures
 710 that may collapse the power system and/or in the event of a collapse allow the power system to be restored.

6.5.1 Protection

Over-current protection is currently a power system need and SMs are a source of large currents that will flow during a fault. These currents are an essential triggering mechanism to activate the protection systems. The limited overload-capabilities of power electronics in contrast to SMs, and hence the lower fault current capability of wind turbines, can undermine the traditional way of triggering the protection system. The challenge with protection also includes the fault current profile of IBRs including wind. It can vary between grid following and grid forming control, and with the evolution of grid code requirement. The provision of negative-sequence current during asymmetrical faults can also challenge the efficacy of relays. If SMs retire and are replaced by IBRs, these needs for fault currents may not be met, and other protection methods may be required.

There are no known wind-based solutions for protection other than the fact that they can have some contribution to the fault current. The fault current limitation of IBRs can be addressed by oversizing the power electronics, so they can produce higher currents during faults. However, this solution is very costly, and will still not reach the same response SMs can provide today (Bialek et al., 2021). DFIG wind turbines can provide much higher levels of fault current (six times rated or higher) compared to full converter wind turbines (El-Naggar and Erlich, 2015). DFIGs could therefore help the situation but would need to be deployed at many locations of the grid. Ways to use the whole installed capacity of wind (and solar PV), that is much larger than SM capacity for providing the same fault current demand could be explored. Wind power plants are most of the time generating less than rated power and could run as STATCOMs when there is no wind available. However, the short circuit current will still have to – individually – be limited to 1.5-2 times the rated current at each connection point. Potentially significant changes are needed in protection methods once the SMs are all gone, pointing towards totally new approaches like using travelling waves (Wilches-Bernal et al., 2021).

Making alternative wind turbine generator technologies available may address some of the shortcomings of existing designs (Figure 2). For example, Type V has been a concept for decades but is not commercially available. It consists of a variable-speed drive system linked to a torque converter, operating in tandem with a SM (Figure 6). This SM can be seamlessly integrated into the grid through a circuit breaker, thereby conferring SM benefits to the grid (Camm et al., 2009). It may provide many benefits including fault current contribution and provision of inertia. These wind turbines are even capable of operating as synchronous condensers during periods of low/no wind and may be a significant part of the future power systems (Henderson, 2021; Henderson and Gevorgian, 2022). However, a significant drawback of this type is pole slipping, which can occur following a fault and result in either loss-of-load or loss-of-generation excitation. Additionally, the pulsating torques during pole slipping have the potential to inflict damage on the generator and gearbox if not addressed appropriately (Gevorgian et al., 2022).

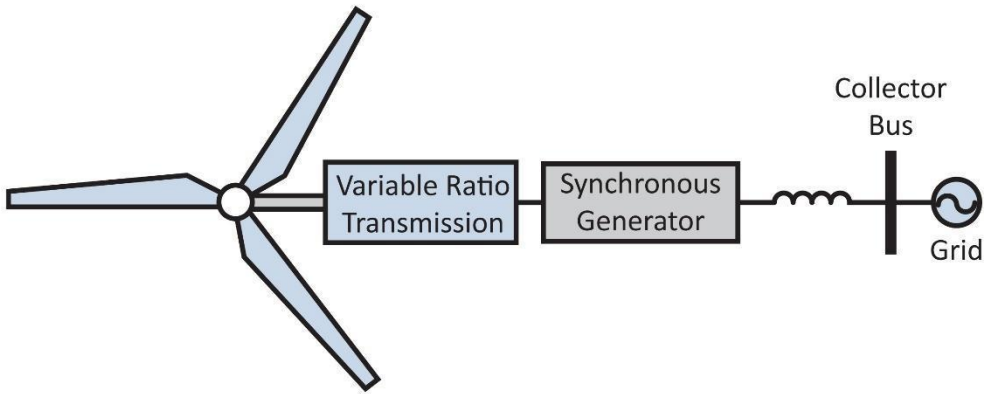

746
747
748
749
750

Figure 6: Type V wind turbine generator technology, not commercially available ((Osman et al., 2018), used with permission).

751

Table 6: Brief summary of wind’s status and opportunity to provide protection.

752
753
754
755

Service	Status	Challenge	Research and development needs
Protection	Can provide but maybe not to the extent that is necessary for existing protection schemes. Some wind technologies are better than others e.g. DFIG.	Restricted inverter overload current capacity. Provision of negative-sequence current during asymmetrical faults.	Different wind technologies’ capabilities to provide more fault current: e.g. type V turbines, hybrids, and larger fleet of wind/solar plants. Alternative protection schemes that do not require overload current inverter capacity. Specifying the fault current behaviour of grid-forming

			wind turbines when reaching the current limit.
--	--	--	--

756 **6.2 Restoration**

757 Restoration of the power system following a blackout is an important need that is rarely activated. To start a power
758 system from a blackout situation requires a primary energy resource and the ability to form the grid (grid forming).
759 Wind with its power electronic interface can provide grid forming capability but can only provide an energy
760 source when the wind is blowing. Although this is a rather new topic for wind power plants, studies and first
761 demonstrations show that wind turbines equipped with power electronic interfaces have self-sustaining islanding
762 capabilities, meaning that – with a minimal energy source – they can start up, energise, and control their voltage
763 and frequency (ScottishPower, 2023). Preliminary field tests show that wind turbines can operate in grid forming
764 mode and energise a substation (Roscoe et al., 2020) illustrating that wind can provide restoration services when
765 wind is available (Pagnani et al., 2020; ScottishPower, 2020). However, as a first stage of the restoration process
766 there are certain control and design modification challenges (Achilles, 2018). It could help the power system if
767 enough wind power plants are equipped with black start capabilities are located across the system, in strategic
768 locations considering network energisation and nearby loads including offshore (Jain et al., 2020). Black start
769 capable wind power allows implementing new bottom-up grid restoration strategies (as opposed to conventional
770 top-down approach by central thermal plants) helping to enhance grid resiliency and restoration times.

771
772 As the restoration services from wind power is nascent, there are multiple aspects that need to be addressed that
773 from a needs and services perspective are like power system needs and services more broadly. Individual wind
774 turbines can operate in grid forming mode, but when multiple wind turbines in a plant are jointly controlling the
775 voltage and frequency, often at quite low operation level (below 15-20% power), synchronisation and unwanted
776 interactions can occur (Lin et al., 2020; Henderson, 2023). Stability analysis methods and proper controller tuning
777 methods need to be developed. The wide timescale and frequency-coupling dynamics of power electronic
778 converters tend to bring in harmonic instability in the form of resonances or abnormal harmonics in a wide
779 frequency range (Wang and Blaabjerg, 2018), and the small signal stability of wind power plants operating in grid
780 forming mode for power system restoration (low power operating point) need to be investigated (Martínez-
781 Turégano et al., 2020). The chances of large transients occurring during restoration process are relatively high, as
782 the system will be in a vulnerable state, hence the performance of wind turbines operating in grid forming and
783 low power operating point needs to be investigated thoroughly (Papadopoulos and Milanović, 2016; Jain et al.,
784 2020). Hybrid with storage, wind and/or solar PV with grid forming are capable of self-black start first, then
785 energise transmission tie-lines, and participate in system restoration schemes (Bialek et al., 2021).

786
787 In times of blackouts, the provision of forecasts from external services may also break down. Power system
788 operators may have to work with older forecasts having worse quality. Research and development on probabilistic
789 forecasting, providing reliable information about the available wind power is essential for restoration concepts
790 (NGESO, 2019).

791

792 Resilience, that is the ability of a power system to transition and potentially survive large scale events that may
793 otherwise cause a blackout and/or ensure the survivability of key assets that will allow restoration, is an evolving
794 area of interest to policy makers and the electricity industry more broadly (Panteli and Mancarella, 2015). It is
795 still in its formation stage as a power system need and is likely to either add to existing needs and/or result in new
796 needs and hence services. For example, improving the resilience of power systems against extreme weather events
797 is one of the key concerns that designers and researchers are exploring, as the frequency of extreme weather events
798 is on a rising trend due to climate change (Mahzarnia, 2020). These events have the potential to cause severe
799 damage to power systems, leading to widespread blackouts that can have significant economic consequences (Bie
800 et al., 2017). The wind energy role in improving power system resilience involves research on turbines that can
801 withstand high-speed winds during hurricanes and in the restoration process (GE, 2018; Simpkins, 2022).

802

803 There are some common themes arising from protection and restoration that are also reflected across other
804 services, and this is discussed briefly in the final section along with some conclusions.

805

806

807 **Table 7: Brief summary of wind’s status and opportunity to provide restoration services.**

808

809

Service	Status	Challenge	Research and development needs
Restoration	Currently not provided. Capability being tested from grid forming turbines	Availability of active power which is affected by weather and leads to variable output of wind power plants. Inverter overload capacity constraints. Small and large signal stability issues of grid-forming wind turbines in restoration scenarios.	Bottom-up grid restoration with the help of wind turbines. Location of wind turbines that will be used to help restoration, needs to have small subsystems with equipment able to initiate restoration. Hybrid power plants. Weather forecast precision and role in the restoration process. Small and large signal stability assessment of wind turbines in restoration scenarios. Weather resilient wind turbines.

810 **76. Discussion and recommendations Conclusions**

811 ~~Table 1 to 4 briefly summarised specifics around the status and opportunities, subject to research, for wind to~~
812 ~~provide services in power systems. They fall into two well defined groups.~~ Wind can and does provide Energy,
813 Capacity, Frequency and Voltage control services and these can be further improved and enhanced by research.
814 ~~Wind does not currently provide Synchronisation, Damping, Protection and Restoration services but~~ **There are**
815 **nascent research efforts to investigate the potential of wind to provide Synchronisation, Damping, Protection and**
816 **Restoration services** ~~these services~~ and there is no fundamental reason why they cannot provide them, however
817 **they may not be competitive nor groundbreaking and more investigation is required.** This research needs to be
818 done in the context of a fundamental change in power systems, driven by the replacement of SMs with wind and
819 other IBRs. This transition is very dynamic and is presenting profound new research challenges to the objective

820 of maintaining supply demand balance reliably at least cost. The simultaneous changes of increasing wind, solar
821 PV, batteries, HVDC etc. and electrification - lead to a high dimensional situation where the challenge is not a
822 unidimensional “wind integration” challenge but a multidimensional energy systems integration challenge.

823 Least cost solutions for resolving these research challenges can come from inside or outside the wind turbine/plant,
824 within the power system and/or from the broader energy system. Here the focus has been on solutions in the form
825 of services that come from within the wind technologies and those that are directly integrated with the wind
826 technologies e.g. power electronics and hybrids. This translates into a multiscale research and design challenge
827 at the individual turbine and plant level with mechanical, electrical and/or control centric solutions to the provision
828 of services (and/or reduction in needs) and a technical/economic comparison with other potential sources of
829 services to meet the power system needs.

830 The role that wind will play in the solution will be a measure of its competitiveness with respect to other solutions.
831 Resources, policy environment and stage of development are different across the world and there is and will be a
832 wide variety of power systems with distinct characteristics and while most power system needs and services will
833 share a lot in common some of them will be system specific. Therefore, we recommend that wind technology in
834 this rapidly changing environment needs to adapt competitively leveraging its advantages and minimising its
835 disadvantages on a regional basis. For example, wind ~~can has the ability to~~ respond more quickly and more
836 accurately than a SM to meet and provide some services and these may be an advantage depending on the power
837 system dynamic characteristics of the host power system.

838 We also recommend that the ~~The goal of the~~ wind industry should now shift towards a more holistic minimisation
839 of the portfolio cost while ensuring higher value of wind power as well as maintaining and/or improving grid
840 reliability. ~~This holistic approach requires signals from the regulators, system and market operators that reward a~~
841 holistic approach and means that wind power needs to ensure coordination across its own technical capabilities
842 and across multiple time scales to maximise its value to the power system and minimise the cost to the wind
843 technology. Maximising the contribution of wind technology to the power system requires a deep understanding
844 of the behaviour of the wind technology with respect to its capabilities to provide services and how they interact
845 and/or are dependent on one another. For example, wind power inherently has little stored energy and as many
846 of the services require energy then the provision of this energy is fundamental and acts to make the services highly
847 dependent on one another. This coordination challenge is dominated by the provision of active power needed
848 during service provision as the active power may also be needed simultaneously for multiple services (e.g.,
849 frequency control, damping, etc.) which makes the coordination of the services from wind highly complex. For
850 example, the interactions of wake steering, curtailment and the provision of services have not been fully
851 investigated in detail. Going beyond the turbine and plant the coordination/aggregation across a region brings
852 challenges that are spatial and temporal. The temporal issue is not only in an operational time frame as the capital
853 and maintenance costs implications of providing services from wind technology are an important dimension of
854 cost minimisation.

855 Since the earliest times in the industry forecasting has been a research challenge. Coordinating services from
856 wind brings a new dimension to the forecasting challenge and as the energy system becomes more integrated the
857 coordination and forecasting across wind, solar, demand, new electrified demands and flexible demands makes
858 this an exciting area. Its contribution is manifold, reducing needs e.g. reduced frequency control, increase in
859 reliability of wind service provision, and in a longer term the reliability of capacity services.

860 Not all the challenges within wind technology are directly coordination related. For frequency control some open
861 issues remain for faster responses, like the ability of measuring, computing and transmitting the frequency signal
862 to the wind turbine/plant controller fast enough. For best impact on capacity value, diversification of turbine types
863 is the key i.e. not just focussing on maximising energy capture but accounting for when the wind resource can be
864 converted into electricity by focussing on low wind speeds. This diversification is also evident in offshore wind
865 and possibly future breakthroughs such as airborne wind and the ability of wind turbines to withstand extreme
866 weather. As the penetration of IBRs increases there may be an inflection point where for example SMs disappear
867 completely from the power system and the need for synchronisation also disappears. However up to that point
868 when SMs are decreasing in number there may be a need to provide the synchronisation service from IBRs a
869 significant research challenge. These “phase change” type transitions are in detail unknown and may form a
870 significant difference between power systems of the future where there may be several main types in contrast to
871 today where the synchronous power system is not the only and dominant type. The opportunities for wind and
872 other technologies during these transitions are significant and potentially extremely challenging.

873 Wind technology interface to power systems and with most new devices is dominated by power electronics (IBRs)
874 and many of the potential evolving needs and services are being driven by the characteristics and nature of this
875 enabling technology. Power electronics differ significantly from SMs principally with respect to its characteristics
876 being determined by the control algorithms deployed within the physical limitations of the hardware in contrast
877 to SMs where the characteristics are driven almost entirely by the basic electromechanical physics of the hardware.
878 There are positives and negatives in this technology transition best summarised as positives emanating from the
879 controllability offered by the algorithms but with some physical limitation of the hardware e.g. over current
880 capability and the lack of direct mechanical coupling that can provide inertial response.

881 While the fundamental principles of IBR controls are a research topic regardless of the host technology, the
882 implementation in wind turbines will need to be adjusted or tailored to their characteristics. IBR based wind power
883 could mimic SMs, but this may not be the best approach as it may negate the controllability advantage. **We**
884 **recommend that the research effort should be focussed on leveraging the unique capabilities of the power**
885 **electronics that interfaces wind to the grid.** There is a growing realisation that there is no one control approach
886 that is most appropriate and that a mix of control approaches will be best and that this will be system specific.
887 This is best characterised by the so-called grid forming or grid following approaches where for example grid
888 forming mode would significantly decrease the reaction time and, to some extent, mitigate for example the
889 challenge with measuring, computing, and transmitting frequency change. But going all into grid forming is not
890 recommended as it brings its own challenges. Understanding the impacts and benefits of the different control
891 approaches is a power system research focus but the wind technology needs to be involved and participate so as

892 the different control approaches can be designed into the basic wind turbine technologies. We recommend
893 therefore that the ~~Not only should the~~ wind industry work with ~~not only with~~ the power systems community but
894 with the power electronics manufacturers to address these research challenges.

895 Many of the integration challenges can be solved without direct or indirect physical participation of wind
896 technology and as stated above this is very system dependent. While wind may not be the central part of a solution
897 it may play a part e.g. in protection while wind may not be capable of providing significant fault current it can
898 provide some and this can be part of a bigger solution. Regardless, wind as an integral part of future power systems
899 needs to provide information on its own performance and characteristics so as system operators can at a system
900 level determine and quantify the needs. The control algorithms embedded in the power electronics that interface
901 to the power systems cause significant challenges to quantify the needs. They are vendor specific and proprietary;
902 they expand the degrees of freedom significantly at a device level and with the relatively small size relative to SM
903 resources they also expand the spatial dimensionality. This is now causing real problems in many of the leading
904 power systems globally and therefore robust wind turbine/plant models that represent the power electronics and
905 its controls are urgently ~~needed~~needed, and we recommend that the wind industry works with all stakeholders to
906 bridge this gap. Allied to this challenge are the development of appropriate tools for wind power plants and power
907 system analysis (methods, component models and data) for both power system ~~planning~~planning, and operations
908 and we recommend that the wind industry provide ~~technology needs to provide~~ the detailed models and data to
909 empower these tools and methods.

910 The needs and services paradigm has been employed here to assess research challenges for wind technology with
911 respect to integration challenges. This paradigm is evolving rapidly with new needs and services being identified
912 regularly within the power system operator community (NGESO, 2024-2024) and in academia (Hatziaargyriou et
913 al., 2020) therefore despite the comprehensive version adopted here (Bialek et al., 2021) there are gaps. For
914 example, harmonic is a very important and emerging topic and wind turbine converters can be tuned to act as an
915 active filter, reducing the harmonic distortion (Kocewiak et al., 2023). Furthermore differences in power systems
916 can result in differences in needs which in turn may result in fragmentation (IEA, 2023).

917 8. Conclusions

918 The increasing share of wind power and other technologies is fundamentally altering the nature of power systems.
919 Wind power's role in future power systems will be driven by its ability to adapt to these changes by competitively
920 providing the required power system services. This will require a holistic research and development approach
921 that is done in coordination with the other technological research communities including solar PV, power
922 electronics and power systems. A needs and services paradigm is one way of ensuring that the research is targeted
923 at characteristics that are valued by the power system either through market signals or mandates. However, as
924 power systems evolve so will the needs and services and in a way that is not yet fully understood. In this dynamic
925 environment wind research challenges and priorities will need to adapt. Other technologies in particular Solar PV
926 may also benefit from the recommendations and conclusions contained here. —This all needs to be done

927 recognising the is all driven by the unchanging nature of the fundamental objective of power systems - maintaining
928 supply demand balance reliably at least cost.

929

930

931 **Author contributions:** Mark O'Malley wrote the initial full draft of the paper - proposed the structure and
932 conclusions, edited it extensively throughout the process and finalised the paper before submission. He did this
933 with the assistance of Fatemeh Rajaei-Najafabadi and Andreas Hadjileonidas. Fatemeh Rajaei-Najafabadi was
934 also the main contributor for the extensive referencing ensuring its accuracy and appropriateness at all stages.

935 Hannele Holttinen and Nicolaos Cutululis in collaboration with Mark O'Malley were the main architects of the
936 structure and content, they also contributed significance to the technical details of many sections and were the
937 main reviewers of the paper with respect to quality control.

938 Til Kristian Vrana, Jennifer King, Vahan Gevorgian and Xiongfei Wang reviewed the paper on several occasions
939 - contributing to fine tuning several sections related to their own area of expertise and in general provided feedback
940 of the paper.

941 **Competing interests:** At least one of the (co-)authors is a member of the editorial board of Wind Energy Science.

942 **Acknowledgements:** This article was written as an international research collaboration under IEA Wind TCP
943 Task 25 "Design and Operation of Energy Systems with Large amounts of Variable Generation". It is part of the
944 IEA Wind TCP Grand challenges set of articles, and the authors would like to acknowledge Paul Veers and
945 Katherine Dykes for guidance. The authors would also like to acknowledge the review comments from Charlie
946 Smith, Damian Flynn, Ana Estanqueiro, Jan Dobschinski, Niina Heliö, Matti Koivisto, Germán Morales, Deepak
947 Ramasubramanian, Tim Green, and Paul Veers.

948 **Financial support:** Mark O'Malley and Fatemeh Rajaei-Najafabadi were supported by the Leverhulme Trust
949 International Professorship.

950

951

952

953 References

954 [Abdul Wahab, N. I. and Mohamed, A.: Area-based COI-referred rotor angle index for transient stability
955 assessment and control of power systems, *Absrt Appl Anal*, <https://doi.org/10.1155/2012/410461>, 2012.](#)

956 Achilles, S.: Black Start and System Restoration with Wind and Solar, 2018.

957 Ackermann, T.: Wind power in power systems, 2, John Wiley & Sons,
958 <https://doi.org/10.1002/9781119941842.ch4>, 2012.

959 Ackermann, T., Prevost, T., Vittal, V., Roscoe, A. J., Matevosyan, J., and Miller, N.: Paving the way: A future
960 without inertia is closer than you think, 10.1109/MPE.2017.2729138, 2017.

961 [Ahmed, S. D., Al-Ismail, F. S., Shafiullah, M., Al-Sulaiman, F. A., and El-Amin, I. M.: Grid integration
962 challenges of wind energy: A review, *IEEE Access*, 8, 10857-10878, \[10.1109/ACCESS.2020.2964896\]\(https://doi.org/10.1109/ACCESS.2020.2964896\),
963 2020.](#)

964 Altin, M., Hansen, A. D., Barlas, T. K., Das, K., and Sakamuri, J. N.: Optimization of short-term overproduction
965 response of variable speed wind turbines, *IEEE Trans. Sustainable Energy*, 9, 1732-1739,
966 10.1109/TSSTE.2018.2810898, 2018.

967 Appleby, S. and Rositano, P.: Addressing the System Strength Gap in SA: Economic Evaluation Report,
968 ElectraNet, 2019.

- 969 Avazov, A., Colas, F., Beerten, J., and Guillaud, X.: Application of input shaping method to vibrations damping
970 in a Type-IV wind turbine interfaced with a grid-forming converter, *Electr. Power Syst. Res.*, 210,
971 108083, <https://doi.org/10.1016/j.epsr.2022.108083>, 2022.
- 972 **Badesa, L., Teng, F., and Strbac, G.: Conditions for regional frequency stability in power system scheduling—**
973 **Part I: Theory, *IEEE T Power Syst.*, 36, 5558 - 5566, 10.1109/TPWRS.2021.3073083, 2021.**
- 974 Bechtle, P., Schelbergen, M., Schmehl, R., Zillmann, U., and Watson, S.: Airborne wind energy resource
975 analysis, *Renewable Energy*, 141, 1103-1116, <https://doi.org/10.1016/j.renene.2019.03.118>, 2019.
- 976 Bevrani, H. and Hiyama, T.: *Intelligent Automatic Generation Control*, CRC press, 2011.
- 977 Bialek, J., Bowen, T., Green, T., Lew, D., Li, Y., MacDowell, J., Matevosyan, J., Miller, N., O'Malley, M., and
978 Ramasubramanian, D.: System needs and services for systems with high IBR penetration, *Global*
979 *Power System Transformation Consortium*, 2021.
- 980 Bie, Z., Lin, Y., Li, G., and Li, F.: Battling the extreme: A study on the power system resilience, *Proc. IEEE*,
981 105, 1253-1266, 10.1109/JPROC.2017.2679040, 2017.
- 982 Bird, L., Milligan, M., and Lew, D.: Integrating variable renewable energy: Challenges and solutions, *National*
983 *Renewable Energy Lab*, <https://doi.org/10.2172/1097911>, 2013.
- 984 Boldea, I.: *Synchronous generators*, CRC press, 2005.
- 985 Bonfiglio, A., Invernizzi, M., Labella, A., and Procopio, R.: Design and implementation of a variable synthetic
986 inertia controller for wind turbine generators, *IEEE Trans. Power Syst.*, 34, 754-764,
987 10.1109/TPWRS.2018.2865958, 2018.
- 988 Breyer, C., Khalili, S., Bogdanov, D., Ram, M., Oyewo, A. S., Aghahosseini, A., Gulagi, A., Solomon, A.,
989 Keiner, D., and Lopez, G.: On the history and future of 100% renewable energy systems research,
990 *IEEE Access*, 10, 78176-78218, 10.1109/ACCESS.2022.3193402, 2022.
- 991 Camm, E., Behnke, M., Bolado, O., Bollen, M., Bradt, M., Brooks, C., Dilling, W., Edds, M., Hejda, W., and
992 Houseman, D.: Characteristics of wind turbine generators for wind power plants, 2009 *IEEE Power &*
993 *Energy Society General Meeting*, Calgary, AB, Canada, 10.1109/PES.2009.5275330, 2009.
- 994 Chaudhuri, B., Ramasubramanian, D., Matevosyan, J., O'Malley, M., Miller, N., Green, T., and Zhou, X.:
995 *Rebalancing Needs and Services for Future Grids*, 2023.
- 996 Chen, L., Du, X., Hu, B., and Blaabjerg, F.: Drivetrain oscillation analysis of grid forming type-IV wind turbine,
997 *IEEE Trans. Energy Convers.*, 37, 2321-2337, 10.1109/TEC.2022.3179609, 2022.
- 998 Chen, Z., Guerrero, J. M., and Blaabjerg, F.: A review of the state of the art of power electronics for wind
999 turbines, *IEEE Trans. Power Electron.*, 24, 1859-1875, 10.1109/TPEL.2009.2017082, 2009.
- 1000 Cheng, Y., Fan, L., Rose, J., Huang, S.-H., Schmall, J., Wang, X., Xie, X., Shair, J., Ramamurthy, J. R., and
1001 Modi, N.: Real-world subsynchronous oscillation events in power grids with high penetrations of
1002 inverter-based resources, *IEEE Trans. Power Syst.*, 38, 316-330, 10.1109/TPWRS.2022.3161418,
1003 2022.
- 1004 Cherubini, A., Papini, A., Vertechy, R., and Fontana, M.: Airborne Wind Energy Systems: A review of the
1005 technologies, *Renewable Sustainable Energy Rev.*, 51, 1461-1476,
1006 <https://doi.org/10.1016/j.rser.2015.07.053>, 2015.
- 1007 Christensen, P. W.: Grid codes: The Manufacturer's Nightmare, *European Wind Energy Association*, Warsaw,
1008 2010.
- 1009 Cochran, J., Miller, M., Zinaman, O., Milligan, M., Arent, D., Palmintier, B., O'Malley, M., Mueller, S.,
1010 Lannoye, E., and Tuohy, A.: Flexibility in 21st century power systems, *National Renewable Energy*
1011 *Lab*, 2014.
- 1012 Cradden, L. C., McDermott, F., Zubiate, L., Sweeney, C., and O'Malley, M.: A 34-year simulation of wind
1013 generation potential for Ireland and the impact of large-scale atmospheric pressure patterns, *Renewable*
1014 *Energy*, 106, 165-176, <https://doi.org/10.1016/j.renene.2016.12.079>, 2017.
- 1015 Cutululis, N. A., Blaabjerg, F., Østergaard, J., Bak, C. L., Anderson, M., da Silva, F. M. F., Johannsson, H.,
1016 Wang, X., and Jørgensen, B. H.: *The Energy Islands: A Mars Mission for the Energy system*, 2021.
- 1017 Dalla Riva, A., Hethy, J., and Vitiņa, A.: IEA Wind TCP Task 26: Impacts of Wind Turbine Technology on the
1018 System Value of Wind in Europe, *International Energy Agency*, <https://doi.org/10.2172/1437346>,
1019 2017.
- 1020 Delille, G., Francois, B., and Malarange, G.: Dynamic frequency control support by energy storage to reduce the
1021 impact of wind and solar generation on isolated power system's inertia, *IEEE Trans. Sustainable*
1022 *Energy*, 3, 931-939, 10.1109/TSST.2012.2205025, 2012.
- 1023 Denholm, P., Mai, T., Kenyon, R. W., Kroposki, B., and O'Malley, M.: Inertia and the power grid: A guide
1024 without the spin, *National Renewable Energy Lab*, <https://doi.org/10.2172/1659820>, 2020.
- 1025 Denholm, P., Arent, D. J., Baldwin, S. F., Bilello, D. E., Brinkman, G. L., Cochran, J. M., Cole, W. J., Frew, B.,
1026 Gevorgian, V., Heeter, J., Hodge, B.-M., Kroposki, B., Mai, T., O'Malley, M., Palmintier, B.,

1027 Steinberg, D., and Zhang, Y.: The challenges of achieving a 100% renewable electricity system in the
1028 United States, *Joule*, 5, 1331-1352, <https://doi.org/10.1016/j.joule.2021.03.028>, 2021.

1029 Denholm, P. L., Sun, Y., and Mai, T. T.: An introduction to grid services: Concepts, technical requirements, and
1030 provision from wind, National Renewable Energy Lab, <https://doi.org/10.2172/1493402>, 2019.

1031 Denis, G., Prevost, T., Debry, M. S., Xavier, F., Guillaud, X., and Menze, A.: The Migrate project: the
1032 challenges of operating a transmission grid with only inverter-based generation. A grid-forming control
1033 improvement with transient current-limiting control, *IET Renew Power Gen*, 12, 523-529,
1034 <https://doi.org/10.1049/iet-rpg.2017.0369>, 2018.

1035 Denny, E. and O'Malley, M.: Quantifying the total net benefits of grid integrated wind, *IEEE Trans. Power*
1036 *Syst.*, 22, 605-615, 10.1109/TPWRS.2007.894864, 2007.

1037 Diógenes, J. R. F., Claro, J., Rodrigues, J. C., and Loureiro, M. V.: Barriers to onshore wind energy
1038 implementation: A systematic review, *Energy Research & Social Science*, 60, 101337,
1039 <https://doi.org/10.1016/j.erss.2019.101337>, 2020.

1040 Doherty, R., Lalor, G., and O'Malley, M.: Frequency control in competitive electricity market dispatch, *IEEE*
1041 *Trans. Power Syst.*, 20, 1588-1596, 10.1109/TPWRS.2005.852146, 2005.

1042 Domínguez-García, J. L., Gomis-Bellmunt, O., Bianchi, F. D., and Sumper, A.: Power oscillation damping
1043 supported by wind power: A review, *Renewable Sustainable Energy Rev.*, 16, 4994-5006,
1044 <https://doi.org/10.1016/j.rser.2012.03.063>, 2012.

1045 Dykes, K., Kitzing, L., Andersson, M., Pons-Seres de Brauwer, C., and Canét, H.: Beyond LCOE: New
1046 assessment criteria for evaluating Wind Energy R&I, 2020.

1047 Dykes, K. L., Veers, P. S., Lantz, E. J., Holttinen, H., Carlson, O., Tuohy, A., Sempreviva, A. M., Clifton, A.,
1048 Rodrigo, J. S., and Berry, D. S.: IEA wind TCP: Results of IEA wind TCP workshop on a grand vision
1049 for wind energy technology, National Renewable Energy Lab, <https://doi.org/10.2172/1508509>, 2019.

1050 Grand Challenges: wind energy research needs for a global energy transition: [https://www.wind-energy-](https://www.wind-energy-science.net/articles_and_preprints/grand-challenges.html)
1051 [science.net/articles_and_preprints/grand-challenges.html](https://www.wind-energy-science.net/articles_and_preprints/grand-challenges.html), 2023.

1052 EIA: Levelized Costs of New Generation Resources in the Annual Energy Outlook 2022, EIA, 2022.

1053 EirGrid: All island grid study overview, EirGrid Group, 2008.

1054 EirGrid: EirGrid Grid Code, EirGrid, 2019.

1055 DS3 Programme: <https://www.eirgridgroup.com/how-the-grid-works/ds3-programme/>, 2023.

1056 El-Naggar, A. and Erlich, I.: Fault current contribution analysis of doubly fed induction generator-based wind
1057 turbines, *IEEE Trans. Energy Convers.*, 30, 874-882, 10.1109/TEC.2015.2398671, 2015.

1058 Ela, E., Hytowitz, R., and Helman, U.: Ancillary services in the united states: Technical requirements, market
1059 designs, and price trends, 2019.

1060 Ela, E., Gevorgian, V., Tuohy, A., Kirby, B., Milligan, M., and O'Malley, M.: Market designs for the primary
1061 frequency response ancillary service—Part I: Motivation and design, *IEEE Trans. Power Syst.*, 29,
1062 421-431, 10.1109/TPWRS.2013.2264942, 2013.

1063 Ela, E., Wang, C., Moorthy, S., Ragsdale, K., O'Sullivan, J., Rothleder, M., and Hobbs, B.: Electricity markets
1064 and renewables: A survey of potential design changes and their consequences,
1065 10.1109/MPE.2017.2730827, 2017.

1066 Ela, E., Mills, A., Gimon, E., Hogan, M., Bouchez, N., Giacomoni, A., Ng, H., Gonzalez, J., and DeSocio, M.:
1067 Electricity market of the future: potential North American designs without fuel costs,
1068 10.1109/MPE.2020.3033396, 2021.

1069 Ela, E., Gevorgian, V., Fleming, P., Zhang, Y., Singh, M., Muljadi, E., Scholbrook, A., Aho, J., Buckspan, A.,
1070 Pao, L., Shigvi, V., Tuohy, A., Pourbeik, P., Brooks, D., and Bhatt, N.: Active power controls from
1071 wind power: Bridging the gaps, NREL, <https://doi.org/10.2172/1117060>, 2014.

1072 EPRI: Resource Adequacy Philosophy: A Guide to Resource Adequacy Concepts and Approaches, 2022a.

1073 EPRI: Resource Adequacy for a Decarbonized Future A Summary of Existing and Proposed Resource
1074 Adequacy Metrics, 2022b.

1075 ESIG: Toward 100% Renewable Energy Pathway: Key Research Needs, ESIG, 2019.

1076 Eto, J. H., Undrill, J., Mackin, P., Daschmans, R., Williams, B., Haney, B., Hunt, R., Ellis, J., Illian, H.,
1077 Martinez, C., O'Malley, M., Coughlin, K., and LaCommare, K. H.: Use of frequency response metrics
1078 to assess the planning and operating requirements for reliable integration of variable renewable
1079 generation, Lawrence Berkeley National Lab, <https://doi.org/10.2172/1003830>, 2010.

1080 GE: Riders On The Storm: GE Is Building A Wind Turbine That Can Weather Violent Typhoons, Hurricanes:
1081 [https://www.ge.com/news/reports/riders-storm-ge-building-wind-turbine-can-weather-violent-](https://www.ge.com/news/reports/riders-storm-ge-building-wind-turbine-can-weather-violent-typhoons-hurricanes#:~:text=GE%20will%20start%20assembling%20a,exceptional%20event%2C%E2%80%9D%20says%20Hidalgo.,)
1082 [typhoons-](https://www.ge.com/news/reports/riders-storm-ge-building-wind-turbine-can-weather-violent-typhoons-hurricanes#:~:text=GE%20will%20start%20assembling%20a,exceptional%20event%2C%E2%80%9D%20says%20Hidalgo.,)
1083 [hurricanes#:~:text=GE%20will%20start%20assembling%20a,exceptional%20event%2C%E2%80%9D](https://www.ge.com/news/reports/riders-storm-ge-building-wind-turbine-can-weather-violent-typhoons-hurricanes#:~:text=GE%20will%20start%20assembling%20a,exceptional%20event%2C%E2%80%9D%20says%20Hidalgo.,)
1084 [%20says%20Hidalgo.,](https://www.ge.com/news/reports/riders-storm-ge-building-wind-turbine-can-weather-violent-typhoons-hurricanes#:~:text=GE%20will%20start%20assembling%20a,exceptional%20event%2C%E2%80%9D%20says%20Hidalgo.,) 2018.

1085 **Gevorgian, V., Shah, S., Yan, W., and Henderson, G.: Grid-forming wind: getting ready for prime time, with or**
1086 **without inverters. IEEE Electrification Magazine, 10, 52-64, 10.1109/MELE.2021.3139246, 2022.**

1087 Ghasemi, H., Gharehpetian, G., Nabavi-Niaki, S. A., and Aghaei, J.: Overview of subsynchronous resonance
1088 analysis and control in wind turbines, *Renewable Sustainable Energy Rev.*, 27, 234-243,
1089 <https://doi.org/10.1016/j.rser.2013.06.025>, 2013.

1090 Ghosh, S., Isbeih, Y. J., Bhattarai, R., El Moursi, M. S., El-Saadany, E. F., and Kamalasadani, S.: A dynamic
1091 coordination control architecture for reactive power capability enhancement of the DFIG-based wind
1092 power generation, *IEEE Trans. Power Syst.*, 35, 3051-3064, 10.1109/TPWRS.2020.2968483, 2020.

1093 Girsang, I. P., Dhupia, J. S., Singh, M., Gevorgian, V., Muljadi, E., and Jonkman, J.: Impacts of providing
1094 inertial response on dynamic loads of wind turbine drivetrains, 2014 IEEE Energy Conversion
1095 Congress and Exposition (ECCE), 10.1109/ECCE.2014.6953597, 2014.

1096 Glasdam, J. B., Zeni, L., Gryning, M., Hjerrild, J., Kocewiak, Ł., Hesselbaek, B., Andersen, K., Sørensen, T.,
1097 Blanke, M., and Sørensen, P. E.: HVDC connected offshore wind power plants: review and outlook of
1098 current research, 12th Wind Integration Workshop, 2013.

1099 Gloe, A., Jauch, C., Craciun, B., Zanter, A., and Winkelmann, J.: Influence of continuous provision of synthetic
1100 inertia on the mechanical loads of a wind turbine, *Energies*, 14, 5185,
1101 <https://doi.org/10.3390/en14165185>, 2021.

1102 Glover, J. D., Sarma, M. S., and Overbye, T.: *Power system analysis & design*, SI version, Cengage
1103 Learning 2012.

1104 Göçmen, T., Giebel, G., Poulsen, N. K., and Sørensen, P. E.: Possible power of down-regulated offshore wind
1105 power plants: The PossPOW algorithm, *Wind Energy*, 22, 205-218, <https://doi.org/10.1002/we.2279>,
1106 2018.

1107 Gonzalez-Longatt, F. M., Acosta, M. N., Chamorro, H. R., and Rueda Torres, J. L.: Power converters dominated
1108 power systems, in: *Modelling and Simulation of Power Electronic Converter Dominated Power*
1109 *Systems in PowerFactory*, 1-35, 2021.

1110 Gu, M., Meegahapola, L., and Wong, K. L.: Coordinated voltage and frequency control in hybrid AC/MT-
1111 HVDC power grids for stability improvement, *IEEE Trans. Power Syst.*, 36, 635-647,
1112 10.1109/TPWRS.2020.2983431, 2020.

1113 Haegel, N. M., Atwater Jr, H., Barnes, T., Breyer, C., Burrell, A., Chiang, Y.-M., De Wolf, S., Dimmler, B.,
1114 Feldman, D., and Glunz, S.: Terawatt-scale photovoltaics: Transform global energy, *Science*, 364, 836-
1115 838, 10.1126/science.aaw1845, 2019.

1116 Hansen, A. D., Altin, M., Margaritis, I. D., Iov, F., and Tarnowski, G. C.: Analysis of the short-term
1117 overproduction capability of variable speed wind turbines, *Renewable Energy*, 68, 326-336,
1118 <https://doi.org/10.1016/j.renene.2014.02.012>, 2014.

1119 Hasche, B., Keane, A., and O'Malley, M.: Capacity value of wind power, calculation, and data requirements: the
1120 Irish power system case, *IEEE Trans. Power Syst.*, 26, 420-430, 10.1109/TPWRS.2010.2051341, 2010.

1121 Hedman, K. W., Oren, S. S., and O'Neill, R. P.: A review of transmission switching and network topology
1122 optimization, *IEEE power and energy society general meeting*, 1-7, 2011.

1123 Henderson, C.: Interactions of grid-forming converters for windfarm applications, Department of Electronic and
1124 Electrical Engineering, University of Strathclyde, 10.48730/0qk4-kk24, 2023.

1125 Henderson, G.: The latest development in synchronous wind turbine technology: how the LVS system can
1126 deliver low cost, broad-band variable turbine speed and type 5 grid connection, 10.1049/icp.2021.2636,
1127 2021.

1128 Henderson, G. and Gevorgian, V.: Type 5 wind turbine technology: how synchronised, synchronous generation
1129 avoids uncertainties about inverter interoperability under IEEE 2800: 2022, 21st Wind & Solar
1130 Integration Workshop 10.1049/icp.2022.2764, 2022.

1131 Hobbs, B. F., Wang, Y., Xu, Q., Zhang, S., Hamann, H. F., Zhang, R., Siebensschuh, C., Zhang, J., Li, B., and
1132 He, L.: Coordinated ramping product and regulation reserve procurements in caiso and miso using
1133 multi-scale probabilistic solar power forecasts (pro2r), Johns Hopkins Univ., Baltimore, MD
1134 <https://doi.org/10.2172/1873393>, 2022.

1135 Hodge, B. M. S., Jain, H., Brancucci, C., Seo, G. S., Korpås, M., Kiviluoma, J., Holttinen, H., Smith, J. C.,
1136 Orths, A., and Estanqueiro, A.: Addressing technical challenges in 100% variable inverter-based
1137 renewable energy power systems, *Wiley Interdisciplinary Reviews: Energy and Environment*, 9, e376,
1138 2020.

1139 Hogan, W. W.: *On an "energy only" electricity market design for resource adequacy*, 2005.

1140 Holttinen, H.: *IEA Wind Annual Report 2022*, 2023.

1141 Holttinen, H., Kiviluoma, J., Heliö, N., Levy, T., Menemenlis, N., Jun, L., Cutulus, N. A., Koivisto, M., Das,
1142 K., and Orths, A.: Design and operation of energy systems with large amounts of variable generation:

1143 Final summary report, IEA Wind TCP Task 25, VTT Technical Research Centre of
1144 Finland951388757X, <https://doi.org/10.32040/2242-122X.2021.T396>, 2021.

1145 Holttinen, H., Kiviluoma, J., Levy, T., Jun, L., Eriksen, P. B., Orths, A., Cutululis, N., Silva, V., Neau, E., and
1146 Dobschinski, J.: Design and operation of power systems with large amounts of wind power: Final
1147 summary report, IEA WIND Task 25, Phase four 2015-20179513886832, 10.32040/2242-
1148 122X.2019.T350, 2019.

1149 Holttinen, H., Kiviluoma, J., Flynn, D., Smith, J. C., Orths, A., Eriksen, P. B., Cutululis, N., Söder, L., Korpås,
1150 M., Estanqueiro, A., MacDowell, J., Tuohy, A., Vrana, T. K., and O'Malley, M.: System impact studies
1151 for near 100% renewable energy systems dominated by inverter based variable generation, IEEE Trans.
1152 Power Syst., 37, 3249-3258, 10.1109/TPWRS.2020.3034924, 2020.

1153 [Hatzigiargyriou, N., Milanovic, J., Rahmann, C., Ajarapu, V., Canizares, C., Erlich, I., Hill, D., Hiskens, I., Kamwa,
1154 I., and Pal, B.: Definition and classification of power system stability–revisited & extended, IEEE
1155 Transactions on Power Systems, 36, 3271-3281, 10.1109/TPWRS.2020.3041774, 2020.](#)

1156 Houck, D. R.: Review of wake management techniques for wind turbines, Wind Energy, 25, 195-220,
1157 www.doi.org/10.1002/we.2668, 2022.

1158 IEA: World Energy Outlook 2022, IEA, 2022.

1159 [IEA: Electricity Grids and Secure Energy Transitions, International Energy Agency, 2023.](#)

1160 IEA Wind TCP Task 50: <https://iea-wind.org/task50/>, 2023.

1161 Government of Ireland: Climate action plan 2021- Securing our future, Government of Ireland, 2021.

1162 IRENA: Grid Codes for Renewable Powered Systems, Abu Dhabi, 2022.

1163 Jain, A., Saborío-Romano, O., Sakamuri, J. N., and Cutululis, N. A.: Blackstart from HVDC-connected offshore
1164 wind: Hard versus soft energization, IET Renewable Power Gener., 15, 127-138,
1165 <https://doi.org/10.1049/rpg2.12010>, 2020.

1166 Jorgenson, J., Denholm, P., and Mai, T.: Analyzing storage for wind integration in a transmission-constrained
1167 power system, Appl. Energy, 228, 122-129, <https://doi.org/10.1016/j.apenergy.2018.06.046>, 2018.

1168 Keane, A., Milligan, M., Dent, C. J., Hasche, B., D'Annunzio, C., Dragoon, K., Holttinen, H., Samaan, N.,
1169 Soder, L., and O'Malley, M.: Capacity value of wind power, IEEE Trans. Power Syst., 26, 564-572,
1170 10.1109/TPWRS.2010.2062543, 2011.

1171 Kemp, J. M., Millstein, D., Kim, J. H., and Wiser, R.: Interactions between hybrid power plant development and
1172 local transmission in congested regions, Adv. Appl. Energy, 10, 100133,
1173 <https://doi.org/10.1016/j.adapen.2023.100133>, 2023.

1174 Kirschen, D. S. and Strbac, G.: Fundamentals of power system economics, John Wiley & Sons 2018.

1175 [Kirkegaard, J. K., Rudolph, D. P., Nyborg, S., Solman, H., Gill, E., Cronin, T., and Hallisey, M.: Tackling grand
1176 challenges in wind energy through a socio-technical perspective, Nature Energy, 8, 655-664,
1177 <https://doi.org/10.1038/s41560-023-01266-z>, 2023.](#)

1178 [Kocewiak, L., Guest, E., Dowlatabadi, M. K. B., Chen, S., Árnadóttir, U. D., Jensen, S. J., Kramer, B. Ø.,
1179 Nagaiceva, V., Siepker, T., and Terriche, Y.: Active filtering trial to reduce harmonic voltage distortion
1180 in an offshore wind power plant, 22nd Wind and Solar Integration Workshop, 394-399,
1181 \[10.1049/icp.2023.2764\]\(https://doi.org/10.1049/icp.2023.2764\), 2023.](#)

1182 Kolar, J. W., Friedli, T., Krismer, F., Looser, A., Schweizer, M., Friedemann, R. A., Steimer, P. K., and Bevirt,
1183 J. B.: Conceptualization and multiobjective optimization of the electric system of an airborne wind
1184 turbine, IEEE J. Emerging Sel. Top. Power Electron., 1, 73-103, 10.1109/JESTPE.2013.2269672,
1185 2013.

1186 Kroposki, B., Johnson, B., Zhang, Y., Gevorgian, V., Denholm, P., Hodge, B.-M., and Hannegan, B.: Achieving
1187 a 100% renewable grid: Operating electric power systems with extremely high levels of variable
1188 renewable energy, 10.1109/MPE.2016.2637122, 2017.

1189 Lannoye, E., Flynn, D., and O'Malley, M.: Evaluation of power system flexibility, IEEE Trans. Power Syst., 27,
1190 922-931, 10.1109/TPWRS.2011.2177280, 2012.

1191 Lauby, M. G., Ahlstrom, M., Brooks, D. L., Beuning, S., Caspary, J., Grant, W., Kirby, B., Milligan, M.,
1192 O'Malley, M., Patel, M., Piwko, R., Pourbeik, P., Shirmohammadi, D., and Smith, C. J.: Balancing Act,
1193 10.1109/MPE.2011.942352, 2011.

1194 Lazard: Lazard's Levelized Cost of Energy Analysis, 2023.

1195 Leutbecher, M. and Palmer, T. N.: Ensemble forecasting, J. Comput. Phys., 227, 3515-3539,
1196 <https://doi.org/10.1016/j.jcp.2007.02.014>, 2008.

1197 Lin, Y., Eto, J. H., Johnson, B. B., Flicker, J. D., Lasseter, R. H., Villegas Pico, H. N., Seo, G.-S., Pierre, B. J.,
1198 and Ellis, A.: Research roadmap on grid-forming inverters, National Renewable Energy Lab.(NREL),
1199 Golden, CO (United States), <https://doi.org/10.2172/1721727>, 2020.

1200 Lin, Y., Eto, J. H., Johnson, B. B., Flicker, J. D., Lasseter, R. H., Pico, H. N. V., Seo, G.-S., Pierre, B. J., Ellis,
1201 A., Miller, J., and Yuan, G.: Pathways to the next-generation power system with inverter-based
1202 resources: Challenges and recommendations, 10.1109/MELE.2021.3139132, 2022.

1203 Lin, Z. and Liu, X.: Wind power forecasting of an offshore wind turbine based on high-frequency SCADA data
1204 and deep learning neural network, *Energy*, 201, 117693, <https://doi.org/10.1016/j.energy.2020.117693>,
1205 2020.

1206 Liu, J., Yao, Q., and Hu, Y.: Model predictive control for load frequency of hybrid power system with wind
1207 power and thermal power, *Energy*, 172, 555-565, <https://doi.org/10.1016/j.energy.2019.01.071>, 2019.

1208 Liu, T. and Wang, X.: Transient stability of single-loop voltage-magnitude controlled grid-forming converters,
1209 *IEEE Trans. Power Electron.*, 36, 6158-6162, 10.1109/TPEL.2020.3034288, 2021.

1210 Loth, E., Qin, C., Simpson, J. G., and Dykes, K.: Why we must move beyond LCOE for renewable energy
1211 design, *Adv. Appl. Energy*, 8, 100112, <https://doi.org/10.1016/j.adapen.2022.100112>, 2022.

1212 Lu, L., Saborío-Romano, O., and Cutululis, N. A.: Torsional oscillation damping in wind turbines with virtual
1213 synchronous machine-based frequency response, *Wind Energy*, 25, 1157-1172,
1214 <https://doi.org/10.1002/we.2719>, 2022.

1215 Mahzarnia, M., Mohsen Parsa Moghaddam, Payam Teimourzadeh Baboli, and Pierluigi Siano: A Review of the
1216 Measures to Enhance Power Systems Resilience, *IEEE Syst. J.*, 10.1109/JSYST.2020.2965993, 2020.

1217 Mallapragada, D. S., Sepulveda, N. A., and Jenkins, J. D.: Long-run system value of battery energy storage in
1218 future grids with increasing wind and solar generation, *Appl. Energy*, 275, 115390,
1219 <https://doi.org/10.1016/j.apenergy.2020.115390>, 2020.

1220 Martínez-Turégano, J., Añó-Villalba, S., Bernal-Perez, S., Peña, R., and Blasco-Gimenez, R.: Small-signal
1221 stability and fault performance of mixed grid forming and grid following offshore wind power plants
1222 connected to a HVDC-diode rectifier, *IET Renewable Power Gener.*, 14, 2166-2175,
1223 <https://doi.org/10.1049/iet-rpg.2019.1264>, 2020.

1224 Matevosyan, J., Badrzadeh, B., Prevost, T., Quitmann, E., Ramasubramanian, D., Urdal, H., Achilles, S.,
1225 MacDowell, J., Huang, S. H., Vital, V., O'Sullivan, J., and Quint, R.: Grid-forming inverters: Are they
1226 the key for high renewable penetration?, 10.1109/MPE.2019.2933072, 2019.

1227 Matevosyan, J., MacDowell, J., Miller, N., Badrzadeh, B., Ramasubramanian, D., Isaacs, A., Quint, R.,
1228 Quitmann, E., Pfeiffer, R., Urdal, H., Prevost, T., Vittal, V., Woodford, D., Huang, S. H., and
1229 O'Sullivan, J.: A future with inverter-based resources: Finding strength from traditional weakness,
1230 10.1109/MPE.2021.3104075, 2021.

1231 Meyers, J., Bottasso, C., Dykes, K., Fleming, P., Gebraad, P., Giebel, G., Göçmen, T., and Van Wingerden, J.-
1232 W.: Wind farm flow control: prospects and challenges, *Wind Energy Sci.*, 7, 2271-2306,
1233 <https://doi.org/10.5194/wes-7-2271-2022>, 2022.

1234 Miller, N., Green, T., Li, Y., Ramasubramanian, D., Bialek, J., O'Malley, M., Smith, C., Lew, D., Matevosyan,
1235 J., Taul, M. G., and Philbrick, R.: Stability Tools Inventory: Status and Needs, 2021.

1236 Moawwad, A., El Moursi, M. S., and Xiao, W.: A novel transient control strategy for VSC-HVDC connecting
1237 offshore wind power plant, *IEEE Trans. Sustainable Energy*, 5, 1056-1069,
1238 10.1109/TSSTE.2014.2325951, 2014.

1239 Mohseni, M. and Islam, S. M.: Review of international grid codes for wind power integration: Diversity,
1240 technology and a case for global standard, *Renewable Sustainable Energy Rev.*, 16, 3876-3890,
1241 <https://doi.org/10.1016/j.rser.2012.03.039>, 2012.

1242 Morales-España, G., Nycander, E., and Sijm, J.: Reducing CO2 emissions by curtailing renewables: Examples
1243 from optimal power system operation, *Energy Econ*, 99, 105277,
1244 <https://doi.org/10.1016/j.eneco.2021.105277>, 2021.

1245 Muljadi, E., Gevorgian, V., Singh, M., and Santoso, S.: Understanding inertial and frequency response of wind
1246 power plants, *IEEE Symposium on Power Electronics and Machines in Wind Applications*, Denver,
1247 Colorado, 10.1109/PEMWA.2012.6316361, 2012.

1248 Mullane, A. and O'Malley, M.: The inertial response of induction-machine-based wind turbines, *IEEE Trans.*
1249 *Power Syst.*, 20, 1496-1503, 10.1109/TPWRS.2005.852081, 2005.

1250 Mullane, A. and O'Malley, M.: Modifying the inertial response of power-converter based wind turbine
1251 generators, 10.1049/cp:20060084, 2006.

1252 Müller, S., Holttinen, H., Taibi, E., Smith, J., Fraile, D., and Vrana, T. K.: System integration costs—A useful
1253 concept that is complicated to quantify, *Proc. 17th Int. Workshop Large-Scale Integr. Wind Power*
1254 *Power Syst. Well Transmiss. Netw. Offshore Wind Power Plants*,

1255 Murphy, C. A., Schleifer, A., and Eurek, K.: A taxonomy of systems that combine utility-scale renewable
1256 energy and energy storage technologies, *Renewable Sustainable Energy Rev.*, 139, 110711,
1257 <https://doi.org/10.1016/j.rser.2021.110711>, 2021.

1258 National Academies of Sciences, E. and Medicine: The Future of Electric Power in the United States, National
1259 Academies Press, Washington, DC, 330 pp., doi:10.17226/25968, 2021.

1260 Nema, P., Nema, R., and Rangnekar, S.: A current and future state of art development of hybrid energy system
1261 using wind and PV-solar: A review, Renewable Sustainable Energy Rev., 13, 2096-2103,
1262 https://doi.org/10.1016/j.rser.2008.10.006, 2009.

1263 Neuhoff, K., Richstein, J. C., and Kröger, M.: Reacting to changing paradigms: How and why to reform
1264 electricity markets, Energy Policy, 180, 113691, https://doi.org/10.1016/j.enpol.2023.113691, 2023.

1265 NGENSO: Black Start from Non-Traditional Generation Technologies, 2019.

1266 NGENSO: Electricity System Operator Markets Roadmap, National Grid Electricity System Operator, 2023.

1267 NGENSO: Electricity System Operator Markets Roadmap, National Grid Electricity System Operator, 2024.

1268 **NGESO: Electricity System Operator Markets Roadmap, National Grid Electricity System Operator, 2024.**

1269 Nguyen, T.-T., Vu, T., Paudyal, S., Blaabjerg, F., and Vu, T. L.: Grid-Forming Inverter-based Wind Turbine
1270 Generators: Comprehensive Review, Comparative Analysis, and Recommendations,
1271 https://doi.org/10.48550/arXiv.2203.02105,

1272 Novacheck, J., Sharp, J., Schwarz, M., Donohoo-Vallett, P., Tzavelis, Z., Buster, G., and Rossol, M.: The
1273 evolving role of extreme weather events in the US power system with high levels of variable renewable
1274 energy, National Renewable Energy Lab.(NREL), Golden, CO (United States),
1275 https://doi.org/10.2172/1837959, 2021.

1276 O'Malley, M.: Grid integration [in my view], 10.1109/MPE.2011.942477, 2011.

1277 O'Malley, M.: Towards 100% renewable energy system, IEEE Trans. Power Syst., 37, 3187-3189,
1278 10.1109/TPWRS.2022.3178170, 2022.

1279 O'Malley, M., Kroposki, B., Hannegan, B., Madsen, H., Andersson, M., D'haeseleer, W., McGranaghan, M. F.,
1280 Dent, C., Strbac, G., Baskaran, S., and Rinker, M.: Energy Systems Integration. Defining and
1281 Describing the Value Proposition, United States, Medium: ED; Size: 12 p., 10.2172/1257674, 2016.

1282 Osman, M., Segal, N., Najafzadeh, A., and Harris, J.: Short-circuit modeling and system strength, North
1283 American Electric Reliability Corporation, 2018.

1284 Pagnani, D., Blaabjerg, F., Bak, C. L., Faria da Silva, F. M., Kocewiak, Ł. H., and Hjerrild, J.: Offshore wind
1285 farm black start service integration: Review and outlook of ongoing research, Energies, 13, 6286,
1286 https://doi.org/10.3390/en13236286, 2020.

1287 Pan, D., Wang, X., Liu, F., and Shi, R.: Transient stability of voltage-source converters with grid-forming
1288 control: A design-oriented study, IEEE J. Emerging Sel. Top. Power Electron., 8, 1019-1033,
1289 10.1109/JESTPE.2019.2946310, 2020.

1290 Panteli, M. and Mancarella, P.: The grid: Stronger, bigger, smarter?: Presenting a conceptual framework of
1291 power system resilience, 10.1109/MPE.2015.2397334, 2015.

1292 Papadopoulos, P. N. and Milanović, J. V.: Probabilistic framework for transient stability assessment of power
1293 systems with high penetration of renewable generation, IEEE Trans. Power Syst., 32, 3078-3088,
1294 10.1109/TPWRS.2016.2630799, 2016.

1295 Pineda, I. and Vannoorenberghe, C.: Strategic Research & Innovation Agenda 2025-2027, European
1296 Technology and Innovation Platform on Wind energy, 2023.

1297 Qiao, W., Harley, R. G., and Venayagamoorthy, G. K.: Coordinated reactive power control of a large wind farm
1298 and a STATCOM using heuristic dynamic programming, IEEE Trans. Energy Convers., 24, 493-503,
1299 10.1109/TEC.2008.2001456, 2009.

1300 Rafique, Z., Khalid, H. M., Muyeen, S., and Kamwa, I.: Bibliographic review on power system oscillations
1301 damping: An era of conventional grids and renewable energy integration, Int. J. Electr. Power Energy
1302 Syst., 136, 107556, https://doi.org/10.1016/j.ijepes.2021.107556, 2022.

1303 Rebours, Y. G., Kirschen, D. S., Trotignon, M., and Rossignol, S.: A survey of frequency and voltage control
1304 ancillary services—Part II: Economic features, IEEE Trans. Power Syst., 22, 358-366,
1305 10.1109/TPWRS.2006.888965, 2007a.

1306 Rebours, Y. G., Kirschen, D. S., Trotignon, M., and Rossignol, S.: A survey of frequency and voltage control
1307 ancillary services—Part I: Technical features, IEEE Trans. Power Syst., 22, 350-357,
1308 10.1109/TPWRS.2006.888963, 2007b.

1309 REN21: Renewables 2023 Global Status Report, 2023.

1310 Roscoe, A., Knueppel, T., Da Silva, R., Brogan, P., Gutierrez, I., Elliott, D., and Perez Campion, J. C.:
1311 Response of a grid forming wind farm to system events, and the impact of external and internal
1312 damping, IET Renewable Power Gener., 14, 3908-3917, https://doi.org/10.1049/iet-rpg.2020.0638,
1313 2021.

- 1314 Roscoe, A., Brogan, P., Elliott, D., Knueppel, T., Gutierrez, I., Crolla, P., Silva, R., Champion, J.-C. P., and Da
1315 Silva, R.: Practical experience of providing enhanced grid forming services from an onshore wind park,
1316 Proc. 19th Wind Integr. Workshop2020.
- 1317 Sakamuri, J. N., Altin, M., Hansen, A. D., and Cutululis, N. A.: Coordinated frequency control from offshore
1318 wind power plants connected to multi terminal DC system considering wind speed variation, IET
1319 Renew Power Gen, 11, 1226-1236, <https://doi.org/10.1049/iet-rpg.2016.0433>, 2017.
- 1320 Schuitema, G., Steg, L., and O'Malley, M.: Consumer behavior: why engineers need to read about it [guest
1321 editorial], 10.1109/MPE.2017.2762378, 2018.
- 1322 Schweppe, F. C., Caramanis, M. C., Tabors, R. D., and Bohn, R. E.: Spot pricing of electricity, Springer Science
1323 & Business Media2013.
- 1324 Global First For ScottishPower As COP Countdown Starts:
1325 https://www.scottishpowerrenewables.com/news/pages/global_first_for_scottishpower_as_cop_countdown_starts.aspx#:~:text=Now%20Dersalloch%20has%20achieved%20a,underpin%20a%20sustainable%20security%20of,2023
1326
1327
- 1328 Black-Start Capability - A Global first for ScottishPower Renewables:
1329 <https://www.scottishpowerrenewables.com/pages/innovation.aspx,2023>.
- 1330 Wind Energy: <https://www.seai.ie/technologies/wind-energy/#:~:text=Government%20Supports&text=To%20achieve%20this%20target%20set,to%20the%20grid%20by%202030,2023>.
1331
1332
- 1333 [WindEurope: Wind Turbine Orders Monitoring Q3 2023, 2023](#).
- 1334 Shah, S. and Gevorgian, V.: Control, operation, and stability characteristics of grid-forming type III wind
1335 turbines, 9th Wind Integration Workshop, 2020.
- 1336 Inspired by palm trees, scientists develop hurricane-resilient wind turbines:
1337 <https://www.colorado.edu/today/2022/06/15/inspired-palm-trees-scientists-develop-hurricane-resilient-wind-turbines,2023>.
1338
- 1339 Singh, M. and Santoso, S.: Dynamic models for wind turbines and wind power plants, NREL, 2011.
- 1340 Singlitico, A., Campion, N. J. B., Münster, M., Koivisto, M. J., Cutululis, N. A., Suo, C. J., Karlsson, K.,
1341 Jørgensen, T., Waagstein, J. E., and Bendtsen, M. F.: Optimal placement of P2X facility in conjunction
1342 with Bornholm energy island: Preliminary overview for an immediate decarbonisation of maritime
1343 transport, Technical University of Denmark, 2020.
- 1344 Smith, J. C., Milligan, M. R., DeMeo, E. A., and Parsons, B.: Utility wind integration and operating impact state
1345 of the art, IEEE Trans. Power Syst., 22, 900-908, 10.1109/TPWRS.2007.901598, 2007.
- 1346 Söder, L., Tómasson, E., Estanqueiro, A., Flynn, D., Hodge, B.-M., Kiviluoma, J., Korpås, M., Neau, E., Couto,
1347 A., Pudjianto, D., Strbac, G., Burke, D., Gomez, T., Das, K., Cutululis, N., Van Herterm, D., Hoschle,
1348 H., Matevosyan, J., Von Roon, S., Carlini, E. M., Gaprabanca, M., and de Vries, L.: Review of wind
1349 generation within adequacy calculations and capacity markets for different power systems, Renewable
1350 Sustainable Energy Rev., 119, 109540, <https://doi.org/10.1016/j.rser.2019.109540>, 2020.
- 1351 Steg, L., Shwom, R., and Dietz, T.: What drives energy consumers?: Engaging people in a sustainable energy
1352 transition, 10.1109/MPE.2017.2762379, 2018.
- 1353 Stenclik, D., Goggin, M., Ela, E., and Ahlstrom, M.: Unlocking the Flexibility of Hybrid Resources, Energy
1354 Systems Integration Group, 2022.
- 1355 Stenclik, D., Bloom, A., Cole, W., Figueroa Acevedo, A., Stephen, G., and Touhy, A.: Redefining resource
1356 adequacy for modern power systems: A report of the redefining resource adequacy task force, National
1357 Renewable Energy Lab.(NREL), Golden, CO (United States), <https://doi.org/10.2172/1961567>, 2021.
- 1358 [Susskind, L., Chun, J., Gant, A., Hodgkins, C., Cohen, J., and Lohmar, S.: Sources of opposition to renewable
1359 energy projects in the United States, Energ Policy, 165, 112922,
1360 <https://doi.org/10.1016/j.enpol.2022.112922,2022>.](#)
- 1361 Swisher, P., Leon, J. P. M., Gea-Bermúdez, J., Koivisto, M., Madsen, H. A., and Münster, M.: Competitiveness
1362 of a low specific power, low cut-out wind speed wind turbine in North and Central Europe towards
1363 2050, Appl. Energy, 306, 118043, <https://doi.org/10.1016/j.apenergy.2021.118043>, 2022.
- 1364 Tande, J. O., Wagenaar, J. W., Latour, M. I., Aubrun, S., Wingerde, A. v., Eecen, P., Andersson, M., Barth, S.,
1365 McKeever, P., and A. Cutululis, N.: Proposal for European lighthouse project: Floating wind energy,
1366 European Energy Research Alliance Wind Energy, 2022.
- 1367 Ueckerdt, F., Hirth, L., Luderer, G., and Edenhofer, O.: System LCOE: What are the costs of variable
1368 renewables?, Energy, 63, 61-75, <http://dx.doi.org/10.1016/j.energy.2013.10.072>, 2013.
- 1369 Van Cutsem, T. and Vournas, C.: Voltage stability of electric power systems, Springer Science & Business
1370 Media, 2007.

1371 Van Dijk, M. T., Van Wingerden, J.-W., Ashuri, T., and Li, Y.: Wind farm multi-objective wake redirection for
1372 optimizing power production and loads, *Energy*, 121, 561-569,
1373 <https://doi.org/10.1016/j.energy.2017.01.051>, 2017.

1374 Van Nuffel, L., Dedecca, J. G., Smit, T., and Rademaekers, K.: Sector coupling: how can it be enhanced in the
1375 EU to foster grid stability and decarbonise?, European Parliament Brussels, Belgium, 2018.

1376 Veers, P., Bottasso, C., Manuel, L., Naughton, J., Pao, L., Paquette, J., Robertson, A., Robinson, M., Ananthan,
1377 S., and Barlas, A.: Grand challenges in the design, manufacture, and operation of future wind turbine
1378 systems, *Wind Energy Science Discussions*, <https://doi.org/10.5194/wes-8-1071-2023>, 2023.

1379 Veers, P., Dykes, K., Basu, S., Bianchini, A., Clifton, A., Green, P., Holttinen, H., Kitzing, L., Kosovic, B.,
1380 Lundquist, J. K., Meyers, J., O'Malley, M., Shaw, W. J., and Straw, B.: Grand Challenges: wind energy
1381 research needs for a global energy transition, *Wind Energy Sci.*, 7, 2491-2496,
1382 <https://doi.org/10.5194/wes-7-2491-2022>, 2022.

1383 Veers, P., Dykes, K., Lantz, E., Barth, S., Bottasso, C. L., Carlson, O., Clifton, A., Green, J., Green, P.,
1384 Holttinen, H., Laird, D., Lehtomaki, V., Lundquist, J. K., Manwell, J., Marquis, M., Meneveau, C.,
1385 Moriarty, P., Munduate, X., Muskulus, M., Naughton, J., Pao, L., Paquette, J., Peinke, J., Robertson,
1386 A., Rodrigo, J. S., Sempreviva, A. M., Smith, C. J., Touhy, A., and Wisler, R.: Grand challenges in the
1387 science of wind energy, *Science*, 366, 10.1126/science.aau2027, 2019.

1388 Vittal, E., O'Malley, M., and Keane, A.: Rotor angle stability with high penetrations of wind generation, *IEEE*
1389 *Trans. Power Syst.*, 27, 353-362, 10.1109/TPWRS.2011.2161097, 2011.

1390 Wang, X. and Blaabjerg, F.: Harmonic stability in power electronic-based power systems: Concept, modeling,
1391 and analysis, *IEEE Trans. Smart Grid*, 10, 2858-2870, 10.1109/TSG.2018.2812712, 2018.

1392 Wilches-Bernal, F., Bidram, A., Reno, M. J., Hernandez-Alvidrez, J., Barba, P., Reimer, B., Montoya, R., Carr,
1393 C., and Lavrova, O.: A survey of traveling wave protection schemes in electric power systems, *IEEE*
1394 *Access*, 9, 72949-72969, 10.1109/ACCESS.2021.3080234, 2021.

1395 Wisler, R., Millstein, D., Bolinger, M., Jeong, S., and Mills, A.: Wind Power Market-Value Enhancements
1396 through Larger Rotors and Taller Towers, 2020.

1397 Wu, Z., Gao, W., Gao, T., Yan, W., Zhang, H., Yan, S., and Wang, X.: State-of-the-art review on frequency
1398 response of wind power plants in power systems, *J. Mod. Power Syst. Clean Energy*, 6, 1-16,
1399 10.1007/s40565-017-0315-y, 2018.

1400 Xu, Y., Zhao, S., Cao, Y., and Sun, K.: Understanding subsynchronous oscillations in DFIG-based wind farms
1401 without series compensation, *IEEE Access*, 7, 107201-107210, 10.1109/ACCESS.2019.2933156, 2019.

1402 Yang, Y., DeFrain, J., and Faruqi, A.: Conceptual discussion on a potential hidden cross-seasonal storage:
1403 Cross-seasonal load shift in industrial sectors, *The Electricity Journal*, 33, 106846,
1404 <https://doi.org/10.1016/j.tej.2020.106846>, 2020.

1405 Zavadil, R., Miller, N., Ellis, A., Muljadi, E., Pourbeik, P., Saylor, S., Nelson, R., Irwin, G., Sahni, M. S., and
1406 Muthumuni, D.: Models for change, 10.1109/MPE.2011.942388, 2011.

1407 Zeni, L.: Power system integration of VSC-HVDC connected offshore wind power plants, DTU Wind Energy,
1408 2015.

1409 Zhang, H., Xiang, W., Lin, W., and Wen, J.: Grid forming converters in renewable energy sources dominated
1410 power grid: Control strategy, stability, application, and challenges, *J. Mod. Power Syst. Clean Energy*,
1411 9, 1239-1256, 10.35833/MPCE.2021.000257, 2021.

1412 Zhao, F., Wang, X., Zhou, Z., Meng, L., Hasler, J.-P., Svensson, J. R., Kocewiak, L., Bai, H., and Zhang, H.:
1413 Energy-Storage Enhanced STATCOMs for Wind Power Plants, 10.1109/MPEL.2023.3273893, 2023.

1414 Zhou, F., Joos, G., and Abbey, C.: Voltage stability in weak connection wind farms, *IEEE Power Engineering*
1415 *Society General Meeting*, 10.1109/PES.2005.1489210, 2005.

1416 **Zhou, S. and Solomon, B. D.: Do renewable portfolio standards in the United States stunt renewable electricity**
1417 **development beyond mandatory targets?, *Energ Policy*, 140, 111377,**
1418 **<https://doi.org/10.1016/j.enpol.2020.111377>, 2020.**

1419