

Condition monitoring of wind turbine drivetrains: State-of-the-art technologies, recent trends, and future outlook

Kayacan Kestel^{1,2}, Xavier Chesterman^{1,2,3,4}, Donatella Zappalá⁵, Simon Watson⁵, Mingxin Li⁶, Edward Hart⁶, James Carroll⁶, Yolanda Vidal^{7,8}, Amir R. Nejad⁹, Shawn Sheng¹⁰, Yi Guo¹¹, Matthias Stammler^{11,12}, Florian Wirsing¹³, Ahmed Saleh¹³, Nico Gregarek¹³, Thao Baszenski¹³, Thomas Decker¹⁴, Martin Knops¹⁴, Georg Jacobs^{13,14}, Benjamin Lehmann¹³, Florian König¹³, Ines Pereira^{1,2}, Pieter-Jan Daems^{1,2}, Cedric Peeters^{1,2,3}, and Jan Helsen^{1,2,3}

¹Department of Applied Mechanics, Vrije Universiteit Brussel, Pleinlaan 2, 1050 Brussels, Belgium

²Offshore Wind Infrastructure Lab, Vrije Universiteit Brussel, Pleinlaan 2, 1050 Brussels, Belgium

³FlandersMake@VUB, Belgium

⁴Artificial Intelligence Lab, Vrije Universiteit Brussel, Pleinlaan 2, 1050 Brussels, Belgium

⁵TU Delft, Kluyverweg 1, Delft, 2629 HS, Netherlands

⁶Department of Electronic and Electrical Engineering, University of Strathclyde, Glasgow, United Kingdom

⁷Control, Data, and Artificial Intelligence, Department of Mathematics, Escola d'Enginyeria de Barcelona Est, Universitat Politècnica de Catalunya (UPC), Campus Diagonal-Besós, Eduard Maristany, 16, 08019 Barcelona, Spain.

⁸Institute of Mathematics (IMTech) Universitat Politècnica de Catalunya (UPC) Barcelona 08028 Spain.

⁹Department of Marine Technology, Norwegian University of Science and Technology, NO-7491, Trondheim, Norway

¹⁰National Wind Technology Center, National Laboratory of the Rockies, Golden, Colorado, USA

¹¹DTU Wind and Energy Systems, Wind Energy Materials and Components Division, Frederiksborgvej 399, DK-4000 Roskilde, Denmark

¹²Fraunhofer IWES, Large Bearing Laboratory, Am Schleusen graben 22, 21029 Hamburg, Germany

¹³Institute for Machine Elements and Systems Engineering, RWTH Aachen University, Schinkelstraße 10, 52062 Aachen, Germany

¹⁴Center for Wind Power Drives, RWTH Aachen University, Campus-Boulevard 61, 52074 Aachen, Germany

Correspondence: Kayacan Kestel (kayacan.kestel@vub.be)

Abstract. As wind energy scales up to meet global ~~decarbonization and energy~~ energy demands and security goals, reducing the ~~levelized cost of energy (LCoE)~~ levelized cost of energy has become essential, particularly through improvements in ~~operations and maintenance~~ operations and maintenance. This positioning paper explores the ~~state-of-the-art in condition monitoring (CM)~~ state of the art in condition monitoring for wind turbines. It focuses on drivetrain components, which are among the most failure-prone and maintenance-intensive subsystems. It examines current diagnostic and prognostic strategies using supervisory control and data acquisition (SCADA) data, vibration and acoustic analysis, and digital twin frameworks, alongside emerging techniques in machine learning, signal processing, and hybrid modelling. The paper also identifies key challenges, including data availability, labelling, standardization, and the gap between academic research and industrial adoption. This work aims to guide future research and industrial efforts in making wind energy more reliable, predictable, and cost-efficient.

~~The transition to green energy sources has become a central concern for Europe, driven not only by the urgent need to address the climate crisis but also by recent global events highlighted in the report by Mario Draghi (2024), which underscores the importance of energy independence. In response, Europe has set ambitious mid-term targets for wind energy deployment.~~

15 According to WindEurope (2025)~~(2025)~~, current wind energy production capacity in Europe is 280 GW. The same report indicates that the ~~European Union (EU)~~ European Union (EU) will reach approximately 351 GW of wind capacity by 2030, with the total for all of Europe almost 450 GW, based on current build-out rates. The initiatives outlined in ~~European Commission (2019) and European Commission (2022)~~ the European Green Deal and the REPowerEU Plan (European Commission, 2019, 2022) further call for the annual installation of 20–23 GW of new wind capacity from 2025 through 2030. Additionally, WindEurope (2025) forecasts that offshore wind capacity in Europe can reach 84 GW by 2030.

20 Long-term strategies are also being developed beyond 2030. ~~This year in WindEurope (2025), it is~~ WindEurope (2025) stressed that wind farms can be deployed at scale in a relatively short time span and will be a major contributor to meet the increasing energy demand. Member ~~States~~ states within the EU have set objectives to achieve 440 GW of onshore and 150 GW of offshore wind capacity. These goals reflect Europe's intention to double or even triple its current wind capacity throughout the 2030s, with continued expansion envisioned through 2050 under net-zero pathways.

25 To meet these targets, reducing the levelized cost of energy (LCoE) for wind power is essential. The LCoE refers to the average cost of electricity generated by a wind turbine over its operational life. A key factor influencing LCoE is the operating expenditure (~~OPEX~~), particularly operations and maintenance (O&M) costs, which represent a major share of the total ~~life cycle~~ life cycle cost of a wind farm, shown by ~~Hammond and Cooperman (2022); Feng et al. (2010)~~ Hammond and Cooperman (2022) and Feng et al. (2010). For onshore wind projects in 2023, O&M expenses, both fixed and variable, generally accounted for
30 10% to 30% of the total LCoE, according to the International Renewable Energy Agency (2024). While decreasing turbine prices have historically helped reduce costs, their impact is now limited, making O&M cost reduction increasingly important. The International Renewable Energy Agency (2024) reports that in offshore wind farms (fixed bottom) in the G20 countries, O&M costs typically range from 16% to 25% of LCoE.

1.1 What is a drivetrain?

35 The drivetrain plays an important role in defining the overall dynamic response of the turbine, the efficiency of power conversion, and the structural integrity. It must accommodate a variety of variable operational conditions, including wind turbulence, directional shifts, start-stop sequences, and grid-induced disturbances. A well-designed drivetrain ensures not only energy efficiency but also long-term reliability and maintainability, which are particularly critical in large-scale and offshore wind applications (Struggl et al., 2015; Ritschel and Beyer, 2022).

40 There are two principal drivetrain configurations (Nejad et al., 2022): ~~indirect drive~~ indirect drive (geared) systems, in which a gearbox increases the rotor speed to match the requirements of the generator, and ~~direct drive~~ direct drive (gearless) systems, where a large, ~~low-speed~~ low-speed generator is directly coupled to the rotor.

The wind turbine drivetrain refers to the mechanical and electromechanical subsystem responsible for transmitting the kinetic energy captured by the rotor into electrical energy via the generator. The drivetrain begins with the rotor assembly, which

45 includes the blades and hub. The blades are aerodynamic structures that extract kinetic energy from the wind and generate torque. This torque is transferred to the hub, which anchors the blades and directs the mechanical energy into the main shaft. In geared systems, a gearbox amplifies rotational speed, which is then transmitted to the generator. The generator, typically induction or permanent magnet synchronous type, converts mechanical energy into electrical energy, with power electronics used for variable-speed operation and grid integration. A mechanical brake system is also mounted on the high-speed shaft.

50 In general, an ~~indirect drive~~ indirect-drive system comprises the following components: the hub (including the blades and the pitch system), the main bearing, a shaft and a gearbox, a generator, and various auxiliary subsystems, such as braking and electrical systems, that ensure stable operation and functional integrity of the turbine (Struggl et al., 2015).

1.2 Need from industry to monitor

Within the overall O&M costs of wind turbines, the drivetrain is one of the most maintenance-intensive subsystems. Failures

55 in wind turbine drivetrains and other major turbine components, e.g., blades, pitch systems, and converters, can significantly increase O&M costs and lead to substantial downtime costs. According to ~~the report by EPRI (2020)~~ a report by the Electric Power Research Institute (EPRI, 2020), the O&M cost of the global onshore wind turbine industry is estimated to reach up to \$15 billion annually. While the exact O&M expenditure of wind farms is not public information, the value is even higher for offshore turbines per MW megawatt. Ensuring the reliability of drivetrain components is therefore critical to the cost-

60 effective and sustainable deployment of wind energy. Continuous condition monitoring helps detect potential issues early, while accurate estimation of the ~~remaining useful life~~ remaining useful life (RUL) of these components allows for optimized maintenance scheduling. This article presents a detailed overview of current approaches to drivetrain condition monitoring and ~~remaining useful life~~ RUL prediction in wind turbines.

1.2.1 What is the cost of O&M in a wind farm?

65 The wind industry has experienced tremendous growth over the past few decades. Advancements from design and manufacturing to O&M have led to reduced capital and maintenance costs, which make wind power an indispensable source for a comprehensive solution to global energy needs. The global cumulative installed capacity, combining land-based and offshore applications, ~~has~~ exceeded one trillion watts by the end of 2023 (GWEC, 2024). Despite the success measured by the scale of deployment, the industry is still challenged by premature component failures, which have become a bigger issue for newer turbine technologies.

70 Furthermore, mature turbine technologies with longer operational experience have and will be subject to an increased number of component failures, ~~as all mechanical systems do as they age~~ like all ageing mechanical systems, leading to increased O&M costs. These turbines typically need overhauls or replacements of major mechanical components or blades throughout their service life, despite the fact that structural components, such as the foundation and tower, can normally last longer. Major component overhauls or replacements, though infrequent, are typically associated with long downtimes. When compounded

75 by more frequent failures of minor components, they significantly increase O&M ~~costs of wind turbines and subsequently, the LCoE for wind power. The O&M cost can~~ wind turbine costs and subsequently wind power LCoE. O&M costs typically increase as wind turbines age and ~~become much~~ are significantly higher for offshore wind power plants. For land-based wind

plants, approximately half of the ~~wind-plant O&M costs are from wind turbine O&M~~ O&M costs derive from the turbines themselves. Comparatively, offshore ~~wind-plant~~ O&M costs can be several times higher than those of a ~~land-based~~ wind plant counterparts. This difference is largely attributed to higher failure rates in offshore turbines compared to onshore ones, a result of harsher environmental conditions, higher rotating speeds, and higher rated powers (Carroll et al., 2016). Moreover, the hard-to-access nature of offshore wind farms increases O&M costs substantially. Turbine O&M costs ~~are the primary source of potential O&M~~ represent the primary area for potential cost reductions, which can be accomplished ~~by improved O&M~~ through improved strategies enabled by ~~various CM~~ condition monitoring technologies.

85 1.2.2 Main failing components

Wind turbines are complex systems ~~that operate~~ operating under highly dynamic environmental conditions. ~~In particular,~~ offshore wind turbines Offshore turbines, in particular, are exposed to more severe environments than ~~their~~ onshore counterparts, ~~including due to~~ higher wind speeds, salt-laden humidity, and extreme weather events, which collectively accelerate ~~component~~ degradation and increase failure rates (Carroll et al., 2016). The emergence of floating offshore wind turbines (FOWTs) ~~further~~ introduces introduces further complexity via platform-induced motions and additional dynamic loads, amplifying ~~the~~ operational stresses on critical components (McMorland et al., 2022). Consequently, ~~offshore and floating wind turbines both fixed and floating offshore assets~~ exhibit higher failure frequencies and face greater maintenance challenges, ~~stressing the need for the identification and monitoring of~~. Hence, it is necessary to identify and monitor critical components to ensure system reliability and reduce ~~lifecyle costs~~ life cycle costs. A detailed understanding of component-specific failure mechanisms is therefore essential for developing the advanced condition monitoring, diagnosis, prognosis, and predictive maintenance strategies required to ensure the economic viability of the sector.

~~Among the major components, several are widely recognized as the most susceptible to failure. The main bearing, which supports the rotor and transmits loads to the main shaft, is vulnerable to various failure modes under the influence of highly non-steady loading. The gearbox, which~~ Reliability studies indicate that a minor portion of wind turbine assemblies (38%) is responsible for ~~transmitting mechanical power from the rotor to the generator, frequently experiences gear tooth pitting, scuffing, and bearing failures due to torque fluctuations and misalignments. The generator and converter, as essential parts of the drivetrain and electrical system, are susceptible to thermal cycling, transient loads, insulation degradation, and power electronic faults.~~ over half of all failure rates and 60% of total downtime (Artigao et al., 2018b). While electrical and mechanical components may fail at similar frequencies, mechanical failures result in significantly longer outages, accounting for more than 75% of total downtime (Artigao et al., 2018b). Specifically, electric systems, control systems, and blade/hub assemblies drive the highest failure rates, whereas gearboxes, generators, and hub/blade assemblies cause the most severe downtime (Artigao et al., 2018b)

The gearbox remains one of the most critical drivetrain elements; it experiences a high number of failures, and its breakdown typically results in the longest downtime and highest economic loss (Olabi et al., 2021). Similarly, generators consistently account for high failure rates and significant downtime across multiple reliability studies (Olabi et al., 2021; Carroll et al., 2016)

. In offshore systems, transformers and electrical components also represent a massive portion of critical failure modes requiring extensive condition-based maintenance (Olabi et al., 2021; Carroll et al., 2016; Scheu et al., 2019).

115 Rotor blades are the third major contributor to O&M costs after the generator and gearbox (Carroll et al., 2016). They are prone to leading-edge erosion, fatigue cracking, and delamination caused by sustained aerodynamic loading and environmental exposure.~~The (Wang et al., 2022b). These loads are managed by the pitch system, comprising which consists of pitch bearings and drives, is. While the pitch system acts as a primary safety mechanism for controlling aerodynamic loads and is characterized by susceptibility to wear and fatigue-related failures. A detailed understanding of these component-specific failure mechanisms is critical for the development of advanced condition monitoring, failure detection, diagnosis, and prognosis, and predictive maintenance strategies, which are essential to improve the reliability, availability, and economic viability of wind turbines., it is~~
120 highly susceptible to wear and fatigue, presenting the highest failure rates in offshore systems (Carroll et al., 2016). Although a pitch system failure can lead to devastating catastrophic events (Olabi et al., 2021), it generally has a lower overall impact on maintenance and downtime costs compared to the energy-producing systems mentioned above (Carroll et al., 2016).

125 Finally, the main bearing supports the rotor and transmits loads to the main shaft, making it vulnerable to various failure modes under highly non-steady loading. Historically, main bearing failure incidents may have been under-reported (Hart et al., 2020), as they are sometimes categorized under broader terms such as "drivetrain" or "other." However, recent data suggests that main bearing failure rates can reach up to 30% over a turbine's lifetime Hart et al. (2019). While these typically result in lower annual failure costs than generators or gearboxes, the main shaft and bearings remain highly critical assemblies because their specific downtime costs can equal those of the primary drivetrain components Hart et al. (2019).

1.2.3 Value of condition monitoring in cost scenarios

130 Once wind turbines are installed in the field, the main opportunity for cost reduction lies in the improvement of O&M practices. Condition-based maintenance (CBM), enabled by various CM condition monitoring technologies, is a practice that the wind industry has investigated for O&M strategy improvements. Typical CM condition monitoring technologies include several modules: data acquisition, signal processing, feature extraction, modelling and analysis for fault detection, diagnosis
135 diagnostics and prognostics, and O&M ~~decision-making~~decision-making. Without investing in any dedicated instrumentation, modelling and analysis for the purpose of fault detection, diagnostics, or prognostics can be conducted using SCADA supervisory control and
system data. Based on dedicated instrumentation, there are various CM condition monitoring technologies, e.g., vibration analysis typically using data collected by accelerometers, oil debris monitoring using magnetic field or image-based sensing principles ~~or,~~
140 oil condition tracking based on certain parameters such as cleanliness, contamination, or oxidation levels, and electric signature analysis, among others. All of these monitoring solutions can be conducted continuously, which is recommended if budget is not a challenge, and periodically, which has the downside of possibly missing fault signatures embedded in the data that was/were not measured. Typical~~A typical~~ value from SCADA-based monitoring is the deviation from baseline or healthy states that can be detected by comparing incoming data against predicted values using the normal behaviour models, which are normally developed based on data collected under healthy states. For major component monitoring solutions, the main benefit is to convert a potential full replacement to an up-tower repair. Fault detection is good information that the

145 industry can benefit from. However, most end users would like to understand how bad the situation is, e.g., fault severity, and how much longer they can keep the turbine running, e.g., RUL prediction, until maintenance actions must be taken. The request is along the line of prognostics, which has not been widely adopted by the industry ~~although~~ but has been actively investigated in the research community ~~has investigated actively~~. The gap between academic exercises and field adoption needs to be filled before the industry can benefit fully from prognostics. Reliable prognostics can enable the bundle of a few different maintenance activities into one crane rental or one vessel trip. In addition, if root cause ~~analyses~~ analyzes of frequent failure modes are conducted and confirmed, the feedback can be provided to component designers and manufacturers to help improve future product performance.

1.2.4 Standards, recommended practices, and guidelines

~~As CM is gradually adopted~~ With the gradual adoption of condition monitoring in the wind industry, various standards, recommended practices, and guidelines have been developed. They will become increasingly important as the industry adopts more ~~of predictive maintenance~~ predictive maintenance practices. A few well-established standards include the following: 1) ISO 20816-21: 2025 ~~providing~~ provides information regarding the measurement and evaluation of the mechanical vibration of wind turbines and their components. It covers both geared and ~~direct drive~~ direct-drive types of drivetrain configurations. Recommended zones for evaluation of vibration under continuous load operation are provided, although cautions need to be taken for early fault detection by using the recommended zone boundaries; 2) ISO 17359 ~~providing~~ provides a general methodology for setting up ~~CM programs~~ condition monitoring programs. 3) ISO 13379 ~~providing~~ provides data interpretation and diagnostics techniques applicable to wind turbines; 4) IEC 61400-25 ~~providing~~ provides uniform information exchange for monitoring and control of wind power plants; 5) IEC 61400-1 ~~including~~ includes design requirements on ~~CM~~ condition monitoring systems in turbines; ~~and~~ 6) IEC 61400-13 ~~providing methods for measurement of~~ provides methods for measuring mechanical loads in turbines that are relevant for ~~CM~~ condition monitoring. For recommended practices, one notable effort is the O&M recommended practices published by American Clean Power Association (formerly American Wind Energy Association). It has a chapter on condition-based maintenance, which covers general overview, vibration analysis, grease analysis on different components (e.g., main bearing, pitch bearing), temperature measurement, nacelle parameter monitoring, oil monitoring, etc. In terms of guidelines, two older ~~er~~ efforts are GL-IV-4, and Allianz Zentrum für Technik report 03.01.068, on requirements for certification of ~~CM~~ condition monitoring systems in wind turbines. Their contents were mostly incorporated in DNVGL-SE-0439, a service specification for certification of wind turbine ~~CM~~ condition monitoring systems.

Current efforts on standards, recommended practices, and guidelines are addressing the evolving needs of the industry, such as ~~onshore ageing fleet~~ the ageing onshore fleet with increased failure rates ~~and~~ offshore wind turbines, ~~facing which face~~ harsher environmental conditions and greater accessibility challenges. There is also a need to define open data formats and improve interoperability among ~~CM~~ condition monitoring systems, which can be accomplished through international collaborations on standards harmonization and knowledge exchange among various standard ~~organisations~~ organizations, such as ISO, IEC, and IEA. Future efforts are expected to account for impacts from artificial intelligence (AI) and machine learning (ML) on modelling and analysis in support of fault detection, diagnostics, and prognostics, especially as turbines increase in

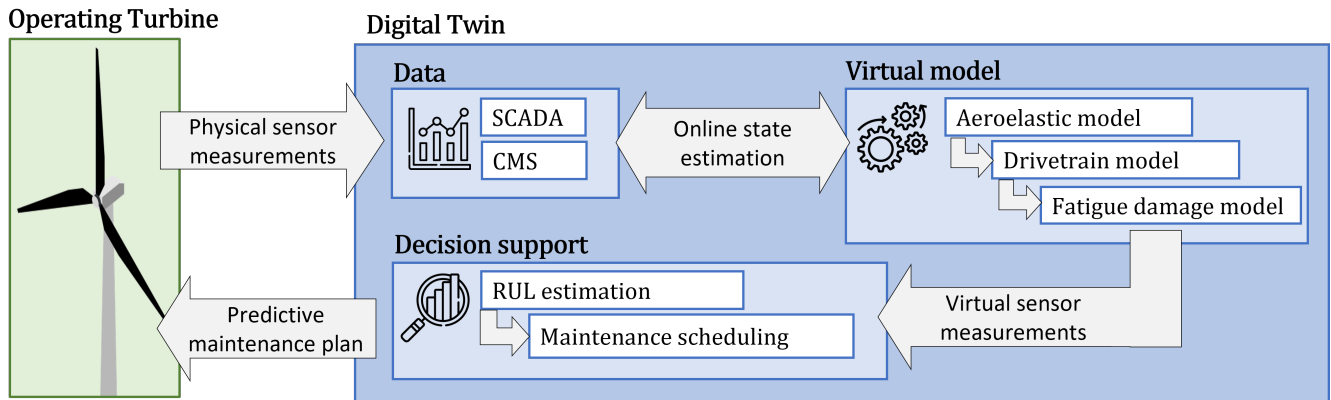


Figure 1. Example of digital Twin-twin framework for continuous RUL estimation in wind turbine drivetrain components (Mehlan et al., 2023).

rating and become more complex, automated, or intelligent. Additionally, cybersecurity and data integrity within CM-condition
 180 monitoring systems need to be better addressed due-to-because-of the increased connectivity and digitalization of wind plants.

1.3 Digital twin in condition monitoring

A digital twin is the-virtual-and-computerized-a-virtual counterpart of a physical system, eharacterized-by-high-levels-of
digital-physical-defined-by-deep integration and automated data flows between-the-two (Kritzinger et al., 2018). In the context
 of Condition Monitoring and Remaining Useful Life, the-central-pillars-of-the-digital-twin-concept-are-condition-monitoring-and
 185 RUL, the-concept-rests-on-two-pillars: 1) continual-data-acquisition-combined-with-modelling-to-facilitate-the-virtual-mirroring
of-the-use-of-continuous-data-and-modelling-to-mirror a turbine's operational history, component-degradation-and-consumed
life;and-and-degradation, and 2) the ability to predict impacts-on-component-damage/life-of-future-scenarios-and-decisions,
thereby-acting-as-part-(decision-support)-or-whole-(controlling-instance)-decision-maker-for-the-physical-system-how-future
scenarios-or-decisions-will-impact-component-life (Errandonea et al., 2020). Figure 1 presents-an-example-of-digital-twin-for
 190 RUL-monitoring-of-illustrates-this-framework-for drivetrain components. A-computerized-counterpart-fulfilling-pillar-1-and-the
decision-support-role-of-pillar-2-is-more-precisely-termed-a While a system that provides decision support is often termed a
Digital Shadow digital shadow, while-those-fulfilling-pillar-1-while-acting-a-true digital twin acts as a direct controlling instance
of-the-system-in-question-are-considered-true Digital Twins that-can-autonomously-execute-decisions-for-the-physical-system
 (Kritzinger et al., 2018; Errandonea et al., 2020).

195 In the digital twin framework for-wind-turbines, simulated data play-a-crucial-role-in-is-essential-for replicating real-world
 operating conditions and potential-failure-modes. These simulated-datasets-are-instrumental-in-creating datasets-are-used-to
create synthetic representations of turbine-components,-such-as-components-like blades, bearings, and gearboxes, particularly
in-scenarios-where-especially-when actual fault data are-limited-is-scarce (Zhao et al., 2022). This capability allows the digital
 twin to model the-behaviour-of-critical-components-under-various-stress-conditions,-including-extreme-or-rare-fault-scenarios,

200 ~~thereby enhancing failure prediction and optimizing maintenance strategies~~ how critical components behave under different stress levels, including rare or extreme failures, which improves prediction accuracy and maintenance planning (De Kooning et al., 2021). The integration of simulated data into the digital twin framework not only aids in understanding component behaviour but also facilitates the development of predictive maintenance protocols that can significantly reduce downtime and maintenance costs (Pacheco-Blazquez et al., 2024). ~~In the following, different modelling strategies~~ Different modelling strategies are briefly discussed below, i.e., data-driven models including supervised and unsupervised, ~~and~~ physics-based ~~approach as well as approaches, and~~ data processing like continuous data support, data pre-processing, data storage, and decision support ~~are briefly discussed~~. The choice of different modelling strategies (data-driven, physics-based, and hybrid) and how actually they improve the condition monitoring performance depends largely on the design information and data availability. For instance Gebel et al. presents a case where the operator has a large measurement data, but is left with limited

205 design information. The similar problem is also raised by Wada et al. for operators in Japan in order to build a physics-based digital twin as they often have limited insight into the design of the drivetrain. Development in AI and data-driven models opens an opportunity, but the advantage of physics-based simulations which do not require a large amount of historical data for model training, as needed for data driven models, also enable prediction of the turbine's behaviour, even in instances where such conditions have not been previously observed should not be overlooked (Gebel et al., 2025).

- 215 – **Data-Driven Models** :- **Supervised vs. Unsupervised**: Data-driven models are instrumental within digital twins for wind turbines. These models utilize historical and real-time data to forecast system health, and they can be categorized into supervised and unsupervised learning approaches. Supervised models depend on labelled data for training, which helps in identifying known faults, such as blade erosion or gearbox damage, once trained with historical datasets (Solman et al., 2022). Conversely, unsupervised models do not require predefined labels and are adept at detecting anomalies or
- 220 unexpected behaviours in turbine operations. This characteristic is particularly advantageous for identifying emerging or previously unknown failure modes, thereby enhancing the overall reliability of wind turbine systems (Encalada-Dávila et al., 2021).
- **Physics-based Models**: Physics-based modelling is another approach to build models for digital twins where fundamental physics rules are utilized (Johansen and Nejad, 2019). For instance ~~equation of motions~~, equations of motion can be used
- 225 to model the relation between input load and load effects in a wind turbine gearbox, which can be further processed through fatigue damage models in order to estimate damage and RUL (Mehlan et al., 2022). Despite the dependency of data-driven models on large ~~data-sets~~ datasets, the physics-based models do not necessarily require historical data. However, having all physical parameters to build a physics-based model is often a challenge, particularly for operators.
- **Continuous Data Support**: The efficacy of a wind turbine's digital twin is heavily reliant on the continuous inflow
- 230 of real-time data. Systems such as SCADA, and condition monitoring systems (CMSs) provide ongoing data streams that enable the digital twin to maintain an accurate representation of the turbine's operational state (Schröder et al., 2018). This constant data flow is essential for real-time fault detection and early warning systems, allowing operators to respond swiftly to potential issues, such as abnormal rotor behaviour or temperature fluctuations in the drivetrain

(Momber et al., 2022). Recent studies underscore the significance of continuous data streams in enhancing the accuracy of digital twins, particularly in areas like load monitoring and fatigue assessment, which are critical for ensuring the longevity and efficiency of wind turbines (Mehlan and Nejad, 2024).

- **Data Pre-Processing:** Data pre-processing is a vital step in the digital twin pipeline for monitoring wind turbines. Raw data from turbine sensors often contain noise, missing values, or outliers that must be addressed to ensure effective utilization. For example, vibration data from turbine components require filtering to eliminate background noise (Peeters et al., 2025, 2016), while SCADA data must be normalized to maintain consistency across multiple turbines (Ibrahim et al., 2023). This pre-processing is crucial for the accuracy of the digital twin's predictive models, which depend on clean, structured data to monitor the health of turbine components and anticipate failures (Wagg et al., 2020). Without rigorous data pre-processing, the reliability of the digital twin's predictions could be compromised, leading to inefficient maintenance strategies and increased operational risks (Wadhvani et al., 2022).
- **Data Storage:** The generation of large volumes of data by a digital twin requires efficient data storage solutions to manage both real-time and historical data effectively. High-frequency sensor data from the CMS and SCADA measurements are streamed into the digital twin, making robust data storage essential for real-time monitoring and long-term trend analysis (Liu et al., 2024b). Furthermore, the simulated data used for fault prediction and performance evaluation must also be securely stored. Advances in data storage technologies, such as distributed systems and cloud-based solutions, could enable the scalability required for large wind farms employing digital twins. Effective storage and retrieval systems facilitate the integration of real-time data with historical trends. As a result, the ability of digital twins to accurately predict the RUL of critical components, such as gearboxes and main bearings, is enhanced (Sivalingam et al., 2018).
- **Decision support:** The loop between the real asset and the virtual models is closed when the digital twin is able to provide decision support and feedback to the asset (Purcell et al., 2024). The level and type of decision support depends on the digital twin functionality level, as described in the following section 1.3.1. Remaining useful life estimation is an example of digital twin decision support at a prognostic capability level.

1.3.1 Digital twin capability levels

DNV (DNV, 2020) has classified a digital twin in six functional element capability levels where the capability increases for each level. Level zero is "represents a stand-alone "or discounted to real asset level where the real asset may not yet exist model" with no data or decision exchange between model and asset, the model and the asset. In this case, the physical asset may not even exist yet. A finite element (FE) model during model during the design phase is an example of this level stage. Level one is the "descriptive" level, for instance, a multi-body dynamic model (MBS) which is updated by data from the real asset. In this level Here, the digital twin can describe the asset behaviour and provide alarms, for example. The second level, "diagnostic", is where the digital twin is able to identify the faults and be used as a diagnostic tool. If the digital twin is able to estimate the RUL, then level three or, "predictive" level, is achieved. The next level, level four, Level four is "perspective". In this level phase, the

digital twin is able to provide recommended actions based on predictions. Finally, level five is the "autonomous" level where the digital twin can take over control from the user and control the asset.

As highlighted by Ibrion et al. (2019), the main aim of employing a digital twin is to reduce the risk in operations, ~~and~~; therefore, the digital twin itself should not pose or bring new risk. Specifically, these technologies target the reduction of risks associated with design errors, maintenance-related downtime, and structural fatigue over an asset's lifecycle. As the digital twin functionality level increases, the associated risk may also increase. It is therefore essential to evaluate the risk and uncertainty throughout each level (Ibrion et al., 2019; Mehlan and Nejad, 2024).

1.3.2 Brief overview of data access challenges

It is well known that the wind industry R&D and technology innovations, including condition monitoring, are hindered by data sharing. There are a few concerns by data owners: 1) Disclosure of sensitive information may impact their business competitiveness; 2) ~~Data data~~ sharing infrastructure introduced to facilitate the data sharing may pose new cybersecurity risks; 3) ~~What are the uncertainty regarding~~ specific data-driven project objectives and ~~what exact data streams or sets may be needed?~~ required data streams; and 4) ~~What is the value with lack of clarity concerning the value generated by~~ their data sharing ~~effort, etc.?~~ efforts.

The contradictory fact is that the wind industry is data rich, ~~with~~. There are thousands of turbines, each ~~having hundred with~~ hundreds of channels of measurements of various types at different resolutions. There are a few possible ways to mitigate the data sharing challenge: 1) Use normalization and anonymization; 2) ~~Specify specify~~ task objectives, data needs, and value (e.g., standardization and FAIR data principle) returned to data owner; 3) ~~Adopt adopt~~ a clear data protection mechanism, making it beneficial to members of a consortium (e.g., ~~NREL-NLR~~ gearbox reliability database (NREL, 2018), EPRI WinNER (EPRI, 2021), and ORE Catapult Sparta (Catapult, 2020)), while releasing educational information to the public (e.g., data organized by turbine ratings, technology types without disclosing turbine or component ~~OEMs~~ original equipment manufacturers); and 4) ~~Investigate investigate~~ novel data sharing approaches that enable proprietary data sharing without disclosing sensitive information.

1.3.3 Ideal datasets for condition monitoring research

~~To support CM research with possible~~ To support condition monitoring research and root cause analysis ~~based on one for a~~ wind plant, an ideal dataset should include ~~basic plant information~~ (the following five categories of information:

- Basic plant information, such as the site layout, resource measurements ~~based on from~~ met towers or turbine ~~nacelle, nacelles, the~~ number of turbines, ~~turbine information~~), turbine ~~(and specific turbine specifications;~~
- Operational data for the turbines or balance of plant) ~~operational data (, including~~ SCADA time series ~~, status codes) and~~ status codes recorded before and after a fault ~~(or failure) event, fault (or failure) history, dedicated CM system data (if available), and maintenance logs (or work orders, including inspection reports), or failure event;~~
- Historical records of faults or failures;

- Dedicated condition monitoring system data, where available; and
- Maintenance logs, including work orders and detailed inspection reports.

300 These data can be in different file formats: time series (SCADA, vibration, oil debris, and met tower), text or string (status codes), Excel table entries (e.g., oil sample analysis results), and pdf (e.g., inspection or oil sample analysis reports). In addition, with the advancement of modelling capabilities, there is abundant synthetic or simulated data, which can be beneficial to mitigate the unbalanced data challenge between faulty and healthy populations. In case a root cause investigation is conducted, the findings are also valuable, especially CM-condition monitoring recommendations that might be used for

305 control adjustments, reducing loads and extending component operational time or life. If more data from wind plants with the same or similar turbine models are available, it will be helpful to make the CM-condition monitoring technologies transferable to different plants or more robust with reduced uncertainty. From a broad industry-wide CM-condition monitoring research perspective, it will be extremely valuable to give the research community access to a large population of useable data based on multiple wind plants. Moreover, data owners can gain immediate access to the developed CM-condition monitoring technologies

310 and help mature these technologies before they are adopted by the rest of the industry.

~~The data access, or broadly digitalization, challenges include a mix of~~ To address the data access and digitalization challenges, several international initiatives and research proposals have emerged, targeting the technical, cultural, and business aspects that requires collaboration across industry, academia, and governments to solve. This is the focus of the second phase of Task 43, which was approved in October 2023 following a Task extension proposal (Bray et al., 2021). barriers that currently

315 hinder sector-wide collaboration. These efforts, such as those coordinated by IEA Wind Task 43 focuses on (Bray et al., 2021) , focus on streamlining the digitalization of wind energy by coordinating through international research on data standards, sharing , and protocols, and advanced analytics to improve lifetime efficiency, reduce costs, and accelerate deployment across the wind sector. The main objectives of Task 43 in this second phase, firstly include learning about data, data services, knowledge graphs and knowledge engineering, and ultimately publishing recommendations for improving data sharing in the

320 sector. Existing and new ontologies will be developed and published collaboratively, and a data maturity roadmap to help the sector plan collaborative activities to increase data maturity will be published. In addition to this, methods for improving organisational culture and cooperation between organisations in the sector to foster digitalisation will be investigated. The results will be converted into life-cycle efficiency and reduce costs. By developing collaborative ontologies, data maturity roadmaps, and guidelines for best practices, these projects aim to foster a culture of "coopetition". Ultimately, these initiatives seek to

325 publish practical recommendations and success stories ~~. Finally, deep dive use case workshops are planned and guidelines for best practices will be developed, outlining that demonstrate~~ how priority use cases can be solved in practice through improved data sharing and organizational transparency.

1.4 Data labelling and annotation: Impact on model training

1.4.1 **Importance for learning models: healthy data and fault classification**

330 ~~Model learning in the context of~~

Model learning for distinguishing between healthy and faulty operational states of wind turbines faces several significant challenges when applied to experimental data. One major obstacle is the inherent imbalance in ~~the dataset~~datasets, as fault occurrences are typically rare compared to normal operational data, ~~leading to limited examples for training robust classifiers~~. This scarcity can result in models that are biased towards the majority class, reducing their effectiveness in accurately detecting faults.

335 Additionally, experimental wind turbine data are often noisy and subject to variability due to fluctuating environmental conditions, sensor inaccuracies, and operational inconsistencies, which complicates the extraction of reliable features ~~for model training~~. The high dimensionality of the data, with numerous sensors capturing a wide range of parameters, further exacerbates the difficulty ~~, making it challenging to identify the most relevant indicators of faults~~of identifying relevant fault indicators.
340 Furthermore, differences in turbine models and configurations introduce heterogeneity ~~that models must account for~~, hindering the development of generalized solutions. Addressing these challenges requires advanced techniques such as data augmentation, imbalance handling methods, robust feature selection, and transfer learning to enhance model resilience and accuracy.

1.5 Contributions and novel perspectives of this review

345 While the literature contains numerous reviews on specific condition monitoring technologies, this manuscript moves beyond a purely descriptive consolidation of these methods. The contribution of this review lies in its comprehensive approach to the condition monitoring pipeline, connecting raw data acquisition with practical O&M decision-making. Specifically, the contributions of this review are threefold:

- **Integration of emerging techniques:** In addition to established methods, this review evaluates new diagnostic and prognostic approaches, such as video-based vibration analysis, deep learning for complex acoustic emission classification, and the transition toward advanced digital twin frameworks.
- **Focus on industrial adoption:** The practical barriers hindering the transition of advanced algorithms from academic research to operational wind farms are analyzed, particularly highlighting challenges related to data scarcity, dataset imbalance, and uncertainty quantification in complex environments.
- **A problem-driven perspective:** By consolidating insights across SCADA, vibration, and acoustic domains, this work
355 outlines how different data streams can be combined to solve core condition monitoring problems, offering a guide for future research and industrial deployment.

1.6 Organization of the manuscript

To guide the reader, the remainder of this manuscript is organized around the fundamental challenges of condition monitoring and asset management.

360 Section 2 establishes the context by analyzing current **failure trends** and identifying the critical components that cause downtime in wind turbine drivetrains. Section 3 directly addresses the problem of **fault detection and diagnosis**, detailing

365 strategies to identify and classify anomalies using SCADA, vibration, and acoustic emission data. Shifting to predictive capabilities, Section 4 covers the problem of prognosis, focusing on RUL estimation methods and their practical limitations. Section 5 applies these diagnostic and prognostic strategies to specific drivetrain components (main bearing, gearbox, generator, converter, and blades), discussing data and processing challenges for each. Finally, Section 6 addresses the end goal of condition monitoring: decision-making. It discusses how diagnostic and prognostic outputs translate into optimized O&M strategies and maintenance planning. The final section concludes the paper with a summary and future outlook.

2 Failure trends

370 Understanding the reliability and historical performance of wind drivetrains is fundamental to developing effective monitoring strategies. By identifying which components fail most frequently and which contribute most significantly to downtime, operators can prioritize their condition monitoring efforts. This section analyzes the current failure statistics for wind turbines and outlines the dominant failure modes affecting critical drivetrain components.

2.1 Key components causing downtime and their failure rates

Failure data from wind turbines are crucial for identifying critical components and improving wind farm performance. In recent years, the cumulative installed capacity of wind turbines, particularly in offshore wind energy, has been steadily increasing. 375 However, due to intense industry competition, information regarding wind turbine operations and failures is strictly protected, with offshore wind failure data being particularly scarce. In this context, some prior studies have collected, analyzed, and compared available data from onshore turbines along with the limited data accessible from offshore sources. For example, Carroll et al. (2016) released a dataset covering 350 offshore wind turbines across Europe, including statistics on failure 380 rates, repair costs, repair times, etc. Cevasco et al. (2021) provided a comprehensive analysis of ~~Reliability, Availability, and Maintainability (RAM)~~ reliability, availability, and maintainability data for both onshore and offshore wind turbines. Dao et al. (2019) reviewed 18 sources of wind turbine ~~RAM~~ reliability, availability, and maintainability data, providing a visual comparison of failure rates and downtime for critical components in onshore and offshore wind turbines, as illustrated in Figure 2 and Figure 3. The figures show that the top three components with the highest failure rates in onshore wind 385 turbines are electrical systems, control systems, and blades ~~& and~~ and hub. This may be due to frequent changes in onshore wind speed and direction, which require more frequent system adjustments, increasing the load and stress on these components. While onshore turbines most frequently experience failures in electrical and control systems, the situation offshore presents different challenges. For offshore wind turbines, the components with the highest failure rates are the pitch systems, followed by generators. The overall failure rates of offshore wind turbines are typically higher than onshore, and the differences in the 390 high-failure components can be explained by the harsh marine conditions and higher wind speeds offshore. Generators also operate more frequently under high-load conditions, which increases the risks of wear and overheating.

Analyzing downtime reveals that component rankings for offshore and onshore wind turbines are consistent, with gearboxes, generators, blades ~~& and~~ and hubs accounting for the longest downtimes. This is largely due to the considerable size and weight of

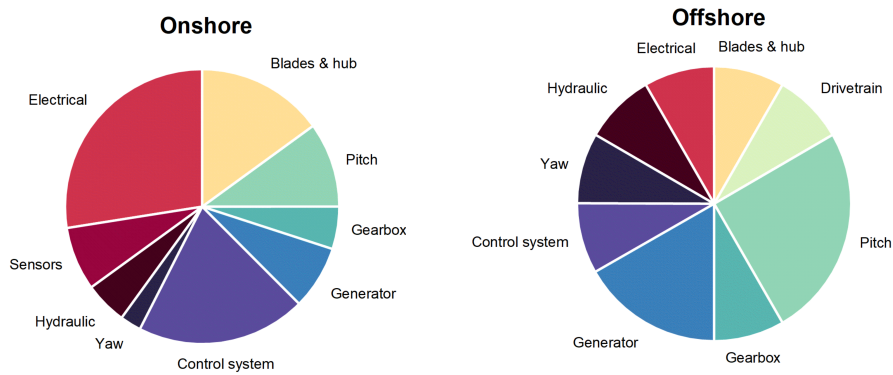


Figure 2. Failure rate comparison of components in onshore and offshore wind turbines (reproduced from (Dao et al., 2019) Dao et al. (2019)).

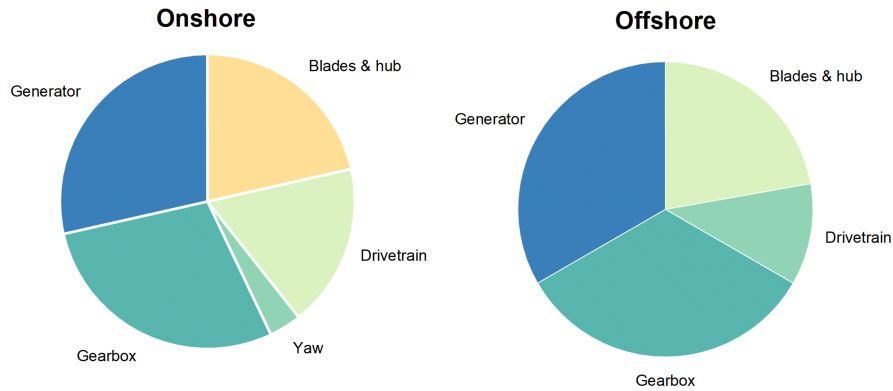


Figure 3. Downtime comparison of components in onshore and offshore wind turbines (reproduced from (Dao et al., 2019) Dao et al. (2019)).

these components. When faults occur, these components typically require complex procedures such as disassembly, inspection
 395 -, and even full replacement, often necessitating large-scale lifting equipment, which significantly prolongs the repair process. Furthermore, offshore wind turbines are located in deep and remote waters where harsh environmental conditions and limited accessibility for maintenance vessels present significant challenges. These factors increase the difficulty and duration of on-site repairs, thereby exacerbating overall downtime.

2.2 Main failure modes

400 The previous section identified the components with the highest failure rates and downtimes, including gearboxes, generators, blades ~~& and~~ hub, electrical and control systems, and pitch systems. Many studies have investigated the failure modes of the critical components in ~~onshore/both onshore and~~ offshore wind turbines. For instance, Kang et al. (2019) employed ~~Fault Tree Analysis (FTA)~~ fault tree analysis to visually depict failure paths in floating wind turbines and identify root causes. Scheu et al. (2019) used ~~Failure Modes, Effects, and Criticality Analysis (FMECA)~~ failure modes, effects, and criticality analysis 405 to prioritize components in offshore wind turbine systems, providing valuable insights for condition monitoring systems and subsequent maintenance planning. The common failure modes for components with the highest failure rates and downtimes are summarized as follows.

Within the drivetrain, main bearing reliability has become a significant challenge to the wind industry (Hart et al., 2023; EPRI, 2024). A variety of failure modes have been documented, including damage resulting from surface and subsurface 410 initiation, stray currents, lubrication failures, overloading, and improper bearing assembly/fit (Hart et al., 2023; EPRI, 2024). The principal drivers of premature ~~MB-main bearing~~ failures remain unclear.

The gearbox in wind turbines serves to amplify the rotational speed of the blades to a level that is efficient for electricity generation by the generator. Gearbox failures in wind turbines are commonly found in the gears and bearings. Typical failure modes include wear of gear teeth and the wear of rollers and raceways in the bearings (Bejger et al., 2021; Gong et al., 2017; 415 Greco et al., 2013). Cracks or even fractures may occur under excessive impact loads or prolonged fatigue. Other failure modes include overheating due to inadequate oil cooling ~~and~~ blockages in the oil passages caused by contaminants or debris (Olabi et al., 2021; Scheu et al., 2019).

The generator converts the mechanical energy from the rotating blades into electrical energy. Generator failures may be attributed to either electrical or mechanical causes (Kang et al., 2019). Mechanical failure modes include rotor issues such as 420 eccentricity, broken rotor bars, cracked end rings, bearing deformation, and air gap eccentricity (Olabi et al., 2021). Electrical faults are mainly caused by winding faults, including open or short circuits in the rotor or stator windings, inter-turn shorts, and abnormalities in electrical connections (Olabi et al., 2021). Overheating and magnetization issues, such as inadequate magnetization or demagnetization of magnets, also lead to generator failures, adversely affecting their efficiency and service life (Scheu et al., 2019; Li et al., 2020a).

425 The blades ~~& and~~ hub capture the kinetic energy of wind and convert it into rotational motion to drive the generator through the gearbox. Common failure modes in blades include cracks, delamination, de-bonding on bonding lines, and damage to the top coat (Wang et al., 2022c). The hub, which connects the blades to the nacelle, may experience fatigue, wear, and imbalance (Zhang et al., 2016).

The failure modes of electrical and control systems can be categorized into electrical faults and mechanical failures. Electrical 430 faults typically include issues such as open circuits, short circuits, and gate drive circuit faults (Kang et al., 2019). On the mechanical side, common faults include corrosion caused by salt mist and moisture and damage to the terminals (Kang et al., 2017).

Pitch bearings are susceptible to wear and fatigue damage, typically affecting the raceways and rolling elements. Together with their drives, pitch bearings form the pitch system of a wind turbine. Blade pitching controls aerodynamic loads and serves as the primary safety mechanism of the turbine. Pitch drives can be either hydraulic or electrical, with both showing similar failure rates in operation (Walgern et al., 2023). Failure modes of pitch bearings include ring cracks, raceway, rolling elements, and-cage wear and fatigue, and bolt damage (Liu et al., 2020; Stammer et al., 2024).

Understanding these failure patterns is essential for guiding condition monitoring strategies. By ~~prioritising~~ prioritizing high-risk components like gearboxes and pitch systems, especially in offshore installations, operators can tailor diagnostic methods to improve reliability and reduce unexpected downtime.

3 Monitoring strategies focused on diagnostics

Wind turbine drivetrain monitoring has seen significant advancements through diverse analytical approaches (Helsen, 2021). An elaborate discussion on the diagnostic strategies is provided in this section. It highlights approaches such as ~~Artificial Intelligence and Machine Learning (AI/ML)-based~~ AI/ML-based monitoring using SCADA data, signal-processing techniques applied to high-frequency vibration data, and acoustic emission methods. These techniques detect anomalies, diagnose faults at early stages, and effectively inform maintenance strategies.

3.1 General aspects of AI/ML-based monitoring using SCADA data

Condition monitoring of wind turbines using SCADA data has been a productive research topic. The developments can be subdivided into several methodological groups. For thorough overviews, see, for example, Tautz-Weinert and Watson (2017), Stetco et al. (2019), Black et al. (2021) and Chatterjee and Dethlefs (2021). In Tautz-Weinert and Watson (2017), the methodologies are divided into six categories, e.g., normal behaviour model (NBM), trending, clustering, damage modelling, assessment of alarms, and expert systems. ~~The normal behaviour model (NBM)~~ NBM is currently the most popular method proposed in the literature. For this reason, the main focus will be on this method, while the other methods will be discussed only briefly.

3.1.1 Overview of normal behaviour modelling methods

Condition monitoring based on the NBM methodology ~~consists in general~~ generally consists of two phases: 1) developing a model that can be used to predict normal or healthy behaviour of the machine (this model is called the NBM) ; and 2) analyzing the prediction error, which is the difference between the observed and predicted data, for abnormal patterns and deviations. NBMs can be developed using various approaches, including statistical models, shallow ~~machine learning~~ ML, and deep learning. Table 1 gives an overview.

- ~~Statistical methods~~ Statistical methods

This is a group of models based on traditional statistical techniques. These can be unsupervised or supervised. The

Type	Methodology	References
	PCA <u>Principle component analysis (PCA)</u>	Campoverde et al. (2022) [MS], Kim et al. (2011) [GBX]
	OLS <u>Ordinary least squares (OLS)</u>	Garlick et al. (2009) [GBX, GEN], Chesterman et al. (2021) [GEN], Chesterman et al. (2022) [GEN]
Statistical	time <u>Time series</u>	Garlick et al. (2009) [GEN, GBX], Yang et al. (2018) [GBX], Li and Wu (2020) [GBX, GEN], Dao et al. (2018) [GBX], Sun et al. (2019) [GEN, GBX], Dao (2023) [GBX], Ali Qadri et al. (2020) [B], Xu et al. (2022) [B]
	RF <u>Random forest (RF)</u>	Turnbull et al. (2021) [GBX, GEN], Chesterman et al. (2022) [GBX], Kusiak and Verma (2012) [GEN]
Shallow ML	GBM <u>Gradient boosting machine (GBM)</u>	Beretta et al. (2021a) [MS], Beretta et al. (2021a) [MB], Shi et al. (2021) [GEN, GBX, H], Udo and Yar (2021) [GBX], (Maron et al., 2022) [GBX, CONV], Chesterman et al. (2022) [GBX], Kusiak and Verma (2012) [GEN], Udo and Yar (2021) [GEN], Trizoglou et al. (2021) [GEN]
	SVM <u>Support vector machine (SVM) / SVR</u>	Kusiak and Li (2011) [GEN], Gonzalez (2019), McKinnon et al. (2020) [GBX], Castellani et al. (2021) [GEN], Chesterman et al. (2022) [GBX]
	LASSO	Dienst and Beseler (2016) [O], Chesterman et al. (2023) [GEN, GBX]
	Deep NN <u>neural network (DNN)</u>	Zaher et al. (2009) [GBX, GEN], Kusiak and Li (2011) [GEN], Kusiak and Verma (2012) [GEN], Li et al. (2014) [GEN], Bangalore and Tjernberg (2014) [GBX], Bangalore and Tjernberg (2015) [GBX], Sun et al. (2016) [GBX], Meyer (2021) [GBX], Turnbull et al. (2021) [GBX], Black et al. (2022) [GBX], Jamil et al. (2022) [GBX], Mazidi et al. (2017) [P], Verma et al. (2022) [GBX]
Deep learning	Autoencoder	Zhao et al. (2018) [GBX, GEN, CONV], Beretta M. and J. (2020) [GEN], Renström et al. (2020) [GEN, R, H], Chen et al. (2021) [GEN], Miele et al. (2022) [GBX, GEN, T], Liu et al. (2023) [B], Lee et al. (2024b) [GBX]
	CNN <u>Convolutional neural network (CNN)</u>	Liu et al. (2020) [GBX], Zraggen et al. (2021) [GBX], Bermúdez et al. (2022) [GBX], Xiang et al. (2022) [GBX]
	LSTM <u>Long short-term memory (LSTM)</u>	Trizoglou et al. (2021) [GEN], Udo and Yar (2021) [GBX, GEN], Bermúdez et al. (2022) [GBX]
	GAN <u>Generative adversarial network (GAN)</u>	Peng et al. (2021) [B]
Ensemble		Beretta et al. (2021a) [MB], Khan et al. (2023) [GEN], Grataloup et al. (2024) [GBX]
	ANFIS <u>Adaptive neuro-fuzzy (ANFIS)</u>	Schlechtingen and Santos (2012) [GBX, CONV, H, O], Schlechtingen et al. (2013) [GBX, CONV, H, O], Schlechtingen and Santos (2014) [GBX, CONV, H, O]
Other	Copula	Zhongshan et al. (2018) [Y, GBX, GEN]
	ELM <u>Extreme learning machine (ELM)</u>	Marti-Puig et al. (2021) [GEN, GBX]

Table 1. Overview of the different methodologies that have been used in the literature to model normal behaviour. Abbreviations: GBX = gearbox, GEN = generator, B = blade, MS = main shaft, MB = main bearing, H = hydraulics, CONV = converter, R = rotor, T = transformer, P = pitch, O = other

465 advantage of statistical models is that they are in general computationally undemanding, data-efficient, ~~well-studied, and well-understood~~well studied, and well understood. The disadvantage is, however, that they are less suitable to model highly complex non-linear dynamics. Algorithms like ~~PCA, OLS~~principal component analysis, ordinary least squares, ARIMA and more recently ~~Cointegration~~cointegration have been/are popular. However, statistical techniques are used less frequently in recent research than ~~machine-learning~~ML techniques.

– ■~~Shallow machine learning methods~~Shallow ML methods

470 Models within this group are based on shallow ~~machine learning~~ML techniques, e.g., decision trees, ~~Random Forests (RF), Gradient Boosting Machines (GBM), Support Vector Machines~~random forests, gradient boosting machines, support vector machines (SVM), etc. Shallow ML techniques are generally better suited for modelling non-linear relationships. However, this comes at the cost of being more computationally expensive and having higher data requirements. The shallow ML algorithms were the most popular ~~up~~ until the deep learning breakthrough.

– ■~~Deep learning methods~~Deep learning methods

475 This category includes models based on deep learning algorithms, such as deep neural networks(~~DNNs~~), convolutional neural networks (CNNs), and ~~Long Short-Term Memory~~long short-term memory (LSTM) networks. The usage of deep learning is the most recent addition to the NBM development toolbox. Deep learning algorithms are even better modelers of non-linearities and have generated good results in several domains. However, they are often more computationally demanding and data-intensive than shallow ML. More recently generative AI, e.g., generative adversarial networks(~~GAN~~),
480 has been introduced. This technique was originally mainly used for the generation of new images(~~a.o. deepfakes~~). More recently, it has become clear that they are also useful for the generation of synthetic tabular data and anomaly detection.

– ■~~Ensemble methods~~Ensemble methods

This is a group of models that combines the output of multiple statistical, shallow ML, or deep learning algorithms. By combining the results of several algorithms~~it is attempted to improve the~~, ensemble methods attempt to improve
485 accuracy compared to the individual models. The ensemble methodology is generally composed of two layers. The first layer contains several algorithms that individually model the normal behaviour. The second layer is made up of an algorithm, called a meta-model, that combines the predictions of the models in the first layer. The meta-model can be a statistical, shallow ML ~~or~~ deep ML model.

– ■~~Other methods~~Other methods

490 ~~Next to the previous groups several~~ Several other methods have also occasionally been used. Examples are the adaptive neuro-fuzzy inference system(~~ANFIS~~), copula-based modelling, and extreme learning machines(~~ELM~~).

3.1.2 Alternative unsupervised/physics-based methods

The previous section focused exclusively on the NBM methodology. However, other methodologies have also been used, although less frequently. For this reason, they are only briefly discussed in this section. This overview is based on the

495 classification proposed by Tautz-Weinert and Watson (2017). The following methodologies (excluding NBM) are distinguished
in Tautz-Weinert and Watson (2017), ~~i.e.~~, trending, clustering, damage modelling, and assessment of alarms and expert
systems.

Trending techniques involve tracking long-term time-series SCADA data to identify patterns, trends, and anomalies that can
indicate potential faults or inefficiencies. The main challenge lies in interpreting trends due to varying operational conditions,
500 as changes in SCADA parameters do not always indicate faults. Several works have demonstrated how these techniques can
be used for anomaly and fault detection. For example, Feng et al. (2013) found that decreasing gearbox efficiency leads to
a temperature rise approximately six months before failure, while Wilkinson et al. (2014) explored comparing temperature
differences between turbines at the same site but found the approach unreliable due to environmental variations. Yang et al.
(2013) introduced a binning method averaging wind speed, generator speed, and power output to track damage levels. While
505 trending SCADA parameters can help detect failures by comparing historical and current data, interpretation challenges and
turbine-specific variability limit accuracy. Without addressing these issues, uncertainty and false alarms remain a risk in
maintenance applications (Black et al., 2021).

Clustering techniques are unsupervised ~~machine learning methods~~ ML methods that are used to group data points into
clusters based on their similarities or differences. They use distance metrics, such as Euclidean distance or cosine similarity,
510 to measure the similarity between data points. Clustering algorithms applied to SCADA data have been proposed for the
automated classification of normal and faulty observations by identifying patterns or distinct operational states representative
of potential anomalies or faults. For example, Wilkinson et al. (2014) applied self-organizing maps (~~SOMs~~) to classify turbine
operating conditions and detect anomalies in the gearbox. Rodriguez et al. (2023) proposed the k-means clustering algorithm
to perform an exploratory analysis of SCADA data to identify patterns and anomalies that can indicate potential faults or
515 abnormal behaviour which can then be ~~investigated further~~ further investigated by experts. More recently, Marti-Puig and
Núñez-Vilaplana (2024) introduced a novel approach to dynamically cluster wind turbines based on real-time SCADA signal
analysis, thereby accounting for temporal and operational variations. Unlike static approaches, this method proved to be more
adaptive and accurate in identifying performance trends and anomalies. However, research showed no clear advantage of
clustering over trending methods. Additionally, the requirement for faulty data in the methodology could pose a challenge in
520 an industrial setting (Tautz-Weinert and Watson, 2017).

In damage modelling the observed signals are interpreted using physical models of the machine or component. This is
different from the NBM approach where an empirical or data-driven method is used. ~~This technique has shown good results~~
~~(Tautz-Weinert and Watson, 2017). However, its applicability~~ However, the applicability of modelling-based methods depends
on the availability of a physical model.

525 Expert systems have also been used for wind turbine condition monitoring research. These systems can be used together
with NBM-based systems as a way to interpret the results (Tautz-Weinert and Watson, 2017). An expert system is composed
of several parts, e.g., a knowledge base, a reasoning or inference engine, and some sort of user interface through which experts
can interact with the AI. The knowledge base contains facts and rules, and the inference engine applies the rules to deduce
new facts or give an explanation or prediction. An advantage is that the rules are ~~in general~~, in general, easily interpretable.

530 Disadvantages are computational complexity and maintenance problems when the number of rules and facts become very large. Expert systems have been applied to wind turbine failure diagnosis cases, e.g., Zhi-Ling et al. (2012), Yang and Jiang (2015/05), Garcia et al. (2006).

3.1.3 Supervised learning ~~and farm-scale strategies~~: Overview of classifier-based modelling methods

~~■ Overview of classifier-based modelling methods (supervised learning)~~ In the categorization of ML, supervised learning
535 utilizes labelled datasets for training, aiming to approximate a mapping that predicts output labels based on input data. Supervised learning is further classified depending on whether the output labels are numerical variables (regression problems) or categorical variables (classification problems). When applied to wind turbine diagnostics, the classifier-based methods leverage an input vector composed of features extracted from pre-processed data collected from the component. The input vector is labelled with the categories reflecting the status of wind turbine components. Fault detection can be regarded as a
540 binary classification problem, where the system is categorized into one of two labels, i.e., "healthy" or "faulty". Fault diagnosis involves a multi-class classification task where the input label is classified into multiple non-overlapping classes encompassing specific faults/failures of the component. The model is subsequently trained to classify component status into the predefined categories.

Commonly used classifier-based methods for wind turbine diagnostics are ~~Support Vector Machine (SVM) (Tuerxun et al., 2021)~~
545 ~~k-Nearest Neighbor SVM (Tuerxun et al., 2021)~~, k-nearest neighbour (kNN) (Tang et al., 2023), ~~Logistic Regression (Bodla et al., 2016)~~
~~Artificial Neural Network~~ logistic regression (Bodla et al., 2016), artificial neural network (ANN) (Cho et al., 2021), Naïve naïve Bayes (Colone et al., 2019), ~~Decision Tree (Joshuva and Sugumaran, 2017)~~, ~~Extreme Gradient Boosting decision tree (Joshuva and Sugumaran, 2017)~~, extreme gradient boosting (XGBoost) (Tao et al., 2021), ~~Light Gradient Boosting Machine light gradient boosting machine~~ (LightGBM) (Wang et al., 2022a), ~~Random Forests (Mansouri et al., 2022)~~, eterandom forests
550 (Mansouri et al., 2022). Current research primarily focuses on improving conventional classifiers, developing ensemble methods that aggregate multiple learners, and utilizing deep learning to process high-dimensional data, enhancing data pre-processing and feature extraction techniques (Surucu et al., 2023; Stetco et al., 2019). Moreover, exploring the application of transfer learning and increasing model transparency, explainability, and interpretability are also critical endeavours (Zio, 2022; Lei et al., 2020). These efforts aim to improve the diagnostic performance of classifiers on real data from wind turbines.

555 The typical performance metrics of diagnostics include ~~Accuracy, Recall, Precision~~ accuracy, recall, precision, and F1-score, which are derived from the observations, including the number of ~~True Positive~~ true positive (TP), ~~False Positive~~ false positive (FP), ~~True Negative~~ true negative (TN), ~~False Negative and false negative~~ (FN) observations. Accuracy is calculated as:

$$\text{Accuracy} = \frac{TP + TN}{TP + TN + FP + FN} \quad (1)$$

The ~~Precision-recall~~ is calculated by:

560
$$\text{Recall} = \frac{TP}{TP + FN} \quad (2)$$

The ~~Recall~~precision is calculated by:

$$\text{Precision} = \frac{TP}{TP + FP} \quad (3)$$

The F1-score is calculated by:

$$F1 = \frac{2 * \text{Precision} * \text{Recall}}{\text{Precision} + \text{Recall}} = \frac{2 \times \text{Precision} \times \text{Recall}}{\text{Precision} + \text{Recall}} \quad (4)$$

565 The performance superiority of different classifiers is generally assessed through these metrics. However, classifier performance can vary across datasets due to factors such as class distribution, feature correlation, and dataset size. To systematically compare the performance of different classifiers, de Lima Munguba et al. (2024) tested and compared 16 classifiers for detecting pitch system faults, utilizing a dataset containing SCADA data and alarm logs ~~which are~~ collected from 14 wind turbines across two wind farms in Brazil. The results indicated that most classifiers achieve an average accuracy of 80% in distinguishing
570 between healthy and faulty operating modes. Among them, the ~~Random Forest, Extra Tree~~random forest, extra tree, XGBoost, LightGBM, CatBoost, ~~Gradient Boosting~~gradient boosting (GBoost), and kNN demonstrated superior performance. In the paper (Allal et al., 2024), the authors tested 13 classifiers by using a SCADA dataset originated from a ~~3-MW~~3 MW direct-drive turbine in Ireland. The type of wind turbine faults cover generator heating faults, mains ~~faults~~failure, feeding faults, air cooling faults, and excitation faults. The comparison results reveal that the best-performing classifier is the ensemble learner
575 based on bagging, achieving the highest accuracy, precision, recall, and F1-score at approximately 79%. This was followed by GBoost, with CatBoost, ~~Random Forest~~random forest, and XGBoost trailing behind. Building on these basic classifiers, researchers have continually innovated algorithms to improve performance. For instance, in the same paper (Allal et al., 2024), the authors proposed a two-tier fault detection and diagnosis framework. In binary classification, bagging achieved accuracy, precision, recall, and F1-scores exceeding 95%, outperforming the voting classifier and CatBoost. For multi-class classification,
580 the stacking ensemble learner demonstrated an overall precision of 86%, with accuracy, recall, and F1-scores all surpassing 84%, followed by ~~the Random Forest~~random forest and CatBoost.

■ ~~Comparing between turbines in the farm (detection and transfer learning)~~

3.1.4 Farm-scale strategies : Detection and transfer learning

Single-turbine models for condition monitoring provide tailored fault detection by aligning with each turbine's unique operational
585 profile, capturing faults specific to individual units. However, these models are computationally demanding in large farms, as each turbine requires its own model and frequent recalibration to address evolving conditions. Additionally, without cross-turbine comparisons, single-turbine models can struggle with environmental variability, increasing false positive or false negative rates. These limitations highlight the potential benefits of a comparative, multi-turbine approach, where analyzing performance deviations among turbines can enhance fault detection and provide a broader, context-aware perspective on turbine
590 health.

Comparative analysis of wind turbines within a farm using SCADA data offers a considerable advantage for condition monitoring, as identifying performance deviations among turbines can help operators detect anomalies early (Cambron et al.,

2018). However, this approach also presents challenges due to the unique operational signatures of each turbine, influenced by factors such as manufacturing variances, site-specific conditions, and individual wear patterns (Malik and Bak, 2024).
595 Differences in assembly processes can cause performance disparities even among turbines of the same model. Additionally, environmental influences, such as the wake effect, which results can result in variations in energy output and mechanical stress among turbines within the same farm. Exposure to differing levels of sunlight can also lead certain turbines to consistently operate at higher temperatures, a condition that reflects site specifics rather than equipment faults. Over time, wear and tear on components such as gearboxes, bearings, and blades further contribute to distinct performance profiles for each turbine.
600 These differences can complicate the establishment of performance baselines and the application of uniform diagnostic models throughout the farm. The challenge lies in balancing the need for standardized approaches with the need to customize to reflect the unique conditions of each turbine.

The signal trending approach examines long-term changes in operational data, assuming failures have identifiable signatures in variables like temperature. Astolfi et al. (2014) introduced a method tracking the relationship between binned active power and key sensor readings (e.g., rotor and generator bearing temperatures) to visualize turbine health over time and support early
605 fault detection. Cambron et al. (2018) advanced this with a control chart monitoring algorithm comparing turbine performance against the farm average to detect generator issues. In contrast, Li and Wu (2020) used median differences across turbines to create a condition vector, incorporating monitoring charts with strategies to handle autocorrelated data. However, these methods are often univariate, limiting their ability to capture interactions among variables within the complex, interconnected
610 systems of wind turbines. Even more, automated online monitoring based on trending methods has been shown to fall short of achieving the required accuracy. This limitation is attributed to the case-specific nature of the problem, which necessitates offline visual interpretation of trends. The challenge is further exacerbated when monitoring extensive wind farms operating under varying conditions. Clustering algorithms have been proposed as one potential approach to mitigate the limitations of trending methods.

615 Clustering-based anomaly detection offers several advantages for wind turbine condition monitoring. By grouping turbines based on similarities in their performance data, clustering enables the identification of outliers that may indicate faults. This approach provides a powerful framework for analyzing complex, high-dimensional data from wind farms. For example, distributing the wind turbines into peer clusters such that the wind turbines within each of the clusters have similar environmental conditions has been used in Lapira et al. (2014). This clustering enabled the identification of underperforming turbines within
620 each peer group using a predictive performance model. By analyzing the performance metrics of these underperforming turbines, a critical component was identified, and the end-of-life of the component was subsequently predicted. Additionally, ensemble approaches that integrate clustering with advanced algorithms, such as Isolation Forests-isolation forests applied at the farm-wide level, have demonstrated significant potential in detecting anomalies with improved precision (Beretta et al., 2021b). The high dimensionality and variability of SCADA data can complicate the clustering process, making it difficult to
625 ensure the meaningful separation of operational states. Additionally, the selection of appropriate clustering algorithms and the definition of similarity measures often require domain-specific knowledge, which may not generalize across different wind farms. Furthermore, clustering methods can be computationally intensive, particularly when applied to large-scale wind farms

with extensive data streams. The dynamic nature of turbine operations and environmental conditions also pose challenges, as clusters may need frequent updates to remain accurate and relevant. To address these challenges, NBMs have been proposed
630 in the literature as an effective alternative.

As mentioned in the previous section, NBMs are data-driven frameworks designed to predict the expected operational behaviour of wind turbines. When extended to include cross-turbine information, NBMs leverage data from multiple turbines to enhance condition monitoring by enabling comparative analysis across units with similar operating conditions. For example, Marti-Puig et al. (2022) use cross-turbine NBMs to detect failures by analyzing the temporal evolution of signals from several
635 SCADA systems belonging to geographically proximate turbines. By evaluating joint variations in these signals, the overall behaviour of the turbine assembly is assessed to identify deviations indicative of faults. Furthermore, Barnabei et al. (2024) introduce a framework that uses the ~~Meta-Predictive Power Score (MPPS)~~ meta-predictive power score to construct a fleet-wide similarity matrix, capturing operational similarities between turbines based on environmental data, operational metrics, and multivariate regression outcomes. By incorporating this similarity matrix into a community detection algorithm, the framework
640 identifies groups of turbines with similar behaviour. This approach transforms NBMs from a single-turbine tool into a fleet-wide monitoring solution.

Finally, transfer learning between turbines has emerged as a promising approach. Transfer learning involves using knowledge gained from one domain (source) to improve learning in another domain (target). This technique enables the application of models trained on data from certain turbines to others within the same farm or across different farms. For instance, a study by
645 Jamil et al. (2022) introduced a deep boosted transfer learning method for wind turbine gearbox fault detection. This approach prevents negative transfer by focusing on relevant information from the source machine, updating the weights of both source and target models to enhance fault detection accuracy. Similarly, Zraggen et al. (2021) explored transfer learning approaches for wind turbine fault detection using deep learning. Their research demonstrated that models trained on data from multiple turbines could be fine-tuned with minimal data from a target turbine, achieving performance comparable to models trained
650 solely on extensive target data.

3.1.5 Limitations and drawbacks of SCADA data for condition monitoring of wind turbines

While the use of SCADA data for condition monitoring offers notable economic and operational advantages, several inherent limitations and complexities must be considered. Wang et al. (2026) highlight the following key challenges:

1. Low sampling frequency: SCADA data is typically recorded at low sampling rates (e.g., 10-minute averages of 1
655 Hz data). This limits the ability to capture transient and dynamic phenomena, which are often critical for early fault detection.
2. Lack of standardization: The absence of a unified taxonomy for signal and parameter naming across SCADA systems complicates data integration and comparative analysis, hampering the development of generalized monitoring frameworks.

- 660 3. Data quality issues: Communication errors, sensor malfunctions, and environmental interference frequently result in noisy, incorrect, or missing data points. These anomalies introduce significant challenges for robust and reliable analysis.
4. Spatio-temporal correlations: The interdependencies between different SCADA signals necessitate the use of sophisticated models capable of capturing and interpreting these complex relationships.
- 665 5. Dynamic environmental conditions: Wind turbines operate under continuously changing environmental conditions, leading to highly dynamic SCADA data. Models must therefore adapt to and account for these evolving operational contexts.
6. Data heterogeneity: SCADA datasets often exhibit heterogeneity in time resolution, variable patterns, statistical properties, and signal scales or units. This variability complicates the application of uniform analytical approaches.
- 670 7. Data availability: Many organizations treat SCADA data as proprietary or confidential, restricting access and limiting the scope of research and validation efforts.
8. Uncertain ground truth: The ground truth for fault events is frequently ambiguous or unreliable due to inconsistencies in maintenance reporting and documentation, which can undermine the accuracy of fault detection and diagnostic models.

675 The limited sampling frequency of SCADA systems renders them less suitable for detecting sudden events, such as many electrical faults. Additionally, SCADA-based condition monitoring is less precise for identifying abnormal behavior in certain components, such as rotating bearings, when compared to vibration-based data (Astolfi et al., 2014). As highlighted by Pandit et al. (2023), condition monitoring approaches relying on SCADA data typically focus on secondary fault effects, such as abnormal component heating or reduced wind turbine performance.

680 A frequently overlooked issue in studies utilizing SCADA data for condition monitoring is the impact of dataset imbalance, as indicated by (Oliveira-Filho et al., 2025). These datasets are typically dominated by observations from healthy operational states, with comparatively fewer instances representing abnormal or degraded conditions. This disparity arises from the inherently high availability of wind turbines. The authors identify three distinct scenarios: (1) imbalance between healthy and degraded datasets, (2) imbalance among different degradation classes, and (3) imbalance due to the scarcity of degraded data points in

685 newly commissioned wind farms. Approaches that do not account for this imbalance may yield suboptimal results.

3.2 Signal processing for vibration-based ~~CM~~condition monitoring

Vibration-based condition monitoring of rotating components in wind turbines represents an effective and non-intrusive method for fault diagnosis. This approach enables efficient monitoring of the turbine's condition through advanced signal processing techniques by analyzing vibration signals generated by various rotating components, including the gearbox, bearings, generator,

690 and rotor blades. The application of advanced signal processing to vibration signals allows for early detection of faults, offering

insights into the overall health of the machinery while allowing for precise identification of specific components exhibiting anomalous behaviour.

Advanced signal processing methods are the key components of this approach, ~~employing analyzes~~ analyzing signals in the time, frequency, and time-frequency domains to identify fault-specific vibration signatures associated with defective components. Although advanced signal processing techniques such as angular signal resampling, spectral analysis, and envelope analysis are crucial for drivetrain condition monitoring, the first and key step is to properly measure the vibration signal.

This section focuses on advanced signal processing techniques for vibration-based condition monitoring of wind turbine drivetrains. It begins by outlining key aspects of data acquisition, specifically the sampling of high-frequency vibration signals from drivetrain components. Subsequently, a generic signal processing pipeline, with examples provided in (Koukoura et al., 2020), is presented, including speed variation compensation, signal pre-processing and processing, exploitation of cyclostationarity, and indicator estimation and trending. The section concludes with a discussion on emerging trends in signal processing for wind turbine drivetrain condition monitoring.

3.2.1 High-frequency vibration signals

As wind turbines increase in size, the rotational speed of the blade, and consequently the rotor, decreases, while gearboxes often amplify the rotational speed by up to 100. Hence, specific challenges arise for vibration signal acquisition. On the one hand, signals must be sampled over long enough durations to capture an adequate number of cycles from each component. On the other hand, the sampling rates must be sufficiently high to capture high-frequency bursts generated by defects on the rotating components (Randall and Antoni, 2011). For condition monitoring purposes, the typical highest frequency range is around 20 kHz, while the lowest range can go below 1Hz (Randall, 2021). Meeting these conditions requires the acquisition of long-duration signals at high sampling rates, which poses challenges related to data storage and the development of memory-efficient signal processing techniques for continuous monitoring of drivetrain health.

Another challenge is identifying the optimal placement of accelerometers to maximize the signal-to-noise (~~SNR~~) ratio during vibration sampling. Vibrations from all excitation sources within the system contribute to the recorded signal, and placing a sensor on one part of the machine does not prevent it from detecting vibrations originating from other components. Furthermore, its transfer path significantly influences the sampled signals (Randall, 2021). In a particular example, planetary gears, a typical stage in gearboxes of ~~non-direct-drive non-direct-drive~~ wind turbines, feature revolving components that alter the transfer path relative to the sensor's position over time. This variability introduces another challenge for signal processing, isolating the target signal by suppressing interference from extraneous vibrations.

3.2.2 Order tracking

Order tracking is a crucial pre-processing technique in vibration-based condition monitoring, particularly for wind turbines, where the rotational speed varies continuously. Speed variations can cause spectral leakage without order tracking, complicating fault detection unless statistical features in the time domain are used. This method transforms a non-stationary time-domain vibration signal into a stationary angular domain, ensuring that spectral content remains independent of speed fluctuations (Fyfe

and Munck, 1997). As a result, spectral peaks remain sharp and unaffected by speed variations, and the resampled signal's spectrum is represented in the order domain, the angular equivalent of frequency. Figure 4 displays an overlaid spectrum of original and angular resampled vibration signals to show the effect of order tracking.

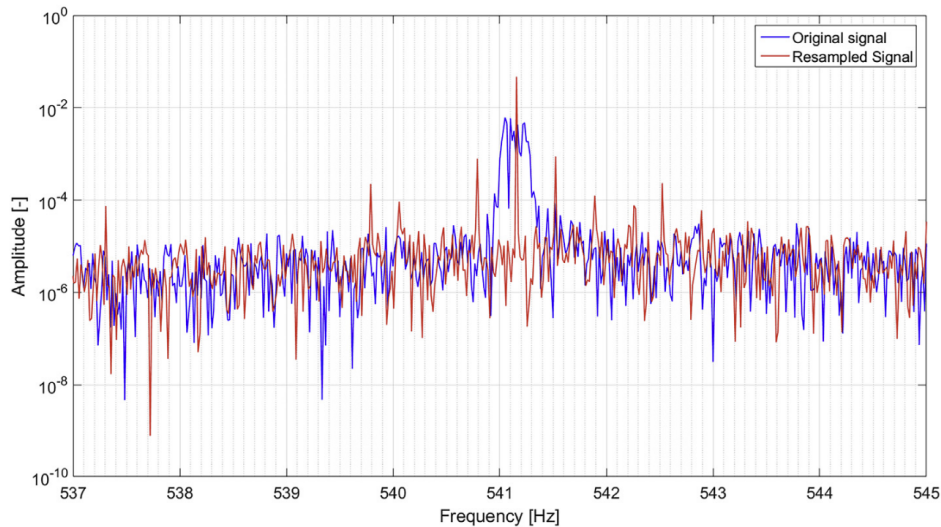


Figure 4. Zoomed spectra of original and angular resampled vibration signals measured from a wind turbine gearbox (reproduced from (Peeters et al., 2018b)).

Order tracking is a fundamental step in spectral analysis, enabling the accurate interpretation of vibration signals. However, it requires knowledge of the instantaneous rotational speed, typically obtained from a tachometer or estimated from vibration data. While wind turbine manufacturers often integrate tachometers into gearboxes, this is not always the case, particularly in direct-drive wind turbines. Various techniques for instantaneous angular speed (IAS) estimation from vibration signals have been proposed in the literature. One common approach involves time-frequency analysis to track dominant speed-synchronous peaks (Zimroz et al., 2011; Protopapadakis et al., 2025; Leclère et al., 2016; Peeters et al., 2017b), while another widely used method relies on phase demodulation of bandpass-filtered signals (Peeters et al., 2022; Boudraa et al., 2004; Peeters et al., 2018a). Peeters et al. (2019) provides a comprehensive review of IAS estimation techniques. Although these studies present general vibration-based IAS estimation methods, some research focuses explicitly on order tracking for wind turbine drivetrain condition monitoring (Peeters et al., 2017b).

For instance, He et al. (2016) introduced an instantaneous frequency estimation method followed by order tracking to enhance vibration spectra for wind turbine gearboxes under non-stationary conditions. By analyzing the time-frequency representation of vibration signals, the study successfully detected shaft misalignment in order-tracked spectra. Similarly, Jiang et al. (2016) proposed two IAS estimation methods—which are time-frequency ridge fusion and the logarithm scheme—where the estimated speed was used in order tracking to identify a faulty bearing in a wind turbine's planetary gearbox. Additionally, Hong et al. (2017) developed a tacho-less diagnostic technique that applies a fast dynamic time-warping algorithm to resample

gearbox acceleration signals, aligning a filtered shaft harmonic with a reference signal based on an estimated constant rotational speed. Validated through simulations and experimental data, this method enhances fault detection without requiring speed sensors, demonstrating its effectiveness in industrial applications.

Although order tracking itself is not a fault detection technique, it serves as a crucial ~~preprocessing step~~, pre-processing step and is often followed by spectral, envelope, or time-frequency analysis methods for effective condition monitoring.

3.2.3 Signal pre-processing techniques

Following angular resampling, signal editing or pre-processing constitutes an essential step in the signal processing pipeline for wind turbine drivetrain condition monitoring. This stage primarily aims to enhance the signal-to-noise ratio and reveal relevant information within the vibration signals. These techniques can be combined or employed alone, depending on the component's potential failure modes and the nature of the acquired signals.

■ Cepstral editing

Cepstral analysis, in essence, represents the spectrum of the vibration spectrum. It is a powerful tool for examining harmonic families and their sidebands within vibration spectra. This makes cepstral analysis a particularly valuable technique for monitoring wind turbine gearbox vibrations characterized by numerous harmonics and sidebands. The complex cepstrum of a signal is defined as the inverse Fourier transform of its logarithmic spectrum, expressed as follows:

$$C_r(\tau) = \mathcal{F}^{-1}(\ln(\mathcal{F}(x(t)))) \quad (5)$$

where \mathcal{F} and \mathcal{F}^{-1} represent Fourier and inverse Fourier transform. The free parameter τ denotes the *quefrency*, with its unit being second, of the cepstrum of the vibration signal $x(t)$. Two additional variations of the cepstrum are commonly defined: the power cepstrum and the real cepstrum. The power cepstrum is derived by squaring the magnitude of the signal's spectrum and then applying the Fourier transform (Randall, 2017). Alternatively, the average power cepstrum can be estimated through Welch-averaging techniques. The real cepstrum, on the other hand, is obtained by extracting the real part of the complex cepstrum, effectively disregarding the phase information of the signal (Randall, 2017).

Cepstral editing is a powerful, indirect method for monitoring component conditions. In this technique, vibration signals are processed in the cepstral domain (using a method called liftering, which is similar to filtering) to remove first-order cyclostationary components within specific quefrency ranges, as shown in Peeters et al. (2017a). This process, known as signal pre-whitening, ensures that strong first-order cyclostationary (CS1) components do not hide important second-order cyclostationary details, thus improving diagnostics. Another use of cepstral methods is detailed in Randall et al. (2022), where comb-liftering is applied to the cepstra. This removes the effects of varying operating conditions from the vibration spectra, allowing for more precise identification of gear meshing frequency amplitudes and enabling the tracking of gear tooth fault deterioration. Cepstral editing is also an effective tool for detecting and suppressing harmonics from the signal spectrum, which is essential for performing modal analysis used to assess the fatigue life of wind turbine components. (Daems et al., 2022; Gioia et al., 2019a, b).

■ Signal filtering

The drivetrain of a wind turbine consists of a large number of components. As a result, vibration signals measured from the drivetrain are combinations of excitations from many sources. Generally, CS1 vibrations, such as gear meshing, dominate and can mask second-order contributions. Moreover, bearings, the most frequently failing rotating component type in a wind turbine drivetrain (NRE, 2016), exhibit pseudo-cyclostationary behaviour likely to be buried in the noise floor of the vibration spectrum.

An efficient way to reveal fault-related second-order cyclostationary (CS2) structures is by filtering the signal around the carrier frequency of the CS2 structure. The literature provides predefined filtering approaches that can reveal fault signatures without requiring knowledge or estimation of the fault's carrier frequency, an example of which is shown by Antoni (2007b). However, these approaches may not fully capture the fault carrier, particularly for cyclostationarity with multi-band excitation. Signal-specific adaptive filter optimization algorithms have been proposed to address this issue. These can be broadly categorized into two types: 1) those that exploit machine kinematic information for the optimization problem and 2) those that operate blindly without requiring any kinematic information about the machine.

Non-blind adaptive filter optimization algorithms typically aim to enhance a statistical feature occurring at a known characteristic fault frequency. Notable examples include Maximum Correlated Kurtosis Deconvolution (~~MCKD~~) (McDonald et al., 2012) and Multipoint Optimal Minimum Entropy Deconvolution Adjustment (~~MOMEDA~~) (McDonald and Zhao, 2017). In addition to statistical features, Buzzoni et al. (2018) proposed leveraging first- and higher-order cyclostationary components, targeting characteristic frequencies in the squared-envelope spectrum. These methods use prior knowledge of machine fault frequencies to optimize filters that highlight fault-related vibration signatures.

In contrast, blind approaches aim to extract fault information without relying on kinematic data, making them valuable when such information is unavailable or limited. Recent work has advanced blind optimization by focusing on time-domain representations of vibration signals (Li et al., 2012; Jiang et al., 2018). Further developments have improved filter performance by promoting sparsity in the squared-envelope spectrum (Peeters et al., 2020b; Wang et al., 2021a). An enhanced sparsity-based blind filtering method was also applied to wind turbine gearbox vibrations, demonstrating its practical effectiveness for condition monitoring (Kestel et al., 2023). Given the complex nature of wind turbine drivetrains, which often generate CS1 signals, blind methods targeting second-order cyclostationarity may be less effective. Therefore, removing CS1 components can significantly improve diagnostic performance. Figure 5 shows the use of blind filters for fault detection in a wind turbine gearbox. By applying blind filters to different frequency bands of the vibration signal and maximizing sparsity in the squared-envelope spectrum, a defective bearing in the high-speed shaft was identified. This diagnosis was later confirmed through a boroscopic inspection.

■ ~~Time-synchronous~~ Time-synchronous averaging and decomposition

Time-synchronous averaging (TSA) is a technique that isolates periodic waveforms from noisy data, making it particularly useful for gearbox diagnostics in wind turbine drivetrains. By segregating the vibration signal of a specific gear from unrelated noise and vibrations from other components, TSA enhances the condition monitoring process (Bechhoefer

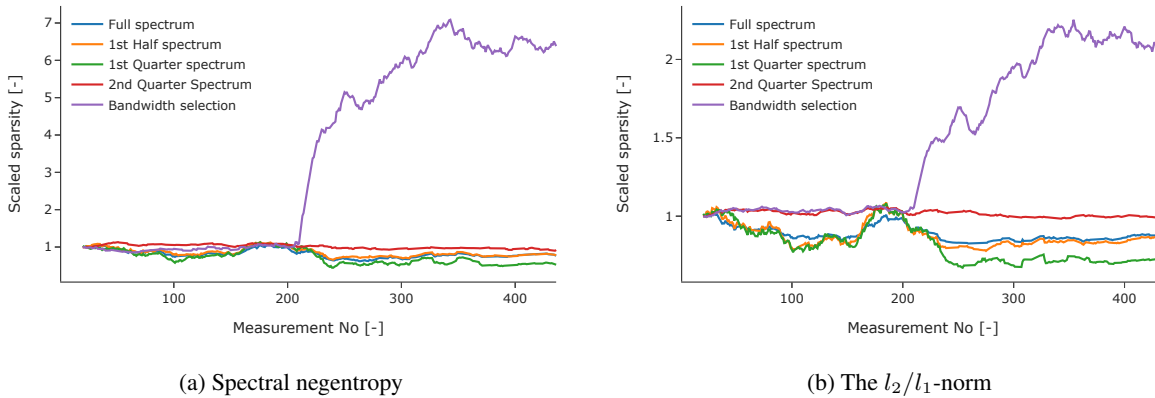


Figure 5. The evolution of the sparsity indicators on the ~~blind-filtered-blind-filtered~~ signals measured from gearbox of an offshore wind turbine. It demonstrates ~~blind-filtering-blind-filtering~~ different bandwidths of signal to maximize the sparsity of the squared-envelope spectrum. The automated bandwidth selection enables fault detection via blind filters. (reproduced from (Kestel et al., 2023)).

810 and Kingsley, 2009). Moreover, it compensates for shaft speed fluctuations, preventing spectral energy from overlapping with adjacent gear mesh frequency bins. TSA application necessitates a signal synchronized with the angular position of the shaft, which can be achieved by employing a tachometer. Alternatively, phase information can be extracted from gear mesh frequencies to estimate instantaneous angular speed from the acceleration signal, as detailed by Combet and Gelman (2007).

815 Sawalhi et al. (2014) utilized TSA to extract a residual signal containing the stochastic vibration signature associated with bearing faults in wind turbine gearboxes. Their study focused on analyzing the envelope spectrum of residual signals from a high-speed shaft bearing, and they also examined averaged signals from the sun gear, ring gear, and planetary gears for fault detection. In a subsequent study, Bajric et al. (2016) applied TSA to isolate the residual signal and then employed a discrete wavelet transform to identify a gear tooth fault in a wind turbine gearbox. Addressing some limitations of
 820 conventional TSA, Ha et al. (2016) proposed an enhanced autocorrelation-based ~~time-synchronous-averaging (ATSA)~~ TSA method for diagnosing planet gear faults in wind turbine gearboxes. This technique utilizes an autocorrelation function that captures the physical interactions among the ring, sun, and planet gears to optimize TSA parameters. This improves accuracy and efficiency in fault diagnosis, especially when stationary data are scarce. Furthermore, Yoon et al. (2016) employed Welch’s spectral averaging on segmented vibration signals, with segments defined according to
 825 the angular positions of individual components within a planetary gearbox. Their work demonstrated that this method effectively isolates the vibration signals of specific components, such as the planetary gears, from the overall system response.

~~Time-Synchronous-Averaging~~ TSA algorithms are commonly employed to isolate vibrations from specific components, particularly planetary gears. However, fault detection in planetary gears and their bearings remains challenging due

830 to the varying positional relationship between these components and the accelerometers over time. Detecting early-stage faults in planetary gears is particularly difficult, and identifying bearing faults is even more challenging, as their vibration signatures are inherently weak due to their pseudo-second-order cyclostationary nature. D'Elia et al. (2017) proposed a method to extract vibrations emitted by planetary gears by leveraging their relative position with respect to the transducer. In the absence of a tachometer, they estimated this relative position directly from the vibration signal.

835 Bearing fault detection was performed on these isolated signals before applying TSA, while TSA was subsequently used to detect an artificially induced tooth fault in one of the planetary gears. Similarly, Ha et al. (2017) demonstrated a method for isolating planetary and sun gear vibrations for fault detection. Their study emphasized the limitations of traditional envelope analysis in such applications and introduced a toothwise fault identification approach for planetary gearboxes.

840 Recent advances in signal decomposition techniques have further improved fault detection in planetary gearbox components (Peeters et al., 2024). While these methods do not explicitly aim to isolate vibrations from specific components, the decomposed signal components potentially converge to such signal components. One notable example of these signal decomposition techniques is ~~Intrinsic Time-Scale Decomposition (ITD)~~intrinsic time-scale decomposition. Feng et al. (2016) addressed the challenges of planetary gearbox fault diagnosis by proposing a joint amplitude and frequency demodulation analysis

845 method based on ~~ITD~~intrinsic time-scale decomposition. Simulation and experimental validation demonstrated its effectiveness in diagnosing localized faults in sun, planet, and ring gears. Pan et al. (2021) introduced a novel ~~Nonlinear Sparse Mode Decomposition (NSMD)~~non-linear sparse mode decomposition method to overcome the limitations of traditional time-frequency-based decomposition techniques, which often struggle with noise, enhancing the adaptability and robustness of signal decomposition. Both simulation and experimental results confirmed its efficacy in fault detection for planetary

850 gearbox fault detection. Further advances include the ~~Variational Nonlinear Component Decomposition (VNCD)~~variational non-linear component decomposition method introduced by Wei et al. (2022) to enhance fault diagnosis under variable speed conditions.

■ Discrete/random separation

Another effective pre-processing approach for extracting the vibration component of interest involves discrete/random

855 separation (DRS) algorithms. Vibration signals inherently consist of two distinct parts: a predictable part, dominated by cyclostationary components, and a random component primarily attributed to noise. The ability to effectively separate these two constituents can significantly augment the performance of downstream signal processing techniques. Specifically, DRS techniques identify and isolate the coherent structures within the vibration signals, which represent the predictable part, allowing for the estimation of the remaining random component. This frequency-domain operation offers a relative

860 speed advantage when compared to its time-domain counterparts such as self-adaptive ~~noise-canceled~~noise-cancelling or linear prediction (Randall et al., 2011). The utility of DRS on signals exhibiting speed fluctuation has been shown by Borghesani et al. (2012). Moreover, an improved version, ~~Multi-delay~~multi-delay DRS, was later proposed by Peeters et al. (2020a), who also showcased its performance and impact on fault detection in a wind turbine gearbox.

This section ~~summarizes~~ has summarized various signal editing and pre-processing techniques that are crucial for subsequent signal processing stages, ultimately leading to indicator estimation. Users must apply one or a combination of these methods to effectively reveal fault information embedded within vibration signals.

3.2.4 Cyclostationarity in drivetrain vibrations

After the vibration signals undergo ~~preprocessing, with specific steps applied according to the expected failure mode, the~~ pre-processing, the analysis typically proceeds to investigate their cyclostationary properties. For condition monitoring applications, comprehending the signal signatures from healthy and faulty drivetrain states is a vital stage of signal processing. While the vibration signatures vary among drivetrain components (e.g., blades produce different vibrations than generator bearings), these signals are classified as cyclostationary. This classification ~~named from their~~ is named from signals' inherent property of exhibiting an underlying periodicity in the temporal flow of energy (Antoni, 2009), a characteristic prevalent in rotating mechanical systems.

Cyclostationary signals cover a wide range of statistical features and are classified ~~concerning~~ with respect to their orders. Generally, cyclostationarity up to the second order is prevalent in vibration signals from rotating machines, and higher orders are typically not of interest for condition monitoring. However, some studies explore the potential to utilize higher orders of cyclostationarity for condition monitoring of rotating machines (Raad et al., 2008). By definition, an n-th order cyclostationary signal exhibits periodicity in its n-th order moment (Antoni et al., 2004). The first-order cyclostationarity represents the simplest form, where the first moment is periodic. In other words, purely first-order cyclostationary signals have a constant periodic mean. First-order cyclostationary signals can arise from gear meshing, shaft imbalances, or misalignments, and they typically produce prominent peaks in vibration spectra ~~Antoni et al. (2004)~~ (Antoni et al., 2004). As expected, CS2 signals have a second moment that remains constant over periods, or their auto-correlation function is periodic (Antoni et al., 2004). Examples of drivetrain components that emit CS2 signals include bearings and blades with high aeroacoustic noise. The term pseudo-cyclostationarity, introduced by Antoni and Randall (2002), describes a specific type of cyclostationarity generated by roller element bearings. This term refers to motions where the cyclic behaviour is not strictly periodic, but the bursts forming cyclostationary signals slightly deviate from the expected repetition frequency.

Since the dominant vibration emitted by rotating drivetrain components exhibits cyclostationary characteristics, signal processing techniques designed to handle cyclostationarity are widely used in drivetrain condition monitoring, such as envelope analysis.

The envelope analysis begins with high-pass or bandpass filtering to isolate the high-frequency components where fault-induced modulations occur, hence removing low-frequency machine vibrations and background noise. The filtered signal is then demodulated to obtain its envelope, which contains information on faults near their theoretical frequencies (Antoni, 2009). Focusing on amplitude modulations rather than raw vibration data provides a more explicit spectrum, reducing noise interference and improving diagnostic accuracy. However, determining the optimal band-pass or high-pass filter settings remains a challenge. The literature discusses predefined and adaptive filtering techniques and correlation maps, which provide

carrier frequency information (Randall et al., 2001). Despite its widespread use, envelope analysis requires extensive pre-processing to reveal fault signatures effectively.

Second-order cyclostationary signals exhibit periodic second-order statistics characterized by periodic autocorrelation functions. 900 A typical example is the vibration signal from a rolling element bearing fault, such as a crack in a raceway, which generates impulses convolved with the structure's resonance frequency. The envelope spectrum is traditionally obtained via the Fourier transform of the envelope, estimated from the analytic signal. Alternatively, spectral correlation provides a method to compute the envelope spectrum (Randall et al., 2001), referred to as the enhanced envelope spectrum.

Randall et al. (2001) investigated spectral correlation density maps for diagnosing bearing faults using experimental vibration 905 signals. Their findings suggest that 2D spectral correlation density maps reveal bearing fault frequencies in the discrete cyclic frequency domain. Additionally, the study introduced the enhanced envelope spectrum derived by integrating spectral correlation density maps over the continuous carrier frequency domain. The authors also demonstrated that spectral correlation density maps assist in determining optimal band-pass filter frequencies to highlight modulations in vibration signals from complex machinery.

Several spectral correlation estimation methods have been extensively studied and compared by Antoni (2007a). While 910 cyclic spectral analysis provides deeper insights into vibration signals, it is not significantly more complex than conventional spectral analysis. However, a significant drawback is estimating the discrete modulation frequency α up to an unknown upper limit, which is computationally intensive (Randall et al., 2001; Borghesani and Antoni, 2018). To mitigate this, a fast algorithm employing the short-time Fourier transform has been proposed for spectral correlation or coherence map estimation (Antoni 915 et al., 2017).

3.2.5 Indicator estimation

Following the previous signal processing operations, a range of health indicators is extracted from vibration data as the next 920 step. These include statistical features in the time domain and spectral features in the frequency domain, which are commonly employed to monitor specific kinematic elements of rotating machinery. However, as highlighted in recent research (Antoni and Borghesani, 2019), no single indicator can effectively detect all types of faults in such systems. As a result, multiple indicators are computed to improve the coverage of fault detection. To capture signal characteristics across various frequency bands, filtering techniques are applied, enabling the estimation of statistical parameters from both the deterministic and stochastic components of the signal. Spectral features are derived from both the signal and envelope spectra.

In this context, [Antoni and Borghesani \(2019\)](#); [Antoni et al. \(2024\)](#); [Antoni and Borghesani \(2019\)](#) and [Antoni et al. \(2024\)](#) 925 introduced a statistical approach to systematically construct indicators that target specific characteristics in the time and frequency domains. Additionally, a framework for designing new statistical indicators aimed at early fault detection has been proposed (Antoni et al., 2024). This work also reviews commonly used indicators in condition monitoring and links conventional health indicators to actual component degradation mechanisms. Apart from the statistical indicators, fault detection also leverages indicators derived from spectra or cepstra. For instance, several cepstral indicators have proven effective in 930 detecting gear tooth faults (El Badaoui et al., 2001, 2004). While the evolution of harmonic families can be traced in signal

or envelope spectra, monitoring their transformation into the cepstral domain offers a more straightforward approach (Siegel et al., 2014).

Given the complex structure of modern wind turbines, which contain numerous rotating elements, a wide range of characteristic frequencies must be monitored. These health indicators are further organized according to different operational and environmental contexts to enable more accurate trend analysis, as their behaviour is influenced by such conditions. Consequently, each vibration measurement generates a large volume of indicators, making manual expert evaluation highly resource-intensive (Helsen et al., 2017a). This issue is compounded by the continuous generation of such indicators across all turbines in a fleet, significantly increasing the complexity of condition monitoring tasks (Helsen et al., 2017a). To address this challenge, a practical approach involves integrating health indicators with contextual data to form composite, high-level features that better represent the turbine's condition (Jamil et al., 2024).

3.2.6 Emerging signal processing techniques

Advancements in technology have enabled innovative data acquisition and signal processing methods for condition monitoring. One emerging approach involves analyzing vibration signals derived from video recordings. Initially, video frames were utilized for performing modal analysis (Wang et al., 2022d). With improvements in camera sampling rates and the availability of larger storage capacities, it is now feasible to capture high-frequency data, even using smartphone cameras (Natili et al., 2020; André et al., 2021). These advancements have allowed applications such as instantaneous rotational speed estimation from video-based vibration data. Moreover, recent studies have demonstrated the feasibility of diagnosing faults in rotating machinery directly from high-speed video frames (Leclère et al., 2025).

3.3 Acoustic ~~Emission Methods~~ emission methods

Monitoring structure-borne sound, also known as ~~Acoustic Emission (AE)~~ acoustic emission (AE), is a non-invasive method for monitoring the dynamic reactions of a material under load or environmental influence. The method is characterized by its sensitivity to defect growth and changes within the material during material degradation. Therefore, it is suitable for the detection of damage precursors and damage at a microscopic stage. Real-time monitoring makes it possible to analyze the growth of inhomogeneities, for example, in the form of degradation processes under load. The frequency range of the ~~AE~~ AE signal varies depending on the application and is 20 kHz--2 MHz (Deutsches Institut für Normung e.V., 2011). The practical implementation of real-time capability in the condition monitoring system places high demands on the signal processing hardware and data processing software due to the large volumes of data and the complexity of the ~~AE~~ AE signals.

3.3.1 Physical principle

According to DIN EN 13554, the physical phenomenon of structure-borne sound is characterized by “transient elastic waves within a material” (Deutsches Institut für Normung e.V., 2011). The loading of material by external forces or environmental conditions generates structure-borne sound, for example, caused by “local plastic deformation, crack growth and friction”

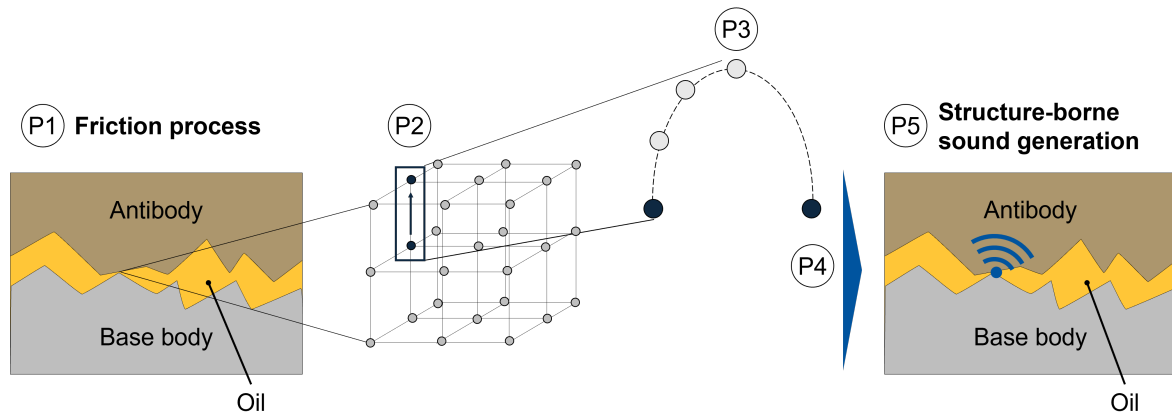


Figure 6. Schematic representation of the generation of acoustic emission through friction (Mokhtari, 2020).

(Deutsches Institut für Normung e.V., 2011). The resulting elastic waves propagate in the material or neighbouring fluids. In the following, the elastic waves are called structure-borne sound waves. Structure-borne sound waves contain information about the processes, for example, such as wear processes, within the material. The molecular lattice theory can explain the generation of structure-borne sound through friction, as shown in Fig. 6 (Deutsches Institut für Normung e.V., 2011; Mokhtari, 2020).

For the explanation, a frictional process between the base and counter body (P1), in the form of a shaft and journal bearing, is considered as an example. The friction process causes a material molecule to change from stable to unstable (P2). The energy is added up during friction until a limit value (P3) is exceeded. The molecule is then transferred to the stable initial state (P4). During the transition from the unstable state (P3) to the stable state (P4), part of the stored energy is released as a structure-borne sound wave from the inside of the material to the surface (P5) (Mokhtari, 2020).

In addition to detecting friction states, according to Hase (2020), inevitable friction and wear phenomena can be detected depending on the frequency range, as shown in Fig. 7. In the diagram, the amplitude is qualitatively assigned to various causes. A quantitative statement is impossible due to many factors influencing the AE-AE signal, such as the measurement system and conditions. Characterizing individual phenomena based on a frequency range mainly depends on the test conditions. Research focusing on the early detection of fatigue damage using the AE-AE technique has shown that fatigue damage in the rolling element bearing raceway surface can be detected from AE-AE signal components in the frequency range of approximately 0.15 to 0.4 MHz (Hase, 2020). Accordingly, peaks observed in this frequency region are considered to be associated with the occurrence of flaking. However, interpreting AE-AE signals solely based on their frequency range remains challenging. Numerous damage mechanisms may overlap within the same frequency band, making it difficult to distinguish between them clearly. Moreover, amplitude-based indicators are often unsuitable, as the signal transmission path, sensor characteristics and the measurement setup significantly influence them.

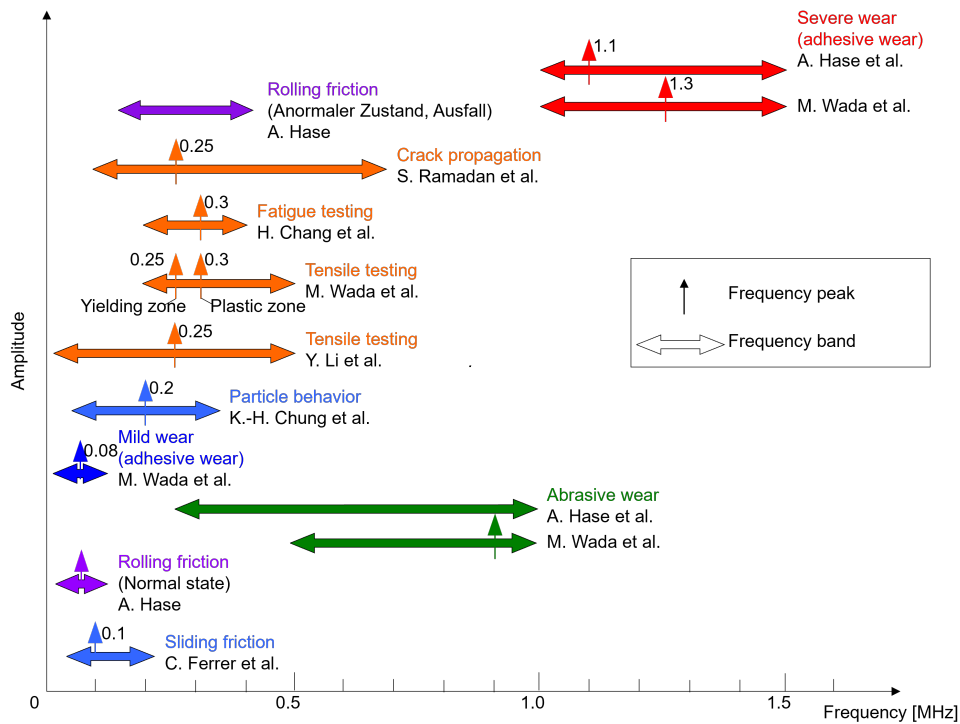


Figure 7. Correlation between AE-AE signals and signs of friction and wear as a function of signal amplitude and frequency (Hase, 2020).

3.3.2 Signal Characteristics

In the 1950s and throughout the 20th century, research in the field of monitoring systems was characterized by the fact that the performance of these systems was severely limited. For example, continuous recording of AE-AE signals over a long period required disproportionate effort. For this reason, the AE-AE signals were reduced to a few parameters for storage. At the beginning of AE-AE technology, the recording was carried out using analogue methods so that only easily measurable parameters could be recorded, and the approach of reducing a signal to characteristic parameters is known as the parameterized approach (Auerswald, 2016). The characteristic parameters of a transient signal are shown in Fig. 8 using the terms commonly used in the literature.

A hit corresponds to the detection of an AE-AE event and is characterized by the occurrence and decay of a structure-borne sound wave. The number of hits per time unit is suitable for evaluating the machine status. A hit begins when a predefined limit value is exceeded for the first time and ends when the limit value is exceeded for the last time. Counts define the number of times the limit value is exceeded during a hit. The amplitude describes the maximum signal level that occurs, which depends on various factors such as the sensor, the coupling between the sensor and the measurement object, and the distance of the sensor to the signal source. The period of a hit is referred to as the duration. The rise time corresponds to the period between

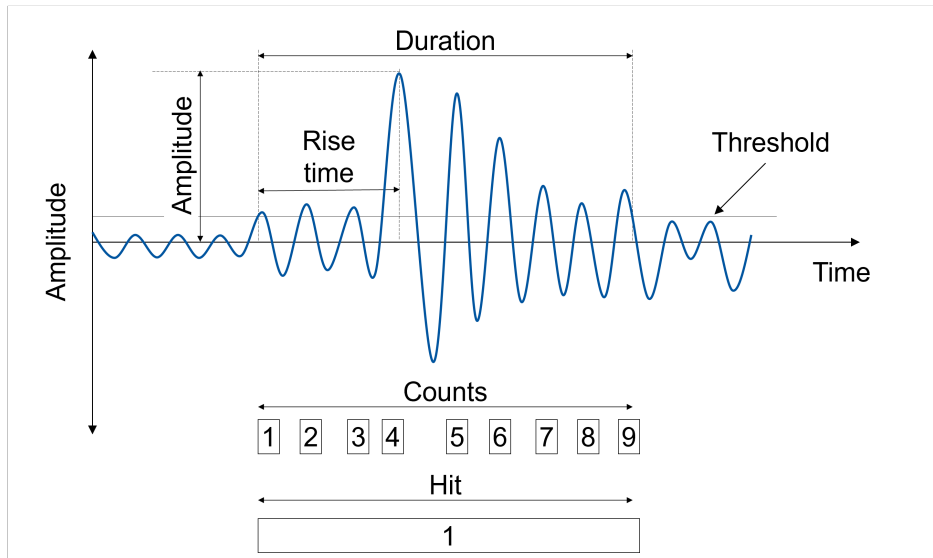


Figure 8. Signal characteristics of ~~AE~~-~~AE~~ signals.

the first time the limit value is exceeded and the maximum signal amplitude (Auerswald, 2016).

Other parameters, such as the energy content of a hit, are not displayed. The parameterized evaluation includes a large number of statistical parameters that can be extracted from a signal. These include the ~~root-mean-square (RMS)~~-~~root-mean-square (RMS)~~ value, the standard deviation, and the kurtosis value (Vraetz, 2018).

3.3.3 ~~Data analysis~~

Compared with traditional vibration ~~analyses~~-~~AE analyzes~~-~~AE~~ technology can obtain valuable information about the condition of a measurement object in the preliminary and early stages of damage. However, the evaluation of the data poses a particular challenge. ~~AE-AE~~ signals frequently have a low amplitude (in the ~~micro~~-~~microvolt~~ to millivolt range) and are overlaid by ambient noise, necessitating specialized methods for separating relevant events from noise in the ~~AE-AE~~ signal. The following ~~sections will~~-~~subsections~~ present time domain analysis, frequency domain analysis and time-frequency domain analysis.

■ ~~Time domain~~

3.3.3 ~~Data analysis: Time domain~~

The evaluation of measurement signals in the time domain is typically predicated on two fundamental principles: the signal progression over time and the analysis of distinctive characteristics. A general distinction between dynamic time signal analysis and time trend analysis can be made. Dynamic time signal analysis is particularly ~~well-suited~~-~~well suited~~ to the assessment of short-term behaviour, for example, in the form of burst events. An integral component of this analysis is statistical feature

extraction, in which a range of parameters is calculated to characterize the signal. These include the mean value and the variance, which provide fundamental information about the signal level and its dispersion. The RMS-RMS value is another key parameter, as it allows for information about the energy of the signal and correlates with the mechanical load on the bearing. The crest factor is also essential, as it describes the relationship between the peak value and the RMS-RMS value, and high crest factors indicate impulse-like disturbances that can be caused by developing damage. Furthermore, kurtosis can be utilized to identify non-stationary surge signals, as it exhibits sensitivity to outliers in the signal. The time trend analysis is employed to assess the long-term behaviour of the signal curve, for example, with the help of the envelope curve analysis, which is particularly useful for identifying repetitive pulse patterns (Mokhtari, 2020; Klein, 2008).

■ Frequency domain

3.3.4 Data analysis: Frequency domain

The transformation of a time domain signal into the frequency domain enables the detection of recurring structures and modulation patterns, which can be utilized to diagnose journal and rolling element bearing damage. The fast Fourier transformation (FFT) is the most prevalent method for decomposing an AE-AE signal into its frequency components. The subsequent frequency analysis of the signal facilitates the classification of its frequency components and, by extension, their attribution to either critical operating conditions or specific damage (Hoffmann and Wolff, 2014; Kolerus and Becker, 2022).

Rolling element bearing

In rolling element bearings, only a fraction of the race is in contact with a rolling element (and therefore under load) at any given time. At a specific point on the race, the load is oscillating at a frequency dependent on the shaft's rotational frequency. Since initialization and growth of faults occur under load, monitoring the over-rolling frequencies allows for the detection of damages with AE-AE. For rolling element bearings, the over-rolling frequencies are listed as follows:

1. BPFO : Ball pass frequency outer race

$$BPFO = \frac{n_B f_r}{2} \left(1 - \frac{d_B}{d_m} \cos \phi \right), \quad (6)$$

2. BRFI: Ball pass frequency inner race

$$BRFI = \frac{n_B f_r}{2} \left(1 + \frac{d_B}{d_m} \cos \phi \right), \quad (7)$$

3. Cage speed or FTF: Fundamental train frequency

$$FTF = \frac{f_r}{2} \left(1 - \frac{d_B}{d_m} \cos \phi \right), \quad (8)$$

4. BSF: Ball spin frequency

$$BSF = \frac{d_m}{2d_B} \left(1 - \left(\frac{d_B}{d_m} \cos \phi \right)^2 \right), \quad (9)$$

where n_B is the number of rolling elements, f_r is the shaft speed, d_B is the diameter of a rolling element, d_m is the pitch diameter and ϕ is the angle of the load from the radial plane (Randall and Antoni, 2011). These equations are derived assuming a stationary outer ring, which represents the most common bearing configuration. However, in scenarios where both the inner and outer rings rotate, such as bearings supporting planet gears in planetary gearboxes, these equations require appropriate
1045 modification-~~(Howard, 1994)~~ [\(Howard, 1994\)](#).

These characteristic frequencies, which depend on the shaft speed, are typically lower than 20 kHz. An increased amplitude at one of these frequencies hints at a fault, and when that frequency corresponds to a specific machine element, the fault can be precisely localized. While these characteristic frequencies often do not appear in the raw ~~AE-AE~~ [AE-AE](#) signal, the envelope of the signal (e.g., magnitude of the analytic signal) contains them, enabling ~~AE-based~~ [AE-based](#) fault detection using established
1050 frequency-analysis methods like order analysis (Elasha et al., 2017; Bechhoefer et al., 2013).

~~Journal bearing-~~

In contradistinction to rolling element bearings, the manifestation of damage in journal bearings is less evident in periodic shock pulses than in rolling element bearings. The manifestation of damage is evident in alterations to tribological behaviour and the lubricating film.

1055 Time-frequency methods can be used as an alternative to conventional spectral analysis to improve the diagnosis of non-stationary signal characteristics. These methods are particularly suited for capturing dynamic changes in frequency components due to varying lubrication conditions ~~König et al. (2021a, b)~~ [\(König et al., 2021a, b\)](#). This is because the frequency components are often not constant and the lubrication condition can change dynamically.

~~■Time-frequency domain-~~

1060 3.3.5 [Data analysis: Time-frequency domain](#)

Bearing damage often generates non-stationary signals, which is why a pure frequency analysis is usually insufficient to capture all the dynamics of the signal. Time-frequency analysis combines both domains and enables a detailed investigation of signal changes over time. One possibility is to use the short-time Fourier transform (STFT). With the STFT, the signal is divided into time windows to create a local frequency analysis. One disadvantage of the STFT is the constant window size, which requires
1065 a compromise between frequency and time resolution. A longer time window leads to better frequency resolution with poorer time resolution. In contrast, a shorter time window leads to better time resolution and poorer frequency resolution. Wavelet analysis uses an alternative segmentation technique and allows variable window sizes. In wavelet analysis, longer time intervals are used to analyze low-frequency information, while shorter time intervals are used for high-frequency details. This allows the signal's low-frequency and high-frequency parts to be examined at different times and frequency resolutions (Kolerus and
1070 Becker, 2022; Puente León, 2013).

~~Journal bearing-Journal-~~

[Journal](#) bearings generate highly non-stationary ~~AE-AE~~ [AE-AE](#) signals as they have been studied on component test rigs that try to mimic critical conditions of planetary gearbox journal bearings. The non-stationary ~~AE-AE~~ [AE-AE](#) signals originate from transient wear events such as two-body abrasion, adhesion, or three-body abrasion caused by particle contamination. Time-frequency

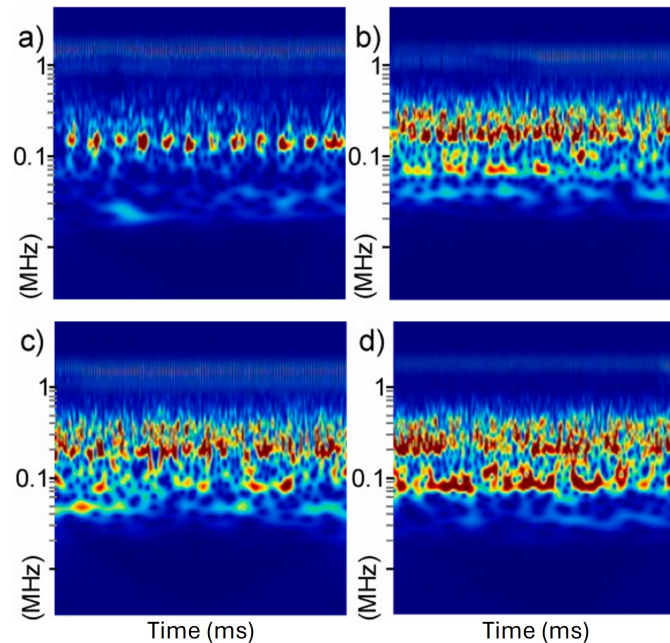


Figure 9. CWT of the AE-AE signals for different operating states: a) Hydrodynamic-hydrodynamic operation, b) Running-inrunning-in, c) Oil-oil starvation, d) Partiele-particle contamination (König et al., 2021a)(König et al., 2021b)(König et al., 2021a, b).

1075 methods such as the Continuous-Wavelet-Transform-continuous wavelet transform (CWT) are particularly well-suited-well
suitet to capture these events adequately. Unlike traditional methods that rely on statistical descriptors or STFT, the CWT
maintains high resolution in both time and frequency domains and enables the localization of specific frequency components
over time. This is particularly advantageous for detecting the onset and evolution of wear modes in journal bearings.

Recent studies have demonstrated that AE-AE signals from running-in, oil starvation, and particle-contaminated lubrication
1080 exhibit distinct 40–700 kHz time-frequency signatures. Figure 9 shows CWT of AE-AE signals recorded under four different
operating conditions of a journal bearing, namely, hydrodynamic operation, running-in, oil starvation, and particle-contaminated
lubrication (König et al., 2021a)(König et al., 2021b)(König et al., 2021a, b).

While each condition yields characteristic signal patterns in the 40–700 kHz range, the overall morphology of the CWT
spectrograms shows significant overlap between certain operating states, particularly between running-in and oil starvation. As
1085 a result, a reliable manual classification of these time-frequency representations is nearly impossible. Human observers cannot
consistently distinguish subtle yet relevant spectral differences across large datasets. Therefore, machine-learning-ML models
are required, specifically, deep convolutional neural networks, trained on labelled CWT spectrograms. These models have
been shown to effectively learn discriminative features and achieve classification accuracies above 80% (König et al., 2021a)
(König et al., 2021b)(König et al., 2021a, b).

1090 The previous sections show that ~~acoustic emission~~-AE is a highly sensitive method for detecting early damage mechanisms in bearings. ~~AE~~-AE is particularly suitable for monitoring non-stationary and transient processes such as abrasion. Manual data evaluation of the ~~AE~~-AE signals by human observers is hardly practicable, as the spectral patterns of different operating states sometimes overlap considerably. Integrating ~~machine learning~~-ML methods, such as ~~convolutional neural networks~~ (~~CNNs~~)-CNNs, opens new perspectives for the automated classification of ~~AE~~-AE signals in the form of time-frequency
1095 information. Existing challenges must be solved before ~~AE~~-AE technology can be used in field applications. Real-time processing requires powerful signal processing hardware and robust software solutions to process large amounts of data reliably. At the same time, the analysis algorithms must be robust against interference signals, varying environmental conditions and structural differences in the systems to avoid misclassifications.

4 Monitoring ~~Strategies Focused~~-strategies focused on Remaining Useful Life~~remaining useful life~~

1100 Components typically undergo measurable changes at the early stages of deterioration. The interval between this initial stage and the occurrence of the fault is commonly referred to as the ~~remaining useful life (RUL)~~-RUL (Aydemir and Acar, 2020; Si et al., 2011). Predicting the RUL of equipment is a core technology for implementing effective maintenance strategies (Zhang et al., 2023b). In wind energy applications, which rely heavily on automation and complex machinery, accurate RUL estimation is critical (Compare et al., 2020). It enables condition-based and predictive maintenance strategies, transforming
1105 asset management and operational risk mitigation. Unplanned downtime poses a major challenge across industries, often leading to substantial financial losses ~~Such instances often result in substantial financial losses~~ (Zhang et al., 2023b). By leveraging RUL predictions, industries can schedule maintenance proactively, ensuring that machinery is serviced or replaced before failure occurs. Researchers have proposed various classifications for RUL approaches. Jardine et al. (2006) categorized RUL approaches into statistical, model-based ~~and artificial intelligence~~-and AI approaches. Heng et al. (2009) grouped them
1110 into physics-based, data-driven ~~and integrated~~ approaches. Javed et al. (2017) classified them into statistical model-based approaches, AI approaches, physics model-based approaches ~~and hybrid~~ approaches. The famous and more commonly used classifications were approached by Lee et al. (2014), ~~which~~-who classified them into three categories: physics model-based, data-driven ~~and hybrid~~ approaches, as shown in Fig. 10. Data-driven prediction approaches can be further divided into two groups: statistical analysis and AI approaches.

1115 4.1 Physics model-based approaches

Physics-based modelling approaches rely on the physical laws that govern faults and failure mechanisms, which can differ depending on the specific mechanism involved (Patrick-Aldaco, 2007). The physical failure model of equipment primarily predicts the RUL by analyzing mainly cracks and wear in critical components (Zhang et al., 2023b; Thirumurugan and Gnanasekar, 2020). The accuracy of these predictions is significantly influenced by the actual load conditions on the components,
1120 specialized knowledge of failure mechanisms ~~and~~ a series of necessary assumptions regarding mechanical components. Consequently, a mathematical model is established to accurately represent the physical laws underlying their performance

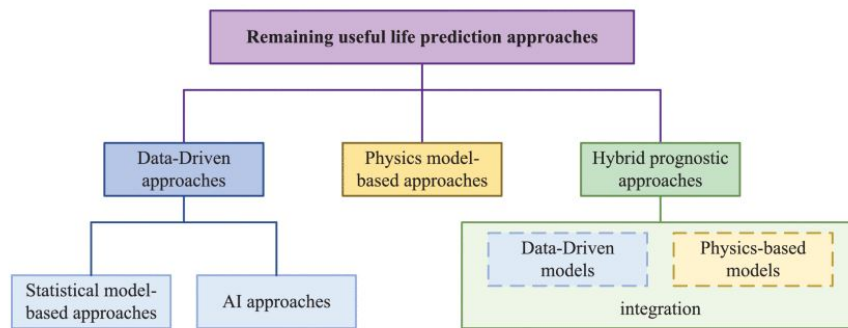


Figure 10. Classification of RUL approaches (Zhang et al., 2023b)

~

degradation (Zhang et al., 2023b). In the case of cracks, the prediction models are empirical and primarily based on experimental results related to crack growth, such as the Paris formula and the Forman formula. The Paris formula is a widely used model for predicting crack growth, linking the crack growth rate to the stress intensity factor (Leser et al., 2020). It underpins fatigue growth theory and is highly applicable in components like gears and bearings. Leser et al. (2020) developed a crack growth model based on the Paris formula for non-deterministic fatigue life predictions, along with a method to reduce prediction uncertainty.

For wear, empirical models such as Archard's (Archard, 1953) and Fleischer's (Fleischer G., Gröger H., Thum H., 1980) focus on material loss rates due to friction and contact stresses, enabling predictions of wear under varying load conditions. These models are often coupled with degradation statistical models to estimate wear life. König introduced a method that combines the Fleischer model with a linear degradation model to determine wear life or journal bearings (König et al., 2024; Gebraeel et al., 2009).

Physics-based approaches depend on knowledge of degradation processes and fault mechanisms in mechanical components, without relying on extensive historical data. These models often incorporate inputs such as material properties, mechanical principles, and load monitoring, which provides direct insight into operational stresses that contribute to failure. Developing these models requires specialized knowledge of material failure mechanisms and system behaviour, which may not always be available (Zhang et al., 2023b). As a result, accurately modelling complex mechanical equipment can be impractical, limiting its engineering applications.

4.2 Data-driven approaches

Data-driven approaches rely on the mapping process of collected equipment status information, without requiring specific physical models of fault evolution or degradation processes. This process, often referred to as pattern recognition, is used to diagnose machine faults. This involves translating information from the measurement space and/or features from the feature

space into specific machine faults within the fault space. These data-driven approaches can be categorized into two main branches: statistical analysis methods and AI techniques (Jardine et al., 2006; Zhang et al., 2023b).

1145 4.2.1 Statistical model-based

Statistical model-based approaches aim to determine the presence of a specific fault using available condition monitoring information (Jardine et al., 2006). These methods utilize specific models or distributions, along with their parameters, to formulate hypotheses regarding fault presence. Subsequently, test statistics are developed to summarize condition monitoring data, facilitating a decision on whether to accept or reject fault prediction (Jardine et al., 2006). Statistical model-based approaches include various methods that aim to estimate the RUL of equipment or components. According to Zhang-Zhang et al. (2023b), these approaches consist of three models: ~~Stochastic Filter Models, Stochastic Process Models, and Similarity-Based Models.~~ stochastic filter models, stochastic process models and similarity-based models. Stochastic filter models, such as the Kalman ~~Filter (KF) and Particle Filter (PF)~~ filter and particle filter, combine noisy measurements with probabilistic models to refine state estimates in real time, addressing uncertainties in both the system and measurement noise (Singleton et al., 2015; Cui et al., 2019). Variants like the ~~Extended Kalman Filter (EKF) and the Unscented Kalman Filter (UKF) tackle non-linear~~ extended Kalman filter and the unscented Kalman filter tackle non-linear challenges, while advances such as the ~~Unscented Particle Filter (UPF)~~ unscented particle filter enhance accuracy (Liu et al., 2022; Zhang et al., 2023b). ~~Stochastic Process Models~~ process models describe equipment degradation using stochastic processes to estimate RUL by identifying when degradation first reaches a failure threshold. Unlike time-series models, they provide probability distributions for RUL predictions, capturing uncertainty in the forecasts (Zhang et al., 2023b). Examples include Wiener ~~Process Models~~ process models (Li et al., 2019b; Wang et al., 2018; Li et al., 2020d), ~~Gamma Process Models~~ gamma process models (Ling et al., 2019), ~~Inverse Gaussian Models~~ inverse Gaussian models (Jin et al., 2020), and ~~Markov Models~~ Markov models (Gu et al., 2020; Zhang et al., 2023b; Ghosh et al., 2019). ~~Similarity-Based Models~~ process models (Li et al., 2019b; Wang et al., 2018; Li et al., 2020d), gamma process models (Ling et al., 2019), inverse Gaussian models (Jin et al., 2020) and Markov models (Gu et al., 2020; Zhang et al., 2023b; Ghosh et al., 2019). Similarity-based models estimate RUL by comparing degradation trajectories of a target system with reference systems using historical failure data. This method constructs health indicators and performs similarity matching, proving effective when detailed degradation mechanisms are not available (Lyu et al., 2020; Cannarile et al., 2019; Zhang et al., 2023b).

4.2.2 AI approaches

Traditional statistical analysis methods, which rely on signal processing technology and specific expert knowledge, struggle to address the complexities of mechanical systems (Deutsch and He, 2018). In contrast, AI approaches are taking a leading role by offering innovative solutions for ~~effective Remaining Useful Life Prediction (RULP)~~ the effective RUL prediction of mechanical equipment (Jia et al., 2016). Unlike traditional physical or statistical models, AI methods eliminate the necessity for precise modelling while effectively managing the complexities associated with degradation prediction in dynamic systems. ~~Zhang et al.~~ Zhang et al. (2023b) categorize AI approaches into two methods: shallow learning and deep learning. Shallow learning algorithms, such as ~~Artificial Neural Networks (ANN), Support Vector Machines (SVM), and Relevance Vector~~

Machines (RVM) ANNs, SVMs, and relevance vector machines, have demonstrated reliable performance in RUL prediction tasks. For instance, one of the earliest studies to utilize an AI approach was conducted by Gebrael et al. (2009), who developed a RULP-RUL prediction model for thrust ball bearings (inner diameter = 3.96 mm) using ANNs based on vibration-based signals. While these algorithms are particularly effective for smaller datasets and specific applications, they may face challenges such as difficulties with parameter tuning. Shallow learning focuses on feature extraction and making predictions from data without requiring deep hierarchical structures, which makes these algorithms faster and easier to train compared to deep learning models (Zhang et al., 2023b). Deep learning algorithms, including Convolutional Neural Networks (CNN) and Recurrent Neural Networks (RNN) CNNs and recurrent neural networks (RNNs), along with their variants such as long short-term memory (LSTM) LSTM, excel in capturing high-dimensional features and temporal correlations within large datasets (Zhang et al., 2023b). These methods provide improved predictive accuracy and adaptability for complex mechanical systems. For example, Li et al. (2020b) utilized CNNs to establish a direct relationship between CM-condition monitoring data collected from approximately 21 sensors, such as total temperature and pressure at the fan inlet, and RUL for aero-engines.

4.3 Hybrid approaches

Hybrid prognostic approaches integrate multiple methodologies, including data-driven and physics-based techniques, to predict the RUL of mechanical systems. These approaches aim to leverage the strengths of various methods while mitigating their individual limitations, hence leading to more accurate and reliable predictions (Zhang et al., 2023b). Such hybrid methods have demonstrated excellent results in predicting wear degradation and fatigue life.

For instance, Shutin et al. (2023) applied Archard's law and the Reynolds equation to develop a physical model for bearings that considers both load and thermal factors. Similarly, Feng et al. (2019) introduced a digital twin application based on a hybrid approach for detecting wear degradation in spur gears. Their method integrated vibration-based signals with a dynamic model developed to simulate gear vibrations, incorporating the Archard wear model. By iteratively updating the dynamic model to account for wear-induced changes and comparing simulated vibrations with measured data, this approach facilitates accurate estimation of the remaining useful life. Their other works further highlighted the effectiveness of digital twins based on hybrid approaches, demonstrating their potential to enhance the accuracy and reliability of predictive maintenance and monitoring processes (Feng et al., 2021, 2022).

4.4 Challenges in the industrial adoption of RUL estimation

Despite the extensive development of physics-based, data-driven and hybrid approaches, the widespread adoption of RUL estimation and prognostic methods in industrial settings remains limited. Transitioning these technologies from academic research to operational wind farms presents several significant practical challenges that must be addressed.

1205 Uncertainty quantification remains a major challenge. Wind turbine drivetrains are inherently noisy and subject to fluctuating operational and environmental conditions. Furthermore, as mechanical designs become increasingly complex, modelling their degradation becomes substantially more difficult (Zhang et al., 2023b). Consequently, RUL predictions are subject to various sources of uncertainty, originating from sensor noise, incomplete degradation models and unpredictable future loads. For

1210 operators to trust these prognostic models, it is essential to provide reliable confidence intervals. However, developing robust
1215 mathematical frameworks to accurately quantify and bound this uncertainty in real time is highly complex. The validation
of RUL models presents a fundamental difficulty (Zhang et al., 2023b). Allowing wind turbine drivetrains to run to failure
incurs substantial costs and is operationally impractical. As a result, historical run-to-failure data is notoriously scarce. Models
are frequently trained and validated using accelerated life testing in controlled laboratory environments or through simulated
data. These controlled scenarios often fail to capture the complex, noisy degradation pathways observed in the field, making
operators skeptical of the model's reliability when deployed in actual operational conditions. Integrating RUL predictions
with actual maintenance decision-making may not be straightforward. Even if a model provides an accurate RUL estimate,
translating this information into a concrete maintenance action requires overcoming organizational and logistical barriers.
These practical challenges must be systematically resolved before RUL models can be widely applied to operational wind
farms.

1220 5 Component-specific monitoring strategies

Wind turbines operate under fluctuating environmental conditions, experiencing variable loads that lead to gradual wear and
potential failure of drivetrain components. The drivetrain includes key elements such as the main bearing, gearbox, generator,
and blades, which require continuous monitoring to prevent unexpected breakdowns. Component-based condition monitoring
focuses on the health of individual drivetrain components. Analyzing each component's condition enables more effective and
1225 efficient maintenance solutions. The primary challenge is selecting the proper monitoring techniques and data granularity for
accurate fault detection.

Each drivetrain component in a wind turbine requires a specific combination of condition monitoring techniques to ensure
early fault detection. Vibration analysis, oil debris monitoring, electrical signature analysis, and infrared thermography are
among the most effective methods. For the best predictive maintenance strategy, a combination of multi-sensor data fusion,
1230 AI-based anomaly detection, and SCADA trend analysis can be implemented to maximize turbine reliability and efficiency.

5.0.1 ~~Data granularity challenges~~

5.1 Data granularity across drivetrain components: Requirements and challenges

Multi-sensor data fusion offers powerful capabilities for condition monitoring. However, it also introduces a significant challenge.
It requires ensuring the appropriate data granularity for each distinct machine component.

1235 ~~Supervisory control and data acquisition systems in wind turbines typically collect operational parameters such as power
output, rotor speed, and temperature at~~ As established in Section 3.1.5, the standard 10-minute intervals. That provides a
low-frequency dataset for condition monitoring. Although this temporal resolution is sufficient to detect gradual degradation
(e.g., bearing wear or lubrication failures), it is often inadequate to identify rapidly evolving faults. Recent studies emphasize
the necessity of higher-frequency SCADA data acquisition, such as SCADA resolution enables broad operational trend analysis

1240 ~~but remains inadequate for resolving incipient fault signatures. Consequently, high-frequency SCADA acquisition (1 Hz (one-second intervals), to enhance diagnostic accuracy (Gonzalez et al., 2017). However, adopting high-frequency SCADA monitoring is associated with significant challenges, particularly regarding increased data volume and computational demands) is increasingly necessary, despite the resulting increase in data volume .~~

~~In contrast, vibration-~~

1245 Vibration and acoustic emission sensors operate at significantly higher sampling rates ~~. Vibration measurements typically range from 1 Hz to 20 kHz, depending on the phenomenon under investigation (Randall, 2021). As modern wind turbines increase in size, their rotational speeds tend to decrease, resulting in longer periods for cyclic events. This requires extended sampling durations to ensure the acquisition of sufficient cycles for reliable signal processing. Additionally, common gearbox failure modes manifest as high-frequency spectral components, requiring high sampling rates to capture these transient events accurately.~~

1250 ~~Consequently, modern data acquisition systems must balance extended measurement durations with the requirement for relatively high sampling frequencies . On the other hand, acoustic emission sensors often require even higher sampling rates, exceeding 1 MHz in some applications. Although such high-resolution data can provide valuable insights into early-stage structural failures, it generates substantial data volumes, requiring efficient data management strategies.~~ than SCADA systems. For large-scale turbines, the data acquisition system must manage the multi-scale requirement discussed in Section 3.2.1: balancing extended

1255 durations for slow rotor cycles with kilohertz-range frequencies for transient gearbox faults .

Another critical aspect of data granularity is the determination of optimal sampling periodicity. While continuous monitoring may be ideal for condition assessment, it is often impractical due to storage and computational constraints. Depending on the measurement type, sampling frequencies can range from high-frequency SCADA data recorded every second to vibration or acoustic measurements taken only a few times daily. However, no standardized framework exists for determining the optimal

1260 sampling periodicity. An efficient approach is to measure intervals ~~sufficiently frequently~~ frequently enough to capture the full range of operating conditions experienced by the wind turbine drivetrain.

The granularity challenge extends beyond simple sampling rates to include the physical nature of the data itself. Oil debris monitoring, for instance, focuses on the cumulative trending of particle counts rather than continuous waveforms. In this case, "granularity" is defined by the sensor's ability to detect specific particle size bins, typically ranging from 30 μm to 300 μm ,

1265 to correlate wear debris with the health of internal bearings and gears. Effectively synchronizing these discrete particle events with high-frequency vibration streams remains a difficult data fusion task.

Electrical signal-based monitoring, such as current signature analysis, presents a different bottleneck. While current and power signals are often already captured by turbine control and protection systems, extracting the harmonic information necessary for detecting rotor or stator faults requires high-speed acquisition. This adds a third parallel stream of high-volume

1270 data that must be processed alongside mechanical signals to provide a complete picture of generator health. Finally, imaging and visual techniques, such as thermography or drone-based X-ray scanning, introduce a unique dimension of spatial granularity. These methods offer unrivaled detail for identifying surface erosion or internal blade delamination. However, they currently suffer from low temporal granularity, as they are largely restricted to periodic, stationary inspections rather than continuous

1275 operation. Transitioning these into real-time monitoring streams remains a significant frontier, requiring a substantial increase in computational power to handle high-resolution spatial datasets alongside traditional time-series data.

Several challenges remain in the integration of multi-granularity data for effective condition monitoring. High-frequency vibration and acoustic emission data necessitate advanced computational approaches, such as edge computing or cloud-based analytics, to process and store information efficiently (Verstraeten et al., 2019). While higher data granularity enhances diagnostic capabilities, it also increases hardware, storage, and maintenance costs, requiring careful cost-benefit analyses.

1280 **5.2 Main bearings**

5.2.1 Main bearing background and open challenges

The main bearing (~~MB~~) in a wind turbine allows for free rotation of the main shaft, transmitting power producing torque to the gearbox/generator while transferring potentially harmful non-rotational loads to the bedplate or frame. Currently, all commercially available main bearings (~~MBs~~) for wind turbines are of the rolling-element type. Recently identified as a primary driver of O&M cost increases, ~~MB-main bearing~~ reliability has become a critical cost factor for wind energy (EPRI, 2024). The high costs associated with ~~MB-main bearing~~ failures arise from both frequent breakdowns and expensive replacements. ~~Concerning the former, high volume~~ Prior high-volume field data studies ~~have shown that MB showed that main bearing~~ L_{10} field lives¹ are around 10.5 years (Hart et al., 2023; EPRI, 2024) for turbines rated at 6 MW or slightly higher. This is close to half the minimum design rating life of 20 years. There is also evidence that larger turbines are experiencing failures earlier (EPRI, 2024). A variety of failure modes have been documented, including damage resulting from surface and subsurface initiation, stray currents, lubrication failures, overloading, and improper bearing assembly/fit (Hart et al., 2023; EPRI, 2024). The principal drivers of premature ~~MB-main bearing~~ failures remain unclear, likely as a result of the challenges presented by 1) complex and highly non-steady operational conditions which make damage modes and expected lifetimes difficult to model or predict (Hart et al., 2022; Kenworthy et al., 2024); 2) ~~MB-main bearing~~ and shaft diameters moving beyond the envelope of prior experience, likely resulting in ~~larger-magnitude bearing deformations~~ larger-magnitude bearing deformations, among other possible ~~effects (Nejad et al., 2022)~~ effects (Nejad et al., 2022); and 3) ~~Uncertainty uncertainty~~ concerning the criticality of ~~MB-main bearing~~ system design versus maintenance and servicing practices when seeking to extend ~~MB-main bearing~~ lifetimes. Condition monitoring and ~~remaining useful life RUL~~ estimation help mitigate the cost impacts of ~~MB-main bearing~~ failures, providing operators with advanced warning of potential issues and supporting effective scheduling of routine maintenance and investigative, preventative and/or replacement activities.

5.2.1 Main bearing condition monitoring

Effective condition monitoring of ~~MBs-main bearings~~ is widely recognized as a crucial strategy to ensure reliable and minimally interrupted operation. The ~~MB-main bearing~~ experiences high-magnitude fluctuating loads, slow rotational speeds ω , and harsh environmental conditions, increasing its susceptibility to wear, spalling τ , and lubrication-related degradation (Hart et al. (2020); Liu and Zh

¹The time at which 10% of the bearing population have failed.

1305 ~~)~~([Hart et al., 2020](#); [Liu and Zhang, 2020](#)). In response, a broad range of sensor-based approaches has been proposed to capture the critical parameters indicative of ~~the MB's main bearing~~ health status. Commonly employed sensors include vibration accelerometers or ~~Micro-Electro-Mechanical Systems (MEMS)~~ [micro-electro-mechanical systems](#) operating at high sampling rates, acoustic emission sensors tailored for early fault detection (Ma et al. (2023)), ~~and~~ complementary sensors such as thermography devices, and strain gauges collecting lower-frequency signals. Although SCADA systems are also used, the associated ~~10-min~~ [10 min](#) averaged sampling rate often proves insufficient to capture subtle, time-sensitive fault signatures ([Encalada-Dávila et al. \(2021\)](#))([Encalada-Dávila et al., 2021](#)).

The effectiveness of these sensor-based approaches depends not only on the types of sensors deployed but also on the granularity of the data they produce. Data granularity must be carefully selected to balance the level of diagnostic detail required with the computational and bandwidth constraints of the monitoring infrastructure. ~~Supervisory control and data acquisition~~ [SCADA](#) data, sampled typically every 10 min, enable broad operational trend analysis (e.g., turbine power, temperature) but do not adequately resolve incipient fault signatures ([Encalada-Dávila et al. \(2021\)](#))([Encalada-Dávila et al., 2021](#)). Medium-frequency data (on the order of 1 Hz) offer a compromise between signal resolution and data volume by capturing moderate-level anomalies that evolve over minutes or hours. High-frequency signals (on the order of ~~kHz~~ [kilohertz](#)) are necessary for revealing localized shock pulses or high-frequency resonances characteristic of early bearing faults (Xiao et al. (2022b); Beretta et al. (2021b)). However, these higher sampling rates require greater data handling capacity and more sophisticated processing pipelines.

A variety of ~~condition monitoring system (CMS)~~ [CMS](#) signal processing techniques have been employed to extract meaningful fault signatures from raw sensor signals. Time-domain methods are frequently used to compute statistics such as ~~Root Mean Square (RMS)~~ [RMS](#) or kurtosis, and envelope analysis is applied to isolate impact-type features associated with bearing damage ([Hart et al. \(2020\)](#); [Hussain et al. \(2024\)](#))([Hart et al., 2020](#); [Hussain et al., 2024](#)). Frequency-domain approaches, including Fourier transform-based spectral analysis and cepstrum analysis, are well suited for identifying characteristic fault frequencies (e.g., ball pass frequency on the outer race, ball pass frequency on the inner race). When signal stationarity cannot be assumed, ~~time-frequency domain methods~~ [time-frequency domain methods](#), such as wavelet transforms or the Hilbert-Huang transform ~~—~~, are effective in tracking transient or non-stationary events ([Fu et al. \(2024\)](#))([Fu et al., 2024](#)). These advanced signal processing tools are selected with consideration for data availability and sampling frequency, as more complex ~~analyses~~ [analyzes](#) often offer improved fault resolution but necessitate higher-quality data and greater computational resources.

While these traditional signal processing techniques have proven effective for feature extraction, the growing complexity of ~~MB~~ [main bearing](#) fault detection challenges has driven the integration of ML methods. ML approaches complement these techniques by automating data interpretation and improving fault detection accuracy through advanced pattern recognition ([Encalada-Dávila et al. \(2021\)](#))([Encalada-Dávila et al., 2021](#)). Traditional supervised algorithms (e.g., ~~support vector machines~~ [SVM](#), random forests) and unsupervised approaches (e.g., clustering, novelty detection) are employed to distinguish normal from anomalous operating conditions ([Beretta et al. \(2021b\)](#))([Beretta et al., 2021b](#)). In situations where large labelled datasets are available, deep learning architectures, such as ~~Convolutional Neural Networks (CNNs)~~ or ~~Recurrent Neural Networks (RNNs)~~ [CNNs](#) or [RNNs](#), are used to learn discriminative features directly from raw vibration signals or time-series data ([Xiao et al. \(2022a, b\)](#)

1340 ~~)~~([Xiao et al., 2022a, b](#)). Autoencoders, in particular, are gaining prominence for unsupervised anomaly detection when labelled
fault examples are limited (~~Liu and Zhang (2020)~~)([Liu and Zhang, 2020](#)). These ML-based strategies frequently leverage multi-
rate data fusion, in which high-frequency vibration measurements are combined with 10 min SCADA observations (e.g., tower
acceleration, bearing temperature, turbine power) to enhance contextual understanding and reduce false alarms (De Oliveira-
Filho et al., 2022).

1345 The combination of advanced sensor technologies, appropriate data granularity, and robust signal processing or ML methods
enables earlier detection of [MB-main bearing](#) faults, reduced downtime, and optimized maintenance schedules (~~Xiao et al. (2022b); Beretta~~
~~)~~([Xiao et al., 2022b; Beretta et al., 2021b](#)). Nevertheless, the selection of a specific monitoring strategy typically depends on
practical factors such as turbine accessibility, cost constraints, and existing data infrastructure. In particular, wind farm
operators must assess whether the added complexity of high-frequency data acquisition and real-time processing can be justified
1350 by the potential for reduced corrective maintenance costs and mitigated risk of catastrophic failures (~~Liu and Zhang (2020)~~
~~)~~([Liu and Zhang, 2020](#)). As wind farm projects continue to scale in size and complexity, further advancements in sensor
technology, data handling capacity, and machine/deep learning algorithms are expected to enhance [MB-main bearing](#) condition
monitoring capabilities while contributing to the overall reliability and cost-effectiveness of wind energy production.

5.2.2 Main bearing remaining useful life prediction

1355 The estimation of RUL for wind turbine [MBs-main bearings](#) has emerged as a critical but highly complex area of research and
application. These components endure ~~nonsteady, nonstationary~~ [non-steady, non-stationary](#) loading conditions and challenging
environments, making accurate RUL prediction essential for minimizing downtime and optimizing maintenance schedules. The
state of the art in this domain encompasses a spectrum of methodologies, including vibration-based diagnostics, hybrid data
fusion techniques, and advanced ML algorithms. This subsection delves into the current state of the art, highlighting the key
1360 challenges and opportunities for advancing [MB-main bearing](#) RUL estimation.

A robust RUL estimation framework begins with the integration of CMS outputs to acquire high-quality data. Vibration
analysis remains the cornerstone of fault detection and prognosis, providing critical insights into bearing degradation through
signal processing techniques in the time and frequency domain (Hart et al., 2020; Kordestani et al., 2022). Techniques
such as envelope analysis, spectral kurtosis, and wavelet transforms allow the extraction of features indicative of wear
1365 and localized damage. However, [MBs-main bearings](#) present unique challenges due to their low rotational speeds and the
influence of external noise, such as gearbox vibrations (Li and Jian, 2024; Rezamand et al., 2020). The effective separation
of meaningful fault signals from this noise remains a significant barrier. Hybrid approaches that integrate SCADA data
and vibration analysis offer promising solutions. ~~Supervisory control and data acquisition~~ [SCADA](#) systems, widely used for
operational monitoring, provide valuable metrics such as temperature, power output, and wind speed, although at coarse
1370 temporal resolutions (Vieira et al., 2024). Combining these metrics with high-frequency vibration data has proven effective in
capturing long-term degradation trends. Recent studies employ cross-validation and data augmentation techniques to address
the challenge of limited ~~labeled data sets~~ [labelled datasets](#), improving model robustness and reducing overfitting risks (Vieira
et al., 2024). ~~Machine learning and Deep Learning (DL)~~ [ML and deep learning](#) have revolutionized RUL estimation by

automating feature extraction and providing adaptive models capable of handling non-linear degradation patterns. Techniques such as ~~Long-LSTM networks~~ and ~~Short-Term Memory networks (LSTM) and convolutional neural networks (CNNs)~~ excel at capturing temporal dependencies and spatial characteristics (Kordestani et al., 2022; Li and Jian, 2024). Hybrid models, such as those that combine tree seed algorithms with LSTM, further improve prediction accuracy and robustness (Rezamand et al., 2020). Bayesian frameworks and ensemble methods also show promise in quantifying uncertainty and improving reliability in real-time applications (Vieira et al., 2024).

1380 Despite these advancements, significant challenges remain. The inherent variability in operating conditions, including fluctuating loads and environmental factors, complicates the identification of consistent degradation trends (Rezamand et al., 2020). Furthermore, the lack of standardized datasets and benchmarking methodologies limits the comparability of proposed models. The high computational demands of ~~DL~~-deep learning models pose practical constraints on their deployment in resource-constrained environments, particularly for real-time monitoring.

1385 The opportunities for innovation lie in enhancing the interpretability and efficiency of predictive models. Advanced data fusion techniques, such as high-level fusion schemes with bounded uncertainty, offer pathways to integrate diverse data sources while mitigating noise (Kordestani et al., 2022). Furthermore, the use of digital twin technology to simulate operational states and predict faults in varying scenarios presents a further route to improve estimation of RUL for the main bearing. Future research on MB-main bearing RUL prediction should prioritize the development of scalable, explainable ML frameworks and
1390 the establishment of open-access, high-quality ~~, and farm-wide~~-and farm-wide datasets to enable comprehensive training and testing activities at scale.

5.3 Gearbox

The size and power capacity of wind turbine gearboxes are continuously increasing, with diameters reaching 3 ~~meters~~ and power up to 20 MW, often utilizing multi-stage designs with four or more planetary gears per stage (Nejad et al., 2022; Abhimanyu, 1395 2024). As summarized in Section- 2, the gearbox accounts for the longest downtime in wind turbines and incurs high repair costs (Li et al., 2020c). Failure modes of gearboxes are various, as concluded in Section- 2, with common issues including wear and damage of gears and bearings, shaft misalignment and fractures, oil leakage, and overheating.

The internal structure of wind turbine gearboxes is highly complicated and subjected to miscellaneous alternating loads, which induce irregular behaviours during operation. These behaviours include complex vibration responses caused by the simultaneous meshing of multiple planetary gears, intricate modulation effects, multiple vibration transmission paths, noise interference, output power fluctuations, as well as variations in voltage and current (Salameh et al., 2018; Wang et al., 2019; Li 1400 et al., 2019a). These factors impose substantial challenges on the condition monitoring of wind turbine gearboxes.

The common condition monitoring techniques for gearboxes include vibration analysis, oil and lubrication analysis, acoustic emission analysis ~~, and~~ SCADA data analysis (Salameh et al., 2018). Vibration signals typically contain abundant information on mechanical faults and are particularly sensitive to issues in critical subcomponents of the wind turbine gearbox, such as gears and bearings. Acoustic emissions in wind turbines primarily result from the initiation and propagation of cracks, making it possible to detect structural defects by installing acoustic emission sensors within the gearbox. Oil-based condition 1405

monitoring is also widely applied in wind turbine gearboxes. By monitoring parameters such as oil viscosity, moisture content, fluid level, particle count and identification, temperature, and pressure, the process of oil contamination and degradation can be analyzed, revealing the health status of the gearbox. Low-frequency parameters in the SCADA system, such as current, voltage, power, rotational speed, and wind speed, indicate the operational status of the wind turbine and provide valuable information regarding gearbox performance.

5.3.1 ~~ML-based~~ Machine-learning-based methods

The detailed classification of ML-based approaches has been thoroughly discussed in the preceding sections. Building upon this classification, we now summarize the commonly employed methods and relevant studies in the context of gearbox fault/failure diagnosis.

In the category of shallow learning, supervised learning is mostly used for classification, with commonly methods applied for gearbox fault/failure diagnosis including, such as kNN (Bao et al., 2023), SVM (Lu et al., 2020), random forests (Pang et al., 2021), and logistic regression (Su et al., 2022a). Unsupervised learning mainly addresses data dimensionality reduction and clustering. Key algorithms for dimensionality reduction include principal component analysis (PCA) (Elforjani, 2020), t-distributed stochastic neighbor embedding (t-SNE) (Zhu et al., 2024), neighbour embedding (Zhu et al., 2024) and linear discriminant analysis (LDA) (Pang et al., 2021). Clustering methods often include partition-based clustering such as K-means k-means (Zhu et al., 2022a), density-based clustering such as density-based spatial clustering of applications with noise (DBSCAN) (Shi et al., 2021), and model-based clustering, such as Gaussian mixture model (GMM) (Fuentes et al., 2020). Furthermore, recent studies have explored the application of reinforcement learning in diagnostics. For instance, in these studies (Wu et al., 2023; Wang et al., 2021b), the diagnostic problem is transformed into an optimization problem, where reinforcement learning is employed to automatically learn optimal classification policies. Deep learning methods for diagnosing wind turbine gearboxes can be broadly categorized as follows: multilayer perceptron (MLP) perception as a basic neural network structure (Bangalore et al., 2017); convolutional neural networks (CNN) CNNs, which are effective for handling data with a clear grid structure (e.g., images) (Zhang et al., 2023a); recurrent neural networks (RNN) RNNs, which specialize in processing sequential data (He et al., 2023); Transformer transformer networks, which leverage self-attention mechanisms to process sequential data (Zhao et al., 2023); autoencoders, which use unsupervised learning to reconstruct input data, aiding in feature extraction and dimensionality reduction (Yang and Zhang, 2020); and generative adversarial networks (GAN), consisting of a generator and discriminator for data generation and augmentation (Su et al., 2022b). In addition to shallow and deep learning, ensemble learning, including stacking, boosting, and bagging leverage multiple compatible machine learning and bagging, leverages multiple compatible ML algorithms to perform a single task, enhancing diagnostic performance and reducing overfitting. For example, in the paper (Pichika et al., 2022) Pichika et al. (2022), the authors proposed a hybrid ensemble method integrating boosting, bagging, and stacking techniques to identify multi-component faults in a wind turbine gearbox. In the context of digitalization, transfer learning has also been applied to wind turbine gearboxes to improve fault diagnosis performance across different turbines and operational conditions, thereby strengthening generalization and advancing the realization of digital twin technologies. For instance, Zhu et al. (2022b) employed three feature-based transfer learning methods to minimize data

distribution discrepancies between wind turbines and applied these methods in case studies for fault detection in two 2 MW wind turbines. Hu et al. (2024) proposed a novel method for early fault detection and diagnosis in wind turbines suited for data-limited scenarios, achieving accurate and transferable fault diagnosis. The proposed method was validated using vibration data from actual wind turbine gearboxes.

5.3.2 ~~CMS~~ Condition monitoring system signal processing

Wind turbine gearbox condition monitoring using vibration analysis can be broken down into monitoring the three key components: shafts, gears, and bearings. Each component exhibits unique fault modes and requires specific signal pre-processing and analysis techniques.

1450 ■ Shafts

Shafts are typically ~~well-designed~~ well designed and robust but can experience significant issues that may lead to catastrophic failures. As the critical link between rotating components, shaft failures can arise from unbalance, misalignment, bending, or cracks. These defects often manifest through increased amplitude at the shaft frequency or its harmonics over time.

1455 An imbalance in rotating machinery can cause mechanical wear, reduced efficiency, and failures if not promptly addressed. It occurs when mass distribution in the rotor is uneven, inducing excessive vibrations and stress on bearings. Traditional methods for detecting imbalances focus on vibration analysis, where deviations from expected patterns indicate the issue. Recently, advanced techniques, including frequency spectrum analysis and ~~machine learning~~ ML algorithms, have improved the precision of unbalance detection (Carbajal-Hernández et al., 2016).

1460 Shaft misalignment, which can occur in coupled shafts, also affects vibration signatures, particularly at the second and fourth harmonics of shaft speed. However, some studies report no direct correlation between misalignment and increased second harmonic (Mitchell, 1984; Al-Hussain and Redmond, 2002). Vibration-based methods are widely employed for detecting unbalance and misalignment by analyzing the machine's vibration signature (Patel and Darpe, 2009a, b).

Although less common, cracks in shafts can manifest as increases in shaft harmonic amplitudes in vibration spectra ~~Patel and Darpe (2009a, b)~~ (Patel and Darpe, 2008). However, small cracks may not significantly alter vibration characteristics. Severe cracks, though dangerous, may only influence vibration patterns once they are sufficiently large ~~Randall (2021)~~ (Randall, 2021). Detection methods using vibration analysis, often combined with acoustic emission techniques, are commonly used for condition monitoring ~~Lu and Chu (2011)~~ (Lu and Chu, 2011). Despite advances in monitoring techniques, there remains substantial potential for developing more effective tools for the early detection of shaft faults as rotating machinery grows more complex.

1470

■ Gears

They Gears are essential components in drivetrain systems, typically used to change rotational speed or torque between two shafts (Randall, 2021). According to ~~Randall (2021)~~ work on vibration-based condition monitoring by Randall (2021), gear faults can be categorized into four primary types.

1475 The first category of gear faults is slow variations, including processes like wear, runout, and polishing (Feng et al.,
2023). Wear is the most common slow deterioration fault, characterized by gradual changes on the gear teeth surfaces.
It can be uniform, with all teeth wearing similarly, or non-uniform, leading to different surface shapes across the
teeth (Hu et al., 2016). While uniform wear typically increases vibration levels detectable at gear meshing harmonic
frequencies, non-uniform wear may cause either an increase or decrease in these amplitudes (Hu et al., 2016; Randall,
1480 2021). Wear increases overall vibration levels due to defects on meshing surfaces contributing to noise and gear meshing
vibrations (Feng et al., 2023). Several studies have linked the severity of wear to vibration levels by tracking RMS (Feng
et al., 2023), and early research introduced the energy ratio (the RMS ratio of the stochastic and deterministic parts
of the vibration signal) as a measure of wear severity (Swansson, 1980). Gear teeth exposed to wear generate higher
vibration levels and additional harmonics (Ziaraan and Darula, 2013) and sidebands in the vibration spectra compared
1485 to healthy gears. Techniques such as tracking frequencies in cepstra (Ziaraan and Darula, 2013) and sidebands in the
spectra (Combet and Gelman, 2011) have been proposed for fault detection.

The second category consists of local faults, which can evolve into distributed faults. Local faults include pitting, spalling,
scoring, and foresting, often caused by contaminants in lubrication, subsurface cracks, or prolonged metal-to-metal
contact (Liang et al., 2018). The fault identification process for pitting and spalling is similar to wear detection in
1490 vibration-based condition monitoring. The vibration spectra of a gear are typically analyzed in the time, frequency, time-
frequency, and cepstral domains (Kumar et al., 2020). Fault detection approaches for wear and pitting are demonstrated
in [Feng et al. \(2015\)](#); [Jena et al. \(2014\)](#); [Feng and Liang \(2016\)](#); [Merainani et al. \(2017\)](#); [Feng et al. \(2015\)](#); [Jena et al. \(2014\)](#); [Feng et al. \(2015\)](#); and [Merainani et al. \(2017\)](#). Two other types of faults encountered by gears are random errors, such as tooth spacing
errors or broken teeth, and systematic errors, referred to as the *Ghost-ghost component*. The former represents manufacturing
1495 defects or severe faults, ~~while and~~ the latter is not necessarily a fault but results from imperfect meshing caused by
manufacturing limitations.

A defect in a gear results in vibration patterns that differ significantly from those of a healthy gear. Typically, a fault
in a gearbox manifests through several sidebands in the vibration spectra, as gear faults are inherently amplitude- and
frequency-modulated. While a localized fault generates a flat sideband distribution, a distributed fault results in larger,
1500 narrowly spaced sidebands. These sidebands are separated from the central peak at the gear meshing frequency by the
shaft frequency. In practice, vibration signals from a gearbox are complex, and sidebands may be challenging to detect
depending on fault severity.

A practical approach for detecting gear faults is to demodulate faulty gear vibration signals and apply fault detection
techniques to the demodulated signal. However, gear faults present a challenge, as the forcing frequencies and modulation
frequencies are often very close, hindering traditional demodulation methods, such as [the](#) Hilbert transform (Kumar
1505 et al., 2020), which do not satisfy the Bedrosian theorem. Other techniques, including signal modulation and application
of problem-specific filters to reveal fault-related frequencies, have been proposed in the literature (Kumar et al., 2020;
Feng et al., 2015).

■ Rolling element bearings

1510 Among others, bearings are the most commonly used rotating component in a gearbox (Randall, 2021). Moreover, they represent the primary contributor to machine failures. Consequently, extensive research has been conducted to analyze the vibration characteristics of bearing faults, leading to the development of advanced signal processing techniques for early fault detection.

1515 Rolling element bearings are susceptible to three types of faults: defects on the inner race, outer race, and rolling elements. A defective bearing produces high-frequency bursts at a frequency determined by the bearing's geometry and the affected component. The characteristic frequencies of rolling element bearings are provided in Eqs. 6 to 9. The shaft speed often modulates these trains of bursts generated by a defect, as it is the rate at which the faulty component passes through the load zone. The envelope of the vibration signals contains information about these high-frequency bursts, enabling condition monitoring of the bearing by tracking these bursts in either the time or spectral domain.

1520 However, the characteristic frequencies listed in Eqs. 6 to 9 may not precisely correspond to the actual frequencies due to a phenomenon known as slippage (Antoni and Randall, 2002, 2003). The bearing cage ensures that the rolling elements rotate at an approximately uniform speed; however, variations in the angle θ cause fluctuations in radial and axial forces, leading to slip in some rollers. This results in deviations in the characteristic frequency of up to 2% (Antoni and Randall, 2002, 2003). This slight variation justifies using the envelope of the signal rather than the raw signal for vibration-based condition monitoring of bearings. Vibration signals dominated by cyclic impulse trains are classified as cyclostationary, whereas in cases where slippage occurs, they are categorized as pseudo-cyclostationary (Antoni and Randall, 2003).

1530 Vibration-based bearing fault detection is typically conducted by analyzing high-frequency bursts in the signal or its envelope within the time, frequency, or time-frequency domain. A comprehensive tutorial on rolling element bearing diagnostics was published by Randall and Antoni (2011). A key challenge in bearing fault detection is that the deterministic component of the signal often obscures the vibration signature of the bearing fault. This deterministic component, typically generated by gear meshing or other cyclic phenomena, exhibits a distinct periodic pattern, unlike the stochastic nature of bearing faults. Consequently, the dominant power of the deterministic component may mask the fault-related signals embedded within the stochastic portion of the signal.

1535 A conventional approach to address this issue involves separating the stochastic component and demodulating the vibration signal after applying high-pass or bandpass filtering. However, determining the optimal filter bandwidth is data-dependent, as the structure dictates the carrier frequency, and no universal selection method exists. Although ~~ad-hoc~~ ad hoc techniques such as spectral kurtosis (Antoni and Randall, 2006) have been developed to identify the optimal bandwidth, automated filtering methods have also been proposed in the literature (McDonald et al., 2012; Peeters et al., 2020b; Buzzoni et al., 2018).

1540 Following this, statistical indicators can be estimated from the time-domain signal to assess whether the signal exhibits increased impulsiveness or skewness relative to the expected healthy state. Additionally, tracking the amplitudes of

characteristic frequencies or sidebands in the signal or envelope spectrum remains a widely used and effective method. Furthermore, advanced techniques employing correlation and coherence maps have been introduced to simultaneously identify modulation and carrier frequencies.

1545

■ Plain bearings

The substitution of roller bearings as planetary bearings in wind turbines with plain bearings has become ~~well-established~~ well established in recent years (Lucassen et al., 2025). Compared to roller bearings, plain bearings are characterized by their low installation space requirements, resulting in a higher power density of the wind turbine ~~drive train~~drivetrain (Lucassen et al., 2023). When operated exclusively within the liquid friction range, plain bearings operate without wear and theoretically possess an infinite service life. However, critical operational anomalies (e.g., insufficient lubrication due to oil supply failure, overheating of the planetary bearing τ , or oil contamination) may occur, which cannot be adequately addressed in the design process and can lead to failure of the plain bearing. Nevertheless, incipient damage to plain bearings can be detected at an early stage by using ~~condition monitoring systems (CMS)~~CMSs. A variety of CMS metrics have been established for hydrodynamic radial plain bearings and are part of the current state of research and industry (Mokhtari et al., 2020).

1550

1555

Conventional monitoring systems are usually retrofitted to the plain bearings and can only be installed in multi-axis rotating systems, such as planetary gearboxes, at considerable expense due to the complex cabling required for data and power transmission (Kirchner et al., 2024). To monitor planetary plain bearings, vibration- or ~~AE-based~~AE-based condition monitoring methods described in ~~chapter 3.3 Section 3~~ may potentially be employed, while measuring at the gearbox housing as described in ~~(Mokhtari, 2020)~~Mokhtari (2020). However, the long transfer path from the planetary plain bearing to the sensor on the gearbox housing introduces many potential sources of interference that must be identified and eliminated through suitable data evaluation.

1560

Another option for monitoring planetary plain bearings involves ultra-low-power-demand monitoring methods integrated directly into the bearing itself, such as temperature sensors. By harnessing energy types generated within planetary plain bearings—~~such as thermal or mechanical energy~~—and converting them into electrical energy using energy harvesting techniques, these condition monitoring methods can operate ~~autarkie~~ without an external power supply.

1565

Surface Acoustic Waves (SAW) method

~~Surface acoustic waves~~ One such integrated approach is the Surface Acoustic Wave (SAW) ~~are elastic waves that propagate along the surface of a solid substrate (the so-called wave guide material). They can be created by active excitation using piezoelectric actuators. In terms of condition monitoring, the bearings raceway or sliding surface acts as the wave guide and the SAWs are directly induced into the bearing material. The measurement of SAW is characterized by its high sensitivity to different friction conditions in tribological systems.~~

1570

~~Several investigations have addressed the use of SAW for the evaluation of the operating state (Chmelar et al., 2020) or the detection of different lubrication states (Lindner et al., 2010) in rolling element bearings. Those studies demonstrated that a dry-running of the bearings can be detected using SAW measurement. The method has also been shown to be~~

1575

effective for an in-situ measurement of the lubricant viscosity in hydrodynamic radial journal bearings (Tyreas et al., 2022). Decker et al. are pursuing the application of the SAW method in journal bearings in wind turbines for the purpose of monitoring the operating state and have demonstrated that measuring the SAW in a journal bearing enables the detection of mixed conditions and the oil film height Decker et al. (2025a).

1580

For the purpose of condition monitoring using SAW, the journal bearing is equipped with two piezoelectric probes underneath method, which utilizes piezoelectric probes embedded beneath the sliding surface with a radially inward-facing position. The probes are placed around the bearing load zone (the area of the expected minimal oil film). The setup is shown in Figure ???. The SAW measurement is a cyclic process. The emitter probe emits a short sinusoidal wavelet to
1585 emit short sinusoidal wavelets $\hat{x}(t)$ with a defined duration, excitation frequency f_E and amplitude (see also Figure ???b). The SAW receiver probe measures the response signal and measure the response $x(t)$ in a defined time interval once per excitation once per cycle. As these waves propagate along the surface, they interact interaction with the adjacent oil film as a portion of the acoustic energy is transferred to the lubricant. This causes a causes measurable wave attenuation and a significant time delay. This is quantified through a measurement of a specific phase amplitude $a(t_G)$ and time shift
1590 (t_G) in the response signal $x(t)$ (see Figure ???b). Consequently, these These SAW signal features are measured once per excitation cycle. Since the cycle durations range from 500 to 1000 μs (depending on the bearing design and size as well as the distance between the SAW probes), the relevant signal features are calculated with a frequency between 0.2 and 1 kHz.

1590

SAW application to a radial journal SAW excitation wavelet $\hat{x}(t)$ SAW response signal $x(t)$

1595

Schematic depiction of the SAW application to a radial journal bearing (Decker et al., 2025a).

Since the SAW method is an enable the detection of mixed conditions and the oil film height (Decker et al., 2025a). This active ultrasonic measurement principle the monitoring is particularly robust against any kind of acoustic disturbance. The measured signal is well localizable due to the is robust against acoustic disturbances due to its specific operating frequency f_E . The transmission of the acoustic energy from the bearing to the oil film and the damping of the wave are
1600 dependent on the height and pressure of the oil film. This effect can be quantified best by analysing the integral amplitude in a defined time interval $t_{\sigma,1}$ to $t_{\sigma,2}$ of the receiver signal (see Figure ???b). In Figure ??, the correlation between the SAW integral amplitude feature and the minimal oil film of the bearing is exemplarily shown. It was also demonstrated that other SAW features (e.g. wave propagation time modulation) can indicate mixed friction events in journal bearings.

1600

SAW amplitude feature measured on a journal bearing Simulated minimal oil film height (EHD model) The correlation
1605 between SAW amplitude features and the oil film height in a journal bearing. (Decker et al., 2025a).

1605

In recent studies, it was demonstrated that the findings on the correlation between the SAW measurements and the bearing's friction state and oil film height can be and has been transferred to planetary journal bearings as they are used in modern wind turbine gearboxes. For the application on planetary journal bearings the SAW probes are mounted bearings,
1610 using a 160° offset across the bearing circumference as shown in Figure ??a o probe offset to compensate for the tilting of the bearing's load zone due to planet gear tilting. The measurement proved to be sensitive for the operating state of the

1610

planetary journal bearing. In Figure ??b the result of a load monitoring algorithm using the SAW measurement data is shown. The algorithm is based on a machine learning model and uses the oil film dependant SAW features to predict the specific pressure \bar{p} on the bearing (Decker et al., 2025c).

1615

SAW probe setup on a planetary journal bearing Load prediction (a) SAW application to the planetary journal bearing for a wind turbine gearbox, (b) load monitoring achieved with the SAW measurement on the planetary journal bearing (Decker et al., 2025c).

1620

In addition to monitoring the oil film thickness and friction conditions, the detection of oil starvation tilting, to detect mixed friction, oil starvation, and lubricant contamination by particles was also investigated. In Decker et al. (2025b), it was shown that a real-time detection of anomalies in the operation of the journal bearing using SAW is potentially possible. One remaining challenge for the field application of SAW for monitoring the operation of planetary journal bearings in real wind turbine gearboxes is a monitoring algorithm which is reliable (detects critical conditions at an early stage) and robust (no false alarms) regardless of measurement influences such as temperature and speed. Since the SAW probes must be placed closely to the sliding surface of the bearing, the measurement system must be placed in the planetary axis. This results in the need for telemetry and energy-independent operation of the CMS. (Decker et al., 2025b, c).

1625

Temperature field measurement (TFM) method

A novel energy autarkic high precision CMS approach for radial plain bearings is temperature field monitoring within the bearing Complementing SAW is the Temperature Field Measurement (TFM) method, a high-precision self-powered CMS approach (Baszenski et al., 2023). The concept has been successfully validated experimentally for hydrodynamic radial plain bearings (Paeßens et al., 2024). The energy supply is generated thermoelectrically by utilizing the waste heat generated in the plain bearing. Additionally, a microcontroller is integrated into the plain bearing that continuously processes recorded measurement data and can wirelessly transmit this data along with alarm signals via an integrated Bluetooth Low Energy interface. This means that the TFM prototype can operate independently and entirely without external cabling. Figure ?? shows a prototype of an autarkic TFM based condition monitoring system for radial plain bearings.

1630

1635

Autarkic TFM-prototype for radial plain bearings

The TFM concept aims to use only commercially available and cost-effective microelectronic components. The current Technology Readiness Level (TRL) of the TFM concept for radial plain bearings is $TRL = 3-4$. On the one hand, this is intended to ensure transferability to many target systems with varying target requirements. On the other hand, the use of cost-effective electronics is intended to enable widespread use in field applications and transferability from science to industry. For the TFM approach, digital temperature sensors are placed directly beneath the running track. Digital temperature sensor offer advantages as very low energy demands (μA range (Texas Instruments, 2018)), low unit costs (approx. 2 € at batch size 1), robustness against environmental influences, and simple data processing. Compared to established temperature measurement at the lubricant outlets of the plain bearing, bearing-integrated temperature sensors

1640

1645 offer the advantage of a significantly reduced transfer path. This significantly increases the sensitivity of bearing-integrated temperature sensors to mixed friction and resulting damage. Accordingly, the minimized transfer path reduces the time required to detect a damage-critical condition.

The positioning of several temperature sensors around the circumference enables critical temperatures to be detected quickly, regardless of the operating point-dependent contact zone. In addition to direct temperature measurements itself,
1650 the lubrication gap height is another relevant monitoring parameter for plain bearings. The concept of the Gumbel curve (Deutsches Institut für Normung e.V., 2017), which is based upon the Reynolds equation, establishes a relationship between the input variable displacement angle of the shaft β and the output variable relative eccentricity ϵ . For steady-state operating conditions, the displacement angle β shows good agreement with the bearing angle to provide spatially resolved temperature data. By measuring the bearing angle $\phi_{T,\max}$ ($=\beta+180^\circ$), at which the maximum temperature
1655 occurs within the plain bearing (Baszenski et al., 2023). Measuring the bearing angle $\phi_{T,\max}$ thus enables temperature field-based, the system can determine the lubrication gap height determination via the Gumbel curve in the fluid friction range.

Knowing the lubricating film height in the fluid friction region allows conclusions to be drawn regarding the power loss in the plain bearing (Soni and Vakharia, 2014; Jiang et al., 2021). If lubricating film height falls below a threshold marking
1660 transition into mixed friction territory, resultant mixed friction causes localized temperature increases at points of contact. Therefore, spatially resolved temperature field measurement proves effective at detecting (Deutsches Institut für Normung e.V., 2017). This method is highly sensitive to transitions between fluid friction regions and mixed friction zones. Incipient damage within a plain bearing correlates with high heat input; this can be detected using appropriate temperature-based thresholds through in-situ temperature field measurement techniques before any rise in friction torque occurs solely due to localized
1665 increases in temperature, allowing for the detection of incipient damage before damage-critical conditions escalate (Paeßens et al., 2017). The TFM system achieves independence from external cabling by utilizing harvested waste heat for power and a Bluetooth low-energy interface for wireless data transmission.

Due to its extremely low energy demand, the TFM method is particularly suitable for use in planetary plain bearings in wind turbine gearboxes. Figure ?? shows a schematic diagram of the planetary plain bearing application.

1670 Autarkie TFM-prototype concept for planetary plain bearings in wind turbine gearboxes

In the project “PBMon” (Planetary Bearing Condition Monitoring System), the TFM concept alongside AE- and SAW-based monitoring will be transferred and combined to wind turbine applications in the coming months. The concept will be applied in a real-life large wind turbine gearbox by developing and implementing a prototype in the gearbox. The energy required to achieve autarky for the concept will be provided by electromechanical energy harvesters inside the gearbox
1675 in order to realize the energy autarky of the prototype over the entire lifetime of the wind turbine.

5.3.3 Oil debris monitoring

Oil debris monitoring (Sheng, 2016) refers to the continuous identification and trending of gearbox debris, including ferrous and non-ferrous, shed from contacting surfaces of these components or trapped through contamination and carried in the oil using an oil debris sensor. Whenever a ferrous or non-ferrous particle larger than a certain size passes through the sensor, the magnetic field formed inside the sensor is disturbed and an electric pulse is generated and counted. The counts over time represent the cumulative damage that occurred to the monitored components (e.g., bearings or gears inside of wind turbine gearboxes). The oil debris sensor can be installed in the main filtration loop or the side-stream (or kidney) filtration loop (relatively smaller bore size, slower flow rate and lower oil pressure than main filtration loop) permanently either before or after the oil pump, but always before the filter. The minimum detectable ferrous wear debris size for this type of sensor can be down to 100 micrometer (μm) and, for non-ferrous wear debris, down to 300 μm , if installed in the main filtration loop. If in the kidney loop, these can be reduced to about 30–50 μm for ferrous debris, and 130–150 μm for non-ferrous debris. Measurements of both ferrous and non-ferrous wear debris can be grouped into different size bins and trended, based on which different levels of alarms can be generated. The data can be processed alone or integrated with a vibration analysis system, offering a more comprehensive monitoring of the gearbox. With the advanced computing and modelling capabilities brought by AI/ML or digital twins, there are opportunities to gain additional benefits from oil debris monitoring.

5.4 Generator

Condition monitoring of electrical generators in wind turbines is a critical aspect of ensuring the reliability and efficiency of wind energy systems. As discussed in Section 2, generator faults contribute significantly to WT wind turbine downtime according to reliability studies. Geared turbines mainly use Doubly-Fed Induction Generators (DFIG) doubly-fed induction generators with a partial-power converter. This has been the most popular topology for medium-sized turbines ranging from 3–6 MW. In the context of direct-drive systems, low-speed and high-torque Permanent Magnet Synchronous (PMSG) permanent magnet synchronous generators are becoming increasingly attractive for offshore applications (Nejad et al., 2022). Diagnosing wind turbine generator faults in real-world applications is particularly challenging due to their rapid progression in uncontrolled environments with highly variable operating conditions. Despite growing concerns about the reliability of wind turbine electrical components and the increasing interest in EM condition monitoring based on electrical signals, monitoring generator electrical faults has yet to become standard practice in the wind industry.

Rotor winding unbalance, resulting from brush gear or slip-ring wear/faults or winding electrical faults, contributes significantly to the failure rate of wind turbine generators (Alewine and Chen, 2011; Liu et al., 2024a). Fault detection in Doubly-Fed Induction Generators (DFIGs) doubly-fed induction generators based on the analysis of high-frequency current, power or vibration signals has been extensively researched (Soares et al., 2018). Various diagnostic methods, using time-domain or frequency-domain techniques, have been proposed to identify rotor failures (Tavner et al., 2020; Liu et al., 2024a). Electrical signals contain a wealth of harmonic information that must be interpreted accurately to ensure a confident diagnosis. Among the proposed approaches, Current Signature Analysis (CSA) current signature analysis is a well-established, non-intrusive

diagnostic technique for monitoring and detecting faults in electrical machines by ~~analysing~~ analyzing the spectral characteristics of electrical signals (El Hachemi Benbouzid, 2000). ~~CSA-Current signature analysis~~ has been extensively researched for the detection of rotor asymmetry in induction machines operating under steady-state conditions, ranging from analytic explanations of the origins of fault frequencies ~~as in Yazidi et al. (2010); Gritli et al. (2011); (Yazidi et al., 2010; Gritli et al., 2011)~~ to investigations based on simulation and experimental data ~~as in Stefani et al. (2008); Gritli et al. (2013)~~ (Stefani et al., 2008; Gritli et al., 2013).

In the wind energy industry, electrical signal-based ~~CM-condition monitoring~~ has attracted significant attention due to its low capital investment requirements. Since electrical signals are readily available through existing wind turbine control and protection systems, there is no need for additional instrumentation. The potential of using high-frequency electrical signals for wind turbine generator fault detection, in some cases combined with mechanical drivetrain signals, has been explored and proved successful in several studies based on experimental data ~~such as in Zappalá et al. (2019); Brigham et al. (2020); Stone et al. (2023)~~ (Zappalá et al., 2019; Brigham et al., 2020; Stone et al., 2023) and complemented with real data from operating wind turbines ~~such as in Artigao et al. (2018a, 2020)~~ (Artigao et al., 2018a, 2020). Recent studies have explored novel approaches using SCADA data to assess the health of wind turbine generators. Despite the low sampling frequency of these signals, which limits the full interpretation of the complex dynamics of electrical phenomena of machines subjected to non-stationary conditions, these methods have demonstrated the potential to identify electrical faults (Zhao et al., 2017; Astolfi et al., 2019; Castellani et al., 2021; Jin et al., 2021; Wang et al., 2022a).

Stator winding insulation and connection faults, airgap eccentricity ~~and~~ demagnetization are among the most critical fault types observed in ~~PMSGs-permanent magnet synchronous generators~~ used in wind turbines. An exhaustive review of ~~CM-methods for PMSGs-condition monitoring methods for permanent magnet synchronous generators~~ proposed in the literature is provided in Freire and Cardoso (2021). However, there is still no consensus on the most effective approach for comprehensive fault detection and diagnosis. Winding insulation failures necessitate ~~an~~ immediate shutdown and unplanned corrective maintenance. Although winding insulation is critical to the operation of wind turbines, online condition monitoring technologies for detecting such failures remain at low levels of technological readiness. As a result, these technologies have not yet been widely deployed across turbine fleets.

5.5 Converter

The power converter, located between the generator and power grid, fulfils the requirements for both sides. In very general terms, the power converter ~~can be seen having has~~ two sections: generator-side and grid-side, ~~in which each section having~~. Each section has components such as ~~power module, a power module and a filter~~ interacting with the power converter control system. The DC link or capacitor ~~is connecting these two generator and grid-side together~~ connects the generator and grid sides (Nejad et al., 2022). Earlier works by Fischer et al. (2019, 2014) indicate that the power module is one of the components most likely to fail. Tartt et al. (2022) investigated the power converter failure of about 400 turbines in different countries. The results show ~~converter-control Units~~ the highest failure rates in converter control units (30%), grid-side power module (25%), and

generator-side power module (21%)~~with the highest failure rate~~. It is also interesting to observe that the same type of converter failed differently in different countries (Tartt et al., 2022).

5.6 Blades and rotor subcomponents

1745 Although catastrophic blade failure is relatively rare, blade failures of varying degrees are not uncommon and ~~wear-through~~ wear-through erosion will occur throughout the lifetime of a blade. ~~There are estimated to be around~~ An estimated 3800 blade failures occur per year globally (Mishnaevsky, 2022). This number of failures equates to a failure rate of approximately 0.016 per turbine per year. For a 100-turbine wind farm operating for 25 years, this means on average 40 blade failures can be expected throughout its the farm's lifetime. Sources of blade damage include ~~trailing edge cracks~~, leading-edge erosion, lightning damage, delamination and other cracks on the surface of the blade (Wang et al., 2022b). Blade damage through erosion can lead to a reduction in rotor efficiency and energy yield. External and internal cracks can ultimately lead to serious structural damage warranting major repairs or replacement. Early detection of problems is thus important. Blade monitoring can be carried out in several ways (Du et al., 2020; Ding et al., 2023):

- Visual inspection by eye or using cameras to inspect external damage.
- 1755 – Infrared cameras using thermography to detect external or internal damage.
- Acoustic emission measurements using an exciter and microphones mounted on external or internal surfaces to detect cracking.
- Strain measurements using foil or ~~fibre-optic type~~ fibre-optic-type sensors.
- Microphones placed within or outside the blade structure.
- 1760 – Ultrasound measurements using a transducer and detector acoustically coupled to the blade to detect cracks.
- Vibrometry using a transducer to excite the blade and a detection technique, e.g., accelerometer or laser-based, to measure changes to the blade response due to potential damage.
- X-ray and T-ray scanning of the blades using drones to detect internal damage.

Of these techniques, only visual inspections are routinely carried out ~~often by technicians climbing blades though increasingly~~ by technicians either by climbing blades or using drones. The other techniques listed above have been tested in the lab or ~~in~~ field, but only recently have commercial systems started to become available.

5.6.1 Visual techniques

The detection of external damage through visual measurements or inspection has until recently relied on human experience in the field with technicians climbing up the outside or within the structure of a blade to take photographic images and inspect

1770 damage. However, ~~machine-learning~~ ML algorithms have been developed to automate visual damage detection (Sheiati et al.,
2024). This, aided by the advent of low-cost ~~Unmanned Aerial Vehicles (UAVs)~~ unmanned aerial vehicles or drones, has
opened up the field of detailed visual inspection and damage detection in wind turbine blades (Xu et al., 2019; Zhang et al.,
2020). Such techniques can be effective in detecting and locating external damage ~~;~~ but are not so useful in detecting internal
blade problems. Moreover, they generally require the turbine rotor to be stationary whilst a ~~UAV~~ drone is flown around the
1775 turbine to record images.

5.6.2 Thermography

Thermographic imaging, using infrared cameras, can be useful for detecting both external and internal blade anomalies.
Damage within a blade such as cracking or de-bonding leads to thermal discontinuities. When the structure of the blade is
heated by the sun or cools at night, this can lead to ~~“hot-spots” around these discontinuities~~ around the discontinuities,
1780 which can be detected by a thermal imaging device close to the blade. Furthermore, if the blade is cyclically stressed during
operation, these hot spots may be enhanced. By appropriate analysis of the infrared images, different types of damage can be
detected (Lizaranzu et al., 2015). There are challenges in using this technique in the field which require some degree of image
processing (Doroshtnasir et al., 2016) but ~~machine-learning~~ ML techniques offer a potential way to enhance the detection of
damage (Yu et al., 2023). Changes to the surface of a blade due to damage such as erosion lead to changes in the characteristics
1785 of the flow. This gives rise to turbulence patterns which can be imaged in the infrared spectrum using a thermal camera. The
detection of these patterns can be automated using AI techniques (Chaudhuri et al., 2025).

5.6.3 Strain measurements

Damage to the structure of a blade can give rise to changes in the local stiffness of the surrounding material. Under loading,
this can change the local deformation and thus the strain experienced. Measurements of the strain at targeted locations along
1790 the blade where damage might be expected to occur could then be used as a way to detect damage. Such measurements can be
made using foil strain gauges whose resistance change is related to the local change in strain which can be measured electrically
with a suitable bridge circuit or fibre Bragg diffraction gratings (FBGs) etched at periodic distances within a fibre glass filament
attached to the surface of a blade. When a light source is passed down the filament, each grating passes all but a very narrow
band of frequencies which depend on the strain local to the FBG which are ~~back-reflected~~ back-reflected and can be measured
1795 using a suitable optical detection system. Each FBG is designed to reflect within a unique frequency range so that strain at
different locations along the blade can be made simultaneously. Foil or FBG-based strain measurement systems have been
shown to be able to detect local blade damage (Sierra-Pérez et al., 2016; Schroeder et al., 2006; Kristensen et al., 2002). The
drawbacks of such systems is that the strain gauges are also sensitive to temperature change so that some form of temperature
compensation measurement is required and the strain gauges will only detect damage if it causes changes to the strain close to
1800 the location of the gauge. The latter limitation can be overcome to some extent by using strain measurements along the blade
to look at changes to the characteristic mode shapes of the blade which can change in response to ~~localised~~ localized damage
(Khoshmanesh et al., 2023). It is nonetheless still challenging to infer the location of damage using this approach.

5.6.4 Acoustic emission

Cracks in the material of a blade resulting from damage when stress is applied to the structure release energy which is dissipated through the structure in the form of elastic waves with frequencies in the ultrasonic range. By the placing of appropriate acoustic sensors on the surface of the blades, these waves can be detected (Joosse et al., 2002; Tang et al., 2016). By using multiple sensors, the signals can be triangulated to locate the origin of the crack-induced sound waves (Khoshmanesh et al., 2024). By appropriate analysis of the signals received using ~~time-domain or frequency-domain~~ time-domain or frequency-domain techniques, it is possible to differentiate different types of damage such as fibre breaking, matrix cracking and de-bonding (Arumugam et al., 2011). This technique requires the placing of sensors within the blade which may not be straightforward if done post-construction once the blade is in service.

5.6.5 Microphones

Three types of blade monitoring using microphones have been tested. The first is an active technique where speakers are placed within a blade and the sound emitted measured using external microphones (Aizawa et al., 2015; Poozesh et al., 2017). This relies on the sounds being modulated or less attenuated by the presence of cracks in the blade structure. The second is a passive technique where microphones are placed within the blade (Traylor et al., 2020; Solimine et al., 2020; Beale et al., 2020). This relies on changes to the sound detected being driven by wind flow over the blade as it moves over or through cracks in the structure. These first two techniques require equipment to be placed within the blade and as such are challenging to be used at scale in the field. A third which is entirely remote is a passive aeroacoustic measurement technique which uses remote microphones only and measures changes to the far-field sound spectrum resulting from changes to the wind flow over a blade which may be modified by cracks (e.g., trailing edge) or surface damage such as erosion (Zhang et al., 2022, 2023b). This technique has been tested under laboratory conditions on a small scale but is yet to be tested in the field.

5.6.6 Ultrasound

The use of ultrasonic ~~guide~~ waves for blade monitoring employs a transducer attached to the blade surface which produces ultrasonic pulses that travel within the laminate structure and whose characteristics can be measured at another location on the blade using a detector. The ultrasonic wave propagation is affected by cracks in the surface material or dirt on the blade surface. By suitable signal processing and the use of ~~machine learning~~ ML, the received pulses can be used to detect dirt build-up (Arcos Jiménez et al., 2019) or damage in the blade material (Muñoz et al., 2019). This technique can detect damage relatively close to the position of the receiver (a few metres) but requires the receiver to be moved over the blade surface for effective monitoring. Furthermore, as the propagation of the waves is restricted within the confines of the material sheet being examined, it may not be so suitable for monitoring damage further inside the blade, e.g., within the spar.

5.6.7 Vibrometry

The characteristic mode shapes of a blade, as mentioned in ~~Section~~Sect. 5.6.3, can be used as a way of detecting damage as they can be modified due to changes in stiffness resulting from cracks, for example. Aside from using strain gauges, instrumenting the blades with accelerometers or scanning the blade-structure with a laser can ~~give a measure of how the blade vibrates along its length when it is excited, e.g. using a surface mounted actuator or by the wind~~ characterize vibration along the blade's length when excited by a surface-mounted actuator or wind loading. By processing the data, it is then possible to infer the blade vibrational modes and monitor changes over time. In the case of a laser, a common technique to measure the motion of the blade is to measure the Doppler shifting of the laser light after it is back-scattered off the blade surface to a detector. Laser Doppler ~~Vibrometry (LDV)~~ vibrometry has been used, for example, to detect delamination in a ~~small scaled~~ small-scale model blade in the laboratory using wavelets to process the data (Łukasz Doliński et al., 2018). Changes to the mode shapes were seen which allowed damage to be detected and ~~localised~~ localized, but changes were small. In addition, changes could only be seen where the largest movements related to a mode shape were observed. This would represent a challenge if damage were located close to a mode shape node where levels of vibration are small.

1845 5.6.8 X-rays and T-rays

The use of X-rays to scan the interior of wind turbine blades to detect damage is quite new. Two drones are flown in tandem where one generates a beam of X-rays which are focused on the blade, and the second drone has an X-ray detector. Commercial systems have been developed such as SpectX (SpectX) which uses AI techniques to process X-ray images to provide a scanned image of the interior of a blade and ~~localise~~ localize potential sources of damage. A similar idea has been developed to inspect lightning conductors in blades which may have been damaged by a strike (Lee et al., 2024a). The use of terahertz waves, or T-rays, which have widely been used in food safety, package imaging and airport security, has been investigated in the laboratory for blade imaging (Im et al., 2019). Similar to X-rays, the system uses a source of T-rays which is projected through the blade, and the resulting transmitted radiation is detected by an imaging system. The system was tested for scanning the trailing edge of a blade in the laboratory but so far has not been used to detect damage.

1855 5.6.9 Overall outlook for blade monitoring

Although there a multitude of methods that can potentially be used for wind turbine blade monitoring, many of them are, as yet, impractical to use in the field or not tested at ~~full-scale~~ full scale. At present, the most promising are using drones for visual, infrared and X-ray inspection. In the future, we are likely to see the use of a combination of different technologies and a preference for those technologies that can be used remotely rather than require sensors attached to the blades. ~~Artificial intelligence~~ AI will be used increasingly to process and interpret the data from multiple scanning technologies to provide the best estimate of the health of a blade and its potential ~~remaining useful life~~ RUL.

6 O&M strategies and maintenance planning

Outputs from various monitoring, modelling, and analysis methods discussed earlier can be used to improve or optimize O&M practices in the wind industry. For a typical wind plant, there are tens or hundreds of turbines, which have multiple mission-critical (e.g., costly or high downtime) components that should be key focus areas for condition monitoring. Condition-based maintenance, predictive (e.g., enabled by RUL prediction) maintenance, or prescriptive (e.g., enabled by root cause analysis and recommended mitigation) maintenance (Paquette et al., 2024) should be applied to these components whenever feasible. Needed research can be conducted by following a prognostics and health management framework (She, 2019), which has proved its benefits in mature applications, e.g., aviation, automotive, and manufacturing. For ~~non-mission-critical~~ non-mission-critical components, a reactive maintenance may be adopted at a land-based plant. For offshore, even a small component failure, that may be relatively cheap or quick to fix on a land-based plant, can become expensive due to the increased challenge ~~with~~ of accessibility.

With the estimated RUL for components of interest being available, the maintenance planning can consider various factors such as supply chain constraints, vessel and/or crane and crew availability, wind and wave conditions, weather forecasts, etc. This helps enable timely interventions and potentially avoid or minimize costly corrective maintenances and production loss due to increased downtime. With cost and crew data defined for different levels of faults and corresponding maintenance actions, the monitoring including modelling and analysis strategy with the maximum savings or highest energy outputs can be chosen from various candidates (Hammond and Cooperman, 2022; Barber et al., 2022). One platform that can support this selection is Windfarm Operations and Maintenance cost-Benefit Analysis Tool (WOMBAT), which is a software package developed by ~~NREL~~ the National Laboratory of the Rockies for offshore wind O&M innovation technology evaluations, such as condition monitoring solutions, and it can also be tailored for land-based wind plant O&M innovation assessments.

The industry has widely adopted reliability engineering life data analysis ~~(?)~~ (Sheng and O'Connor, 2023) approaches for maintenance scheduling at a plant or a fleet. A prerequisite for this type of analysis is enough historical life data of interested components and it may be only feasible for older turbine models or wind plants. For newer turbine models or plants, the life cycle data gap could potentially be filled through simulations based on advanced modelling technologies, e.g., digital twins enabled by condition monitoring (Helsen et al., 2017b; Perez-Sanjines et al., 2023; Kestel et al., 2025).

7 Conclusion

The transition toward more sustainable and cost-effective energy production has placed wind energy at the forefront of Europe's green-energy strategy. A crucial step in achieving this energy vision lies in improving the reliability and efficiency of wind turbine systems, particularly through enhanced maintenance strategies. This paper provides a critical overview and positioning of current approaches, technologies, and research challenges associated with these capabilities in wind turbine systems, focusing especially on drivetrain components.

7.1 Summary

1895 The rapid deployment of wind energy systems, driven by EU's green energy policy, demands greater efficiency and reduced costs. A significant portion of wind farm expenditures is attributed to O&M, particularly for offshore systems. Within O&M, the drivetrain is one of the most EU policy, requires advanced maintenance strategies to mitigate the high O&M costs associated with the drivetrain, the subsystem most prone to failure and maintenance-intensive subsystems. Hence, CM is identified as an essential tool in reducing unplanned downtime, preventing catastrophic failures, and optimizing maintenance logistics (e.g., scheduling crane or vessel trips).

1900 The paper distinguishes between reactive, time-based, and condition-based maintenance strategies, while stating condition-based maintenance strategies as a more effective strategy. Various sensing and data acquisition technologies, including SCADA systems, vibration sensors, oil debris analysis. This paper has evaluated a spectrum of sensing technologies, highlighting a critical transition from low-frequency SCADA trend analysis toward continuous, high-frequency vibration, acoustic emission, and electrical signature analysis allow for a wide variety of CM approaches. The value of continuous monitoring is emphasized over periodic inspections, particularly given the intermittent and transient nature of early fault signatures, to capture transient fault signatures. A central finding of this review is the multi-scale nature of drivetrain data: effective monitoring must balance long-duration sampling to capture full cycles of slow-rotating main bearings with high-frequency resolution for transient gearbox faults.

1910 While diagnostics informs the operators about the state of the machine, prognostics estimate how long drivetrains can continue operating safely before a failure occurs. Despite strong interest from academia, RUL estimation is still lacking the expected interest in industry due to challenges in accuracy the industrial adoption of prognostics and estimation RUL remains limited by challenges in precision, uncertainty quantification, and lack of trust in the "explainability gap" of black-box models. However, its potential benefits, such as optimizing repair schedule and improving component utilization, are significant. A promising tool is the use of Digital Twins (DTs), which can virtually replicate the turbine system in real time. AI models. To bridge this gap, digital twins and hybrid physics-informed models are identified as essential tools to address data sparsity and enhance predictive reliability. The paper elaborates on different DT the necessary evolution of digital twin capability levels, ranging from descriptive to autonomous systems, and introduces the concept of Digital Shadows and true Digital Twins. Incorporating simulated data and physics-based modelling into DTs addresses the data sparsity issue and enhances predictive capabilities the integration of simulated data to model rare or extreme failure modes.

1920 Despite the recent developments in sensor technology, the wind industry faces significant challenges for effective drivetrain monitoring due to. Ultimately, the realization of the wind industry's full monitoring potential is hindered by structural barriers, including proprietary data access, privacy concerns, and lack of standardization. The industry produces a significant volume of data from its numerous turbines; however, the problems discussed hinder the realization of its full potential. Several mitigating strategies are proposed, such as data anonymization, standardization (FAIR principles), and a lack of cross-platform standardization. Proposed mitigating strategies include international standardization and the adoption of anonymized sharing

platforms (e.g., NREL National Laboratory of the Rockies's Gearbox Reliability Database, EPRI's WinNER platform) .
1930 ~~The paper also underscores the importance of properly labelled to facilitate collaborative research. Furthermore, the review underscores the critical need for properly labeled and annotated datasets ,essential for techniques like supervised learning models. Imbalanced datasets, with far more healthy than faulty cases, remain a recurring challenge for training robust AI to overcome the inherent imbalance between healthy and faulty operational data, which remains a recurring obstacle to training robust, field-ready AI models.~~

7.2 Remarks

- 1935 ~~– Combining~~ The integration of physics-based models with data-driven techniques offers the best of both worlds, interpretability and flexibility. These methods can help address provides a robust framework that balances interpretability with flexibility. Such hybrid approaches are instrumental in addressing data scarcity and generalization issues, especially in cases improving generalization, particularly in scenarios with limited failure data.
- 1940 ~~– As~~ CM condition monitoring and RUL tools are increasingly used/ utilized for high-stakes operational decisions, there is a pressing need/ an urgent requirement for models that provide uncertainty quantification, interpretability, and transparency. The paper highlights the risk of over-relying on “transparent uncertainty quantification. The industry must avoid an over-reliance on “black-box” AI methods without sufficient validation/ comprehensive validation to mitigate operational risks.
- 1945 ~~– True progress in CM and RUL estimation requires collaborative frameworks involving OEMs, operators, academia, and regulators. The paper positions initiatives like IEA Wind Task 43 as essential platforms to advance standardization and digital maturity across the sector.~~
- 1950 ~~– Future~~ CM systems must be computationally efficient, scalable across farms, and able condition monitoring systems must prioritize computational efficiency and scalability to provide actionable insights in real-time ~~or near-real-time~~. Edge . Key technological enablers for this transition include edge computing, cloud-based architectures, and modern database solutions ~~are enablers in this direction.~~
- 1955 ~~– While single-turbine models offer~~ precision, high precision, the development of cross-turbine ~~or and~~ farm-wide models allow for broader insights and anomaly detection facilitates broader insights through comparative analytics. ~~Transfer~~ Innovations such as transfer learning and fleet-wide normal behaviour models ~~are promising innovations~~ represent a significant shift toward more robust, context-aware monitoring.
- ~~– Advanced signal processing techniques are essential part of the vibration and acoustic-based condition monitoring of the rotating components of the drivetrains. Techniques like~~ At the component level, advanced signal processing remains the bedrock of effective drivetrain monitoring. Techniques such as order tracking, envelope analysis, and cepstral editing ~~enable the detection of weak or hidden fault signals, especially in complex, nonstationary environments such as~~

~~wind turbine~~ are vital for isolating weak fault signatures within the complex, non-stationary vibration environments characteristic of gearboxes and bearings.

- 1960 – ~~Deep~~ Although deep learning, autoencoders, ~~ensemble methods~~, and generative models have shown ~~strong performance in~~ fault detection. However, they demand impressive diagnostic performance, their success is contingent upon high-quality data, ~~domain knowledge, and precise and domain-specific~~ tuning. The “~~explainability gap~~” explainability gap in AI remains a ~~concern for adoption~~ significant barrier to industrial adoption that must be systematically addressed.
- 1965 – Ultimately, progress in this field necessitates collaborative frameworks involving O&Ms, operators, academia, and regulators. International industry-led initiatives are essential platforms for advancing the standardization and digital maturity required across the sector.

This positioning paper highlights the essential role of ~~the condition monitoring of the~~ condition monitoring for drivetrain components in the wind energy sector’s future. It ~~is~~ serves as both a technical roadmap and a strategic vision which aims to be useful for intended to guide researchers, engineers, and policymakers.

- 1970 As wind farms become larger, more remote, and ~~more increasingly~~ complex, smart maintenance strategies enabled by ~~CM~~ condition monitoring will become indispensable. However, unlocking their full value requires not only technological innovation but also fundamental cultural, organizational, and regulatory shifts. This paper invites the entire ecosystem to collaborate in driving that transformation.

. No datasets or code were utilized in this article.

- 1975 . The paper was conceived within the EAWC Drivetrain Committee, with contributions from its members. All listed co-authors contributed to the writing of the paper, generation of content, and provision of figures and images. The editing and structuring of the paper were carried out by KK, YV, DZ, EH, XC, and JH.

. Yolanda Vidal, Yi Guo, Amir R. Nejad, and Shawn Sheng are members of the editorial board of Wind Energy Science.

- 1980 . This work was authored in part by the National Laboratory of the Rockies for the U.S. Department of Energy (DOE), operated under Contract No. DE-AC36-08GO28308. Funding provided by U.S. Department of Energy Critical Minerals and Energy Innovations Integrated Energy Systems Office. The views expressed in the article do not necessarily represent the views of the DOE or the U.S. Government. The U.S. Government retains and the publisher, by accepting the article for publication, acknowledges that the U.S. Government retains a nonexclusive, paid-up, irrevocable, worldwide license to publish or reproduce the published form of this work, or allow others to do so, for U.S. Government purposes.

1985 . The authors would like to acknowledge ~~FWO (Fonds Wetenschappelijk Onderzoek)~~ FOD Economy for their support through ~~ETF Energy~~ Transition Fund project SWIFT. They also acknowledge VLAIO for their support in the context of the Blue Cluster, for the ICON project Supersized 5.0 and the cSBO project CORE. This research was also supported by funding from the Flemish Government under the 'Onderzoeksprogramma Artificiële Intelligentie (AI) Vlaanderen' program.

1990 The authors would like to sincerely thank the state of North Rhine-Westphalia and the European Union for funding the research project AEsy as part of the Start-up Transfer, NRW funding program. The authors would also like to thank COST Action CA23155 (OTC), supported by COST (European Cooperation in Science and Technology), as well as the Research Association for Drive Technology FVA (Forschungsvereinigung Antriebstechnik e.V.) for funding project FVA 878 II. The authors also gratefully acknowledge the German Federal Ministry for Economic Affairs and Climate Action for funding the project CyPhEs-Sens (KK5211204).

1995 Edward Hart is funded by an EPSRC Innovation Launchpad Network+ Researcher in Residence Fellowship (EP/W037009/1), a collaboration with the Offshore Renewable Energy Catapult.

This work is partially funded by: (i) grant PID2021-122132OB-C21 funded by and by “ERDF A way of making Europe”, by the European Union; (ii) grant TED2021-129512B-I00 funded by MCIN/AEI/10.13039/5011000110-33 and by the European Union NextGenerationEU/PRTR; (iii) grant 2021-SGR-01044 funded by the Generalitat de Catalunya.

References

- 2000 Statistics Show Bearing Problems Cause the Majority of Wind Turbine Gearbox Failures, <https://grd.nrel.gov/stats>, 2016.
- A Prognostics and Health Management Framework for Wind, vol. Volume 9: Oil and Gas Applications; Supercritical CO2 Power Cycles; Wind Energy of *Turbo Expo: Power for Land, Sea, and Air*, <https://doi.org/10.1115/GT2019-91533>, 2019.
- Abhimanyu, G.: Colossal 20-MW wind turbine is the largest on the planet (for now), <https://newatlas.com/energy/world-largest-offshore-wind-turbine-20-mw-mingyang/>, 2024.
- 2005 Aizawa, K., Poozesh, P., Niezrecki, C., Baqersad, J., Inalpolat, M., and Heilmann, G.: An acoustic-array based structural health monitoring technique for wind turbine blades, vol. 9437, <https://doi.org/10.1117/12.2084276>, 2015.
- Al-Hussain, K. and Redmond, I.: Dynamic response of two rotors connected by rigid mechanical coupling with parallel misalignment, *Journal of Sound and vibration*, 249, 483–498, 2002.
- Alewine, K. and Chen, W.: A review of electrical winding failures in wind turbine generators, in: 2011 Electrical Insulation Conference (EIC), pp. 392–397, IEEE, <https://doi.org/10.1109/EIC.2011.5996185>, 2011.
- 2010 Ali Qadri, B., Ulriksen, M., Damkilde, L., and Tcherniak, D.: Cointegration for Detecting Structural Blade Damage in an Operating Wind Turbine: An Experimental Study, pp. 173–180, ISBN 978-3-030-12114-3, https://doi.org/10.1007/978-3-030-12115-0_23, 2020.
- Allal, Z., Noura, H. N., Vernier, F., Salman, O., and Chahine, K.: Wind turbine fault detection and identification using a two-tier machine learning framework, *Intelligent Systems with Applications*, 22, 200 372, 2024.
- 2015 André, H., Leclère, Q., Anastasio, D., Benaïcha, Y., Billon, K., Birem, M., Bonnardot, F., Chin, Z., Combet, F., Daems, P.-J., et al.: Using a smartphone camera to analyse rotating and vibrating systems: Feedback on the SURVISHNO 2019 contest, *Mechanical systems and signal processing*, 154, 107 553, 2021.
- Antoni, J.: Cyclic spectral analysis in practice, *Mechanical Systems and Signal Processing*, 21, 597–630, 2007a.
- Antoni, J.: Fast computation of the kurtogram for the detection of transient faults, *Mechanical systems and signal processing*, 21, 108–124, 2007b.
- 2020 Antoni, J.: Cyclostationarity by examples, *Mechanical Systems and Signal Processing*, 23, 987–1036, 2009.
- Antoni, J. and Borghesani, P.: A statistical methodology for the design of condition indicators, *Mechanical Systems and Signal Processing*, 114, 290–327, 2019.
- Antoni, J. and Randall, R.: Differential diagnosis of gear and bearing faults, *J. Vib. Acoust.*, 124, 165–171, 2002.
- 2025 Antoni, J. and Randall, R.: A stochastic model for simulation and diagnostics of rolling element bearings with localized faults, *J. Vib. Acoust.*, 125, 282–289, 2003.
- Antoni, J. and Randall, R. B.: The spectral kurtosis: application to the vibratory surveillance and diagnostics of rotating machines, *Mechanical Systems and Signal Processing*, 20, 308–331, <https://doi.org/10.1016/j.ymsp.2004.09.002>, 2006.
- Antoni, J., Bonnardot, F., Raad, A., and El Badaoui, M.: Cyclostationary modelling of rotating machine vibration signals, *Mechanical systems and signal processing*, 18, 1285–1314, 2004.
- 2030 Antoni, J., Xin, G., and Hamzaoui, N.: Fast computation of the spectral correlation, *Mechanical systems and signal processing*, 92, 248–277, 2017.
- Antoni, J., Kestel, K., Peeters, C., Leclère, Q., Girardin, F., Ooijevaar, T., and Helsen, J.: On the design of Optimal Health Indicators for early fault detection and their statistical thresholds, *Mechanical Systems and Signal Processing*, 218, 111 518, 2024.
- 2035 Archard, J. F.: Contact and Rubbing of Flat Surfaces, *Journal of Applied Physics*, 24, 981–988, <https://doi.org/10.1063/1.1721448>, 1953.

- Arcos Jiménez, A., Gómez Muñoz, C. Q., and García Márquez, F. P.: Dirt and mud detection and diagnosis on a wind turbine blade employing guided waves and supervised learning classifiers, *Reliability Engineering System Safety*, 184, 2–12, <https://doi.org/10.1016/j.res.2018.02.013>, *Impact of Prognostics and Health Management in Systems Reliability and Maintenance Planning*, 2019.
- 2040 Artigao, E., Honrubia-Escribano, A., and Gomez-Lazaro, E.: Current signature analysis to monitor DFIG wind turbine generators: A case study, *Renewable Energy*, 116, 5–14, 2018a.
- Artigao, E., Martín-Martínez, S., Honrubia-Escribano, A., and Gómez-Lázaro, E.: Wind turbine reliability: A comprehensive review towards effective condition monitoring development, *Applied energy*, 228, 1569–1583, 2018b.
- Artigao, E., Honrubia-Escribano, A., and Gómez-Lázaro, E.: In-Service Wind Turbine DFIG Diagnosis Using Current Signature Analysis, *IEEE Transactions on Industrial Electronics*, 67, 2262–2271, 2020.
- 2045 Arumugam, V., Sajith, S., and Stanley, A. J.: Acoustic Emission Characterization of Failure Modes in GFRP Laminates Under Mode I Delamination, *Journal of Nondestructive Evaluation*, 30, 213–219, <https://doi.org/10.1007/s10921-011-0109-5>, 2011.
- Astolfi, D., Castellani, F., and Terzi, L.: Fault prevention and diagnosis through SCADA temperature data analysis of an onshore wind farm, *Diagnostyka*, 15, 2014.
- 2050 Astolfi, D., Castellani, F., and Natili, F.: Wind turbine generator slip ring damage detection through temperature data analysis, *Diagnostyka*, 20, 3–9, 2019.
- Auerswald, C.: Mikromechanischer Körperschall-Sensor zur Strukturüberwachung, Dissertation, TU Chemnitz, Chemnitz, 2016.
- Aydemir, G. and Acar, B.: Anomaly monitoring improves remaining useful life estimation of industrial machinery, *Journal of Manufacturing Systems*, 56, 463–469, <https://doi.org/10.1016/j.jmsy.2020.06.014>, 2020.
- 2055 Bajric, R., Zuber, N., Skrimpas, G. A., and Mijatovic, N.: Feature extraction using discrete wavelet transform for gear fault diagnosis of wind turbine gearbox, *Shock and Vibration*, 2016, 6748 469, 2016.
- Bangalore, P. and Tjernberg, L. B.: Self evolving neural network based algorithm for fault prognosis in wind turbines: A case study, in: 2014 International Conference on Probabilistic Methods Applied to Power Systems (PMAPS), pp. 1–6, 2014.
- Bangalore, P. and Tjernberg, L. B.: An Artificial Neural Network Approach for Early Fault Detection of Gearbox Bearings, *IEEE Transactions on Smart Grid*, 6, 980–987, <https://doi.org/10.1109/TSG.2014.2386305>, 2015.
- 2060 Bangalore, P., Letzgun, S., Karlsson, D., and Patriksson, M.: An artificial neural network-based condition monitoring method for wind turbines, with application to the monitoring of the gearbox, *Wind Energy*, 20, 1421–1438, 2017.
- Bao, C., Zhang, T., Hu, Z., Feng, W., and Liu, R.: Wind turbine condition monitoring based on improved active learning strategy and KNN algorithm, *IEEE Access*, 11, 13 545–13 553, 2023.
- 2065 Barber, S., Lima, L. A. M., Sakagami, Y., Quick, J., Latiffianti, E., Liu, Y., Ferrari, R., Letzgun, S., Zhang, X., and Hammer, F.: Enabling Co-Innovation for a Successful Digital Transformation in Wind Energy Using a New Digital Ecosystem and a Fault Detection Case Study, *Energies*, 15, <https://doi.org/10.3390/en15155638>, 2022.
- Barnabei, V. F., De Girolamo, F., Ancora, T. C., Tieghi, L., Delibra, G., Corsini, A., et al.: Normal behaviour modeling of hawt fleets using scada-based feature engineering, in: Proceedings of Global Power & Propulsion Society, Global Power and Propulsion Society, 2024.
- 2070 Baszenski, T., Kauth, K., Kratz, K.-H., Gutiérrez Guzmán, F., Jacobs, G., and Gemmeke, T.: Sensor integrating plain bearings: design of an energy-autonomous, temperature-based condition monitoring system, *Forschung im Ingenieurwesen*, 87, 441–452, <https://doi.org/10.1007/s10010-023-00642-1>, 2023.

- Beale, C., Inalpolat, M., and Niezrecki, C.: Active acoustic damage detection of structural cavities using internal acoustic excitations, *Structural Health Monitoring*, 19, 48–65, <https://doi.org/10.1177/1475921719835761>, 2020.
- 2075 Bechhoefer, E. and Kingsley, M.: A review of time synchronous average algorithms, in: *Annual Conference of the PHM society*, vol. 1, 2009.
- Bechhoefer, E., Qu, Y., Zhu, J., and He, D.: Signal processing techniques to improve an acoustic emissions sensor, in: *Annual Conference of the PHM Society*, vol. 5, 2013.
- Bejger, A., Frank, E., and Bartoszko, P.: Failure analysis of wind turbine planetary gear, *Energies*, 14, 6768, 2021.
- Beretta, M., Julian, A., Sepulveda, J., Cusidó, J., and Porro, O.: An Ensemble Learning Solution for Predictive Maintenance of Wind Turbines
2080 Main Bearing, *Sensors*, 21, 1–20, 2021a.
- Beretta, M., Vidal, Y., Sepulveda, J., Porro, O., and Cusidó, J.: Improved ensemble learning for wind turbine main bearing fault diagnosis, *Applied Sciences*, 11, 7523, <https://www.mdpi.com/2076-3417/11/16/7523>, 2021b.
- Beretta M., Cárdenas J., K. C. and J., C.: Wind Fleet Generator Fault Detection via SCADA Alarms and Autoencoders, *Applied Sciences*, 10, 2020.
- 2085 Bermúdez, K., Ortiz-Holguin, E., Tutivén, C., Vidal, Y., and Benalcázar-Parra, C.: Wind Turbine Main Bearing Failure Prediction using a Hybrid Neural Network, *Journal of Physics: Conference Series*, 2265, 032 090, 2022.
- Black, I. M., Richmond, M., and Kolios, A.: Condition monitoring systems: a systematic literature review on machine-learning methods improving offshore-wind turbine operational management, *International Journal of Sustainable Energy*, 40, 923–946, 2021.
- Black, I. M., Cevalco, D., and Kolios, A.: Deep Neural Network Hard Parameter Multi-Task Learning for Condition Monitoring of an
2090 Offshore Wind Turbine, *Journal of Physics: Conference Series*, 2265, 032 091, 2022.
- Bodla, M. K., Malik, S. M., Rasheed, M. T., Numan, M., Ali, M. Z., and Brima, J. B.: Logistic regression and feature extraction based fault diagnosis of main bearing of wind turbines, in: *Proceedings of the 2016 IEEE 11th Conference on Industrial Electronics and Applications*, pp. 1628–1633, Hefei, China, 2016.
- Borghesani, P. and Antoni, J.: A faster algorithm for the calculation of the fast spectral correlation, *Mechanical Systems and Signal
2095 Processing*, 111, 113–118, 2018.
- Borghesani, P., Pennacchi, P., Randall, R., and Ricci, R.: Order tracking for discrete-random separation in variable speed conditions, *Mechanical Systems and Signal Processing*, 30, 1–22, 2012.
- Boudraa, A.-O., Cexus, J.-C., Salzenstein, F., and Guillon, L.: IF estimation using empirical mode decomposition and nonlinear Teager energy operator, in: *First International Symposium on Control, Communications and Signal Processing, 2004.*, pp. 45–48, IEEE, 2004.
- 2100 Bray, A., Clifton, A., Sempreviva, A. M., Enevoldsen, P., Fields, J., Purdue, M., Williams, L., and Barber, S.: IEA Wind Task 43: Grand Challenges in the Digitalisation of Wind Energy, <https://windeurope.org/tech2022/>, windEurope Technology Workshop 2022: Resource Assessment & Analysis of Operating Wind Farms; Conference date: 23-06-2022 through 24-06-2022, 2021.
- Brigham, K., Zappalá, D., Crabtree, C., and Donaghy-Spargo, C.: Electrical mechanical diagnostic indicators of wind turbine induction generator rotor faults, *Wind Energy*, 23, 1135–1144, 2020.
- 2105 Buzzoni, M., Antoni, J., and D'Elia, G.: Blind deconvolution based on cyclostationarity maximization and its application to fault identification, *Journal of Sound and Vibration*, 432, 569–601, <https://doi.org/10.1016/j.jsv.2018.06.055>, 2018.
- Cambron, P., Masson, C., Tahan, A., and Pelletier, F.: Control chart monitoring of wind turbine generators using the statistical inertia of a wind farm average, *Renewable Energy*, 116, 88–98, <https://doi.org/10.1016/j.renene.2016.09.029>, real-time monitoring, prognosis and resilient control for wind energy systems, 2018.

- 2110 Campoverde, L., Tutivén, C., Vidal, Y., and Benaláazar-Parra, C.: SCADA Data-Driven Wind Turbine Main Bearing Fault Prognosis Based on Principal Component Analysis, *Journal of Physics: Conference Series*, 2265, 032 107, 2022.
- Cannarile, F., Baraldi, P., and Zio, E.: An evidential similarity-based regression method for the prediction of equipment remaining useful life in presence of incomplete degradation trajectories, *Fuzzy Sets and Systems*, 367, 36–50, <https://doi.org/10.1016/j.fss.2018.10.008>, theme: Uncertainty Management, 2019.
- 2115 Carbajal-Hernández, J. J., Sánchez-Fernández, L. P., Hernández-Bautista, I., Medel-Juárez, J. d. J., and Sánchez-Pérez, L. A.: Classification of unbalance and misalignment in induction motors using orbital analysis and associative memories, *Neurocomputing*, 175, 838–850, 2016.
- Carroll, J., McDonald, A., and McMillan, D.: Failure rate, repair time and unscheduled O&M cost analysis of offshore wind turbines, *Wind energy*, 19, 1107–1119, 2016.
- 2120 Castellani, F., Astolfi, D., and Natili, F.: SCADA Data Analysis Methods for Diagnosis of Electrical Faults to Wind Turbine Generators, *Applied Sciences*, 11, 1–14, 2021.
- Catapult, O.: SYstem Performnce, Availability and Reliability Trend Analysis, <https://www.sparta-offshore.com/SpartaHome>, 2020.
- Cevasco, D., Koukoura, S., and Kolios, A.: Reliability, availability, maintainability data review for the identification of trends in offshore wind energy applications, *Renewable and Sustainable Energy Reviews*, 136, 110 414, 2021.
- 2125 Chatterjee, J. and Dethlefs, N.: Scientometric review of artificial intelligence for operations maintenance of wind turbines: The past, present and future, *Renewable and Sustainable Energy Reviews*, 144, 111 051, 2021.
- Chaudhuri, S., Stamm, M., Lapšanská, I., Lançon, T., Osterbrink, L., Driebe, T., Hein, D., and Harendt, R.: Infrared Thermography of Turbulence Patterns of Operational Wind Turbine Rotor Blades Supported With High-Resolution Photography: KI-VISIR Dataset, *Wind Energy*, 28, e2958, <https://doi.org/10.1002/we.2958>, 2025.
- 2130 Chen, H., Liu, H., Chu, X., Liu, Q., and Xue, D.: Anomaly detection and critical SCADA parameters identification for wind turbines based on LSTM-AE neural network, *Renewable Energy*, 172, 829–840, 2021.
- Chesterman, X., Verstraeten, T., Daems, P.-J., Nowé, A., and Helsen, J.: Condition monitoring of wind turbines using machine learning based anomaly detection and statistical techniques for the extraction of 'healthy data', *Proceedings of the Annual Conference of the PHM Society*, 2021.
- 2135 Chesterman, X., Verstraeten, T., Daems, P.-J., Sanjines, F. P., Nowé, A., and Helsen, J.: The detection of generator bearing failures on wind turbines using machine learning based anomaly detection, *Journal of Physics: Conference Series*, 2265, 032 066, 2022.
- Chesterman, X., Verstraeten, T., Daems, P.-J., Nowé, A., and Helsen, J.: Overview of normal behavior modeling approaches for SCADA-based wind turbine condition monitoring demonstrated on data from operational wind farms, *Wind Energy Science*, 8, 893–924, <https://doi.org/10.5194/wes-8-893-2023>, 2023.
- 2140 Chmelar, J., Petr, K., Mossoczy, P., and Dynybyl, V.: Experimental study of lubrication film monitoring in a roller bearing by utilization of surface acoustic waves, *Tribology International*, <https://doi.org/10.1016/j.triboint.2019.105908>, 2020.
- Cho, S., Choi, M., Gao, Z., and Moan, T.: Fault detection and diagnosis of a blade pitch system in a floating wind turbine based on Kalman filters and artificial neural networks, *Renewable Energy*, 169, 1–13, 2021.
- Colone, L., Dimitrov, N., and Straub, D.: Predictive repair scheduling of wind turbine drive-train components based on machine learning, 2145 *Wind Energy*, 22, 1230–1242, 2019.
- Combet, F. and Gelman, L.: An automated methodology for performing time synchronous averaging of a gearbox signal without speed sensor, *Mechanical systems and signal processing*, 21, 2590–2606, 2007.

- Combet, F. and Gelman, L.: Novel adaptation of the demodulation technology for gear damage detection to variable amplitudes of mesh harmonics, *Mechanical systems and signal processing*, 25, 839–845, 2011.
- 2150 Compare, M., Baraldi, P., and Zio, E.: Challenges to IoT-Enabled Predictive Maintenance for Industry 4.0, *IEEE Internet of Things Journal*, 7, 4585–4597, <https://doi.org/10.1109/JIOT.2019.2957029>, 2020.
- Cui, L., Wang, X., Xu, Y., Jiang, H., and Zhou, J.: A novel Switching Unscented Kalman Filter method for remaining useful life prediction of rolling bearing, *Measurement*, 135, 678–684, <https://doi.org/10.1016/j.measurement.2018.12.028>, 2019.
- Daems, P.-J., Peeters, C., Guillaume, P., and Helsen, J.: Removal of non-stationary harmonics for operational modal analysis in time and
2155 frequency domain, *Mechanical Systems and Signal Processing*, 165, 108 329, 2022.
- Dao, C., Kazemtabrizi, B., and Crabtree, C.: Wind turbine reliability data review and impacts on levelised cost of energy, *Wind Energy*, 22, 1848–1871, 2019.
- Dao, P. B.: On Cointegration Analysis for Condition Monitoring and Fault Detection of Wind Turbines Using SCADA Data, *Energies*, 16, <https://doi.org/10.3390/en16052352>, 2023.
- 2160 Dao, P. B., Staszewski, W. J., Barszcz, T., and Uhl, T.: Condition monitoring and fault detection in wind turbines based on cointegration analysis of SCADA data, *Renewable Energy*, 116, 107–122, <https://doi.org/10.1016/j.renene.2017.06.089>, real-time monitoring, prognosis and resilient control for wind energy systems, 2018.
- De Kooning, J. D., Stockman, K., De Maeyer, J., Jarquin-Laguna, A., and Vandevelde, L.: Digital twins for wind energy conversion systems: a literature review of potential modelling techniques focused on model fidelity and computational load, *Processes*, 9, 2224, 2021.
- 2165 de Lima Munguba, C. F., Ochoa, A. A. V., Leite, G. d. N. P., da Costa, A. C. A., da Costa, J. Â. P., de Menezes, F. D., de Mendonça, E. P. A., de Petribú Brennan, L. J., de Castro Vilela, O., and de Souza, M. G. G.: Fault detection framework in wind turbine pitch systems using machine learning: Development, validation, and results, *Engineering Applications of Artificial Intelligence*, 138, 109 307, 2024.
- De Oliveira-Filho, A. M., Cambron, P., and Tahan, A.: Condition monitoring of wind turbine main bearing using SCADA data and informed by the principle of energy conservation, in: *2022 Prognostics and Health Management Conference (PHM-2022 London)*, pp. 276–282,
2170 IEEE, 2022.
- Decker, T., Jacobs, G., Arneth, P., Raddatz, M., Röder, J., and Schröder, T.: Approach towards the condition monitoring of journal bearings using surface acoustic wave technology, *Bearing World Journal Vol. 8*, https://vdma-verlag.com/publikation/bearing_world_journal_.html, 2025a.
- Decker, T., Jacobs, G., Raddatz, M., Röder, J., Betscher, J., and Arneth, P.: Detection of particle contamination and lubrication outage
2175 in journal bearings in wind turbine gearboxes using surface acoustic wave measurements and machine learning, *Forschung im Ingenieurwesen*, <https://doi.org/10.1007/s10010-025-00784-4>, 2025b.
- Decker, T., Jacobs, G., Röder, J., Scholz, T., Paridon, C., and Schröder, T.: Experimental study on the condition monitoring of planetary journal bearings in wind turbine gearboxes using the surface acoustic wave method, *Forschung im Ingenieurwesen*, 2025c.
- D’Elia, G., Mucchi, E., and Cocconcelli, M.: On the identification of the angular position of gears for the diagnostics of planetary gearboxes,
2180 *Mechanical systems and signal processing*, 83, 305–320, 2017.
- Deutsch, J. and He, D.: Using Deep Learning-Based Approach to Predict Remaining Useful Life of Rotating Components, *IEEE Transactions on Systems, Man, and Cybernetics: Systems*, 48, 11–20, <https://doi.org/10.1109/TSMC.2017.2697842>, 2018.
- Deutsches Institut für Normung e.V.: *Zerstörungsfreie Prüfung – Schallemissionsprüfung – Allgemeine Grundsätze*, 2011.
- Deutsches Institut für Normung e.V.: *Plain bearings - Hydrodynamic plain journal bearings under steady-state conditions - Part 2: Functions*
2185 for calculation of circular cylindrical bearings, 2017.

- Dienst, S. and Beseler, J.: Automatic anomaly detection in offshore wind SCADA data, Wind Europe summit 2016, pp. 1–7, 2016.
- Ding, S., Yang, C., and Zhang, S.: Acoustic-Signal-Based Damage Detection of Wind Turbine Blades – A Review, *Sensors*, 23, <https://doi.org/10.3390/s23114987>, 2023.
- DNV: Qualification and assurance of digital twins, Recommended Practice DNV-RPA204, 2020.
- 2190 Doroshnasir, M., Worzeński, T., Krankenhagen, R., and Röllig, M.: On-site inspection of potential defects in wind turbine rotor blades with thermography, *Wind Energy*, 19, 1407–1422, <https://doi.org/10.1002/we.1927>, 2016.
- Draghi, M.: The future of European competitiveness: In-depth analysis and recommendations (Part B), Tech. rep., European Commission, https://commission.europa.eu/document/download/ec1409c1-d4b4-4882-8bdd-3519f86bbb92_en?filename=The%20future%20of%20European%20competitiveness_%20In-depth%20analysis%20and%20recommendations_0.pdf, 2024.
- 2195 Du, Y., Zhou, S., Jing, X., Peng, Y., Wu, H., and Kwok, N.: Damage detection techniques for wind turbine blades: A review, *Mechanical Systems and Signal Processing*, 141, 106445, <https://doi.org/10.1016/j.ymssp.2019.106445>, 2020.
- El Badaoui, M., Antoni, J., Guillet, F., Daniere, J., and Vexel, P.: Use of the moving cepstrum integral to detect and localise tooth spalls in gears, *Mechanical Systems and Signal Processing*, 15, 873–885, 2001.
- El Badaoui, M., Guillet, F., and Daniere, J.: New applications of the real cepstrum to gear signals, including definition of a robust fault indicator, *Mechanical systems and signal processing*, 18, 1031–1046, 2004.
- 2200 El Hachemi Benbouzid, M.: A review of induction motors signature analysis as a medium for faults detection, *IEEE Transactions on Industrial Electronics*, 47, 984–993, 2000.
- Elasha, F., Greaves, M., Mba, D., and Fang, D.: A comparative study of the effectiveness of vibration and acoustic emission in diagnosing a defective bearing in a planetary gearbox, *Applied Acoustics*, 115, 181–195, 2017.
- 2205 Elforjani, M.: Diagnosis and prognosis of real world wind turbine gears, *Renewable Energy*, 147, 1676–1693, 2020.
- Encalada-Dávila, Á., Purunçajas, B., Tutivén, C., and Vidal, Y.: Wind turbine main bearing fault prognosis based solely on scada data, *Sensors*, 21, 2228, 2021.
- EPRI: Wind Turbine Gearbox Physics-Based Machine Learning Model for Effective Health Monitoring: Early Damage Detection to Reduce O&M Costs, Tech. Rep. 3002020145, Electric Power Research Institute, 2020.
- 2210 EPRI: Wind Network for Enhanced Reliability (WinNER) Web-based Tool, <https://www.epri.com/research/products/000000003002020805>, 2021.
- EPRI: Wind turbine main bearing reliability analysis, operations, and maintenance considerations. Technical report 3002029874, 2024.
- Errandonea, I., Beltrán, S., and Arrizabalaga, S.: Digital Twin for maintenance: A literature review, *Computers in Industry*, 123, 103316, 2020.
- 2215 European Commission: Communication on The European Green Deal, eUR-Lex: 52019DC0640, 2019.
- European Commission: REPowerEU Plan, eUR-Lex: 52022DC0230, 2022.
- Feng, K., Borghesani, P., Smith, W. A., Randall, R. B., Chin, Z. Y., Ren, J., and Peng, Z.: Vibration-based updating of wear prediction for spur gears, *Wear*, 426–427, 1410–1415, <https://doi.org/10.1016/j.wear.2019.01.017>, 22nd International Conference on Wear of Materials, 2019.
- 2220 Feng, K., Smith, W. A., and Peng, Z.: Use of an improved vibration-based updating methodology for gear wear prediction, *Engineering Failure Analysis*, 120, 105066, <https://doi.org/10.1016/j.engfailanal.2020.105066>, 2021.

- Feng, K., Smith, W. A., Randall, R. B., Wu, H., and Peng, Z.: Vibration-based monitoring and prediction of surface profile change and pitting density in a spur gear wear process, *Mechanical Systems and Signal Processing*, 165, 108319, <https://doi.org/10.1016/j.ymssp.2021.108319>, 2022.
- 2225 Feng, K., Ji, J., Ni, Q., and Beer, M.: A review of vibration-based gear wear monitoring and prediction techniques, *Mechanical Systems and Signal Processing*, 182, 109605, 2023.
- Feng, Y., Tavner, P. J., and Long, H.: Early experiences with UK round 1 offshore wind farms, *Proceedings of the Institution of Civil Engineers-energy*, 163, 167–181, 2010.
- Feng, Y., Qiu, Y., Crabtree, C. J., Long, H., and Tavner, P. J.: Monitoring wind turbine gearboxes, *Wind energy*, 16, 728–740, 2013.
- 2230 Feng, Z. and Liang, M.: Complex signal analysis for planetary gearbox fault diagnosis via shift invariant dictionary learning, *Measurement*, 90, 382–395, 2016.
- Feng, Z., Chen, X., and Liang, M.: Iterative generalized synchrosqueezing transform for fault diagnosis of wind turbine planetary gearbox under nonstationary conditions, *Mechanical Systems and Signal Processing*, 52, 360–375, 2015.
- Feng, Z., Lin, X., and Zuo, M. J.: Joint amplitude and frequency demodulation analysis based on intrinsic time-scale decomposition for planetary gearbox fault diagnosis, *Mechanical Systems and Signal Processing*, 72, 223–240, 2016.
- 2235 Fischer, K., Stalin, T., Ramberg, H., Wenske, J., Wetter, G., Karlsson, R., and Thiringer, T.: Field-experience based root-cause analysis of power-converter failure in wind turbines, *IEEE transactions on power electronics*, 30, 2481–2492, 2014.
- Fischer, K., Pelka, K., Puls, S., Poech, M.-H., Mertens, A., Bartschat, A., Tegtmeier, B., Broer, C., and Wenske, J.: Exploring the causes of power-converter failure in wind turbines based on comprehensive field-data and damage analysis, *Energies*, 12, 593, 2019.
- 2240 Fleischer G., Gröger H., Thum H.: *Verschleiß und Zuverlässigkeit*, VEB Verlag Technik, Berlin, 1980.
- Freire, N. M. A. and Cardoso, A. J. M.: Fault Detection and Condition Monitoring of PMSGs in Offshore Wind Turbines, *Machines*, 9, 2021.
- Fu, X., Tao, J., Jiao, K., and Liu, C.: A novel semi-supervised prototype network with two-stream wavelet scattering convolutional encoder for TBM main bearing few-shot fault diagnosis, *Knowledge-Based Systems*, 286, 111408, 2024.
- Fuentes, R., Dwyer-Joyce, R., Marshall, M., Wheals, J., and Cross, E.: Detection of sub-surface damage in wind turbine bearings using acoustic emissions and probabilistic modelling, *Renewable Energy*, 147, 776–797, 2020.
- 2245 Fyfe, K. and Munck, E.: Analysis of computed order tracking, *Mechanical systems and signal processing*, 11, 187–205, 1997.
- Garcia, M. C., Sanz-Bobi, M. A., and del Pico, J.: SIMAP: Intelligent System for Predictive Maintenance: Application to the health condition monitoring of a windturbine gearbox, *Computers in Industry*, 57, 552–568, <https://doi.org/10.1016/j.compind.2006.02.011>, e-maintenance Special Issue, 2006.
- 2250 Garlick, W., Dixon, R., and Watson, S.: A model-based approach to wind turbine condition monitoring using SCADA data, in: Keith J Burnham and Olivier C L Haas (eds.). *20th International Conference on Systems Engineering*, pp. 1–8, 2009.
- Gebel, J., Rezaei, A., Vemuri, A., Liverud Krathe, V., Daems, P.-J., Matthys, J. J., Sterckx, J., Vratsinis, K., Kestel, K., Nejad, A. R., et al.: System identification of offshore wind turbines for model updating and validation using field measurements, *Wind Energy Science Discussions*, 2025, 1–25, 2025.
- 2255 Gebrael, N., Elwany, A., and Pan, J.: Residual life predictions in the absence of prior degradation knowledge, *IEEE Transactions on Reliability*, 58, 106–117, <https://doi.org/10.1109/TR.2008.2011659>, 2009.
- Ghosh, A. K., Ullah, A. S., and Kubo, A.: Hidden Markov model-based digital twin construction for futuristic manufacturing systems, *Artificial Intelligence for Engineering Design, Analysis and Manufacturing*, 33, 317–331, <https://doi.org/10.1017/S089006041900012X>, 2019.

- 2260 Gioia, N., Daems, P.-J., Peeters, C., El-Kafafy, M., Guillaume, P., and Helsen, J.: Influence of the harmonics on the modal behavior of wind turbine drivetrains, in: *Rotating Machinery, Vibro-Acoustics & Laser Vibrometry*, Volume 7, pp. 231–238, Springer, 2019a.
- Gioia, N., Peeters, C., Guillaume, P., and Helsen, J.: Identification of noise, vibration and harshness behavior of wind turbine drivetrain under different operating conditions, *Energies*, 12, 3401, 2019b.
- Gong, Y., Fei, J.-L., Tang, J., Yang, Z.-G., Han, Y.-M., and Li, X.: Failure analysis on abnormal wear of roller bearings in gearbox for wind turbine, *Engineering Failure Analysis*, 82, 26–38, 2017.
- 2265 Gonzalez, E., Stephen, B., Infield, D., and Melero, J.: On the use of high-frequency SCADA data for improved wind turbine performance monitoring, in: *Journal of Physics: Conference Series*, vol. 926, p. 012009, IOP Publishing, 2017.
- Grataloup, A., Jonas, S., and Meyer, A.: Wind turbine condition monitoring based on intra- and inter-farm federated learning, <https://arxiv.org/abs/2409.03672>, 2024.
- 2270 Greco, A., Sheng, S., Keller, J., and Erdemir, A.: Material wear and fatigue in wind turbine systems, *Wear*, 302, 1583–1591, 2013.
- Gritli, Y., Stefani, A., Rossi, C., Filippetti, F., and Chatti, A.: Experimental validation of doubly fed induction machine electrical faults diagnosis under time-varying conditions, *Electric Power Systems Research*, 81, 751–766, 2011.
- Gritli, Y., Zarri, L., Rossi, C., Filippetti, F., Capolino, G.-A., and Casadei, D.: Advanced Diagnosis of Electrical Faults in Wound-Rotor Induction Machines, *IEEE Transactions on Industrial Electronics*, 60, 4012–4024, 2013.
- 2275 Gu, Y.-K., Xu, B., Huang, H., and Qiu, G.: A Fuzzy Performance Evaluation Model for a Gearbox System Using Hidden Markov Model, *IEEE Access*, 8, 30 400–30 409, <https://doi.org/10.1109/ACCESS.2020.2972810>, 2020.
- GWEC: Global Wind Report 2024, <https://gwec.net/global-wind-report-2024/>, 2024.
- Ha, J. M., Youn, B. D., Oh, H., Han, B., Jung, Y., and Park, J.: Autocorrelation-based time synchronous averaging for condition monitoring of planetary gearboxes in wind turbines, *Mechanical Systems and Signal Processing*, 70, 161–175, 2016.
- 2280 Ha, J. M., Park, J., Na, K., Kim, Y., and Youn, B. D.: Toothwise fault identification for a planetary gearbox based on a health data map, *IEEE Transactions on Industrial Electronics*, 65, 5903–5912, 2017.
- Hammond, R. and Cooperman, A.: Windfarm operations and maintenance cost-benefit analysis tool (wombat), Tech. rep., National Renewable Energy Lab.(NREL), Golden, CO (United States), <https://doi.org/10.2172/1894867>, 2022.
- Hart, E., Turnbull, A., Feuchtwang, J., McMillan, D., Golyshva, E., and Elliott, R.: Wind turbine main-bearing loading and wind field characteristics, *Wind Energy*, 22, 1534–1547, 2019.
- 2285 Hart, E., Clarke, B., Nicholas, G., Kazemi Amiri, A., Stirling, J., Carroll, J., Dwyer-Joyce, R., McDonald, A., and Long, H.: A review of wind turbine main bearings: design, operation, modelling, damage mechanisms and fault detection, *Wind Energy Science*, 5, 105–124, 2020.
- Hart, E., Stock, A., Elderfield, G., Elliott, R., Brasseur, J., Keller, J., Guo, Y., and Song, W.: Impacts of wind field characteristics and non-steady deterministic wind events on time-varying main-bearing loads, *Wind Energy Science*, 7, 1209–1226, 2022.
- 2290 Hart, E., Raby, K., Keller, J., Sheng, S., Long, H., Carroll, J., Brasseur, J., and Tough, F.: Main bearing replacement and damage-a field data study on 15 gigawatts of wind energy capacity., Technical Report NREL/TP-5000-86228, 2023.
- Hase, A.: Early Detection and Identification of Fatigue Damage in Thrust Ball Bearings by an Acoustic Emission Technique, *Lubricants*, 8, 37, <https://doi.org/10.3390/lubricants8030037>, 2020.
- 2295 He, G., Ding, K., Li, W., and Jiao, X.: A novel order tracking method for wind turbine planetary gearbox vibration analysis based on discrete spectrum correction technique, *Renewable Energy*, 87, 364–375, 2016.

- He, Y., Liu, J., Wu, S., and Wang, X.: Condition monitoring and fault detection of wind turbine driveline with the implementation of deep residual long short-term memory network, *IEEE Sensors Journal*, 23, 13 360–13 376, 2023.
- 2300 Helsen, J.: Review of research on condition monitoring for improved O&M of offshore wind turbine drivetrains, *Acoustics Australia*, 49, 251–258, 2021.
- Helsen, J., Gioia, N., Peeters, C., and Jordaens, P.-J.: Integrated condition monitoring of a fleet of offshore wind turbines with focus on acceleration streaming processing, in: *Journal of Physics: Conference Series*, vol. 842, p. 012052, IOP Publishing, 2017a.
- Helsen, J., Peeters, C., Doro, P., Ververs, E., and Jordaens, P. J.: Wind farm operation and maintenance optimization using big data, in: 2017 IEEE Third International Conference on big data computing service and applications (BigDataService), pp. 179–184, IEEE, 2017b.
- 2305 Heng, A., Zhang, S., Tan, A. C., and Mathew, J.: Rotating machinery prognostics: State of the art, challenges and opportunities, *Mechanical Systems and Signal Processing*, 23, 724–739, <https://doi.org/10.1016/j.ymssp.2008.06.009>, 2009.
- Hoffmann, R. and Wolff, M.: *Signalanalyse*, vol. 1 of *Intelligente Signalverarbeitung / Rüdiger Hoffmann Matthias Wolff*, Springer Vieweg, Berlin, 2. Aufl. edn., ISBN 978-3-662-45322-3, 2014.
- Hong, L., Qu, Y., Dhupia, J. S., Sheng, S., Tan, Y., and Zhou, Z.: A novel vibration-based fault diagnostic algorithm for gearboxes under speed fluctuations without rotational speed measurement, *Mechanical Systems and Signal Processing*, 94, 14–32, 2017.
- 2310 Howard, I.: A review of rolling element bearing vibration 'detection, diagnosis and prognosis', 1994.
- Hu, C., Smith, W. A., Randall, R. B., and Peng, Z.: Development of a gear vibration indicator and its application in gear wear monitoring, *Mechanical Systems and Signal Processing*, 76, 319–336, 2016.
- Hu, W., Jiao, Q., Liu, H., Wang, K., Jiang, Z., Wu, J., Cong, F., and Hao, G.: A transferable diagnosis method with incipient fault detection for a digital twin of wind turbine, *Digital Engineering*, 1, 100 001, 2024.
- 2315 Hussain, M., Mirjat, N. H., Shaikh, F., Dhirani, L. L., Kumar, L., and Sleiti, A. K.: Condition Monitoring and Fault Diagnosis of Wind Turbine: A Systematic Literature Review, *IEEE Access*, 2024.
- Ibrahim, M., Rassölkin, A., Vaimann, T., Kallaste, A., Zakis, J., Hyunh, V. K., and Pomarnacki, R.: Digital Twin as a Virtual Sensor for Wind Turbine Applications, *Energies*, 16, 6246, 2023.
- 2320 Ibrion, M., Paltrinieri, N., and Nejad, A. R.: On risk of digital twin implementation in marine industry: Learning from aviation industry, in: *Journal of Physics: Conference Series*, vol. 1357, p. 012009, IOP Publishing, 2019.
- Im, K.-H., Kim, S.-K., Jung, J.-A., Cho, Y.-T., Wood, Y.-D., and Chiou, C.-P.: NDE characterization and inspection techniques of trailing edges in wind turbine blades using terahertz waves, *Journal of Mechanical Science and Technology*, 33, 4745–4753, <https://doi.org/10.1007/s12206-019-0915-8>, 2019.
- 2325 International Renewable Energy Agency: Renewable power generation costs in 2023, IRENA, Abu Dhabi, 2024.
- Jamil, F., Verstraeten, T., Nowé, A., Peeters, C., and Helsen, J.: A deep boosted transfer learning method for wind turbine gearbox fault detection, *Renewable Energy*, 197, 331–341, 2022.
- Jamil, F., Peeters, C., Verstraeten, T., and Helsen, J.: Leveraging Signal Processing and Machine Learning for Automated Fault Detection in Wind Turbine Drivetrains, *Wind Energy Science Discussions*, 2024, 1–21, 2024.
- 2330 Jardine, A. K., Lin, D., and Banjevic, D.: A review on machinery diagnostics and prognostics implementing condition-based maintenance, *Mechanical Systems and Signal Processing*, 20, 1483–1510, <https://doi.org/10.1016/j.ymssp.2005.09.012>, 2006.
- Javed, K., Gouriveau, R., and Zerhouni, N.: State of the art and taxonomy of prognostics approaches, trends of prognostics applications and open issues towards maturity at different technology readiness levels, *Mechanical Systems and Signal Processing*, 94, 214–236, <https://doi.org/10.1016/j.ymssp.2017.01.050>, 2017.

- 2335 Jena, D., Sahoo, S., and Panigrahi, S.: Gear fault diagnosis using active noise cancellation and adaptive wavelet transform, *Measurement*, 47, 356–372, 2014.
- Jia, F., Lei, Y., Lin, J., Zhou, X., and Lu, N.: Deep neural networks: A promising tool for fault characteristic mining and intelligent diagnosis of rotating machinery with massive data, *Mechanical Systems and Signal Processing*, 72-73, 303–315, <https://doi.org/10.1016/j.ymssp.2015.10.025>, 2016.
- 2340 Jiang, X., Li, S., and Wang, Q.: A study on defect identification of planetary gearbox under large speed oscillation, *Mathematical Problems in Engineering*, 2016, 5289 698, 2016.
- Jiang, X., Cheng, X., Shi, J., Huang, W., Shen, C., and Zhu, Z.: A new l_0 -norm embedded MED method for roller element bearing fault diagnosis at early stage of damage, *Measurement*, 127, 414–424, <https://doi.org/10.1016/j.measurement.2018.06.016>, 2018.
- Jiang, Y., Liang, B., Huang, Z., Chen, Z., and Xu, B.: Prediction on Flow and Thermal Characteristics of Ultrathin Lubricant Film of Hydrodynamic Journal Bearing, *Micromachines*, 12, <https://doi.org/10.3390/mi12101208>, 2021.
- 2345 Jin, C., Ran, Y., Wang, Z., Huang, G., Xiao, L., and Zhang, G.: Reliability analysis of gear rotation meta-action unit based on Weibull and inverse Gaussian competing failure process, *Engineering Failure Analysis*, 117, 104953, <https://doi.org/10.1016/j.engfailanal.2020.104953>, 2020.
- Jin, X., Xu, Z., and Qiao, W.: Condition Monitoring of Wind Turbine Generators Using SCADA Data Analysis, *IEEE Transactions on Sustainable Energy*, 12, 202–210, 2021.
- 2350 Johansen, S. S. and Nejad, A. R.: On digital twin condition monitoring approach for drivetrains in marine applications, in: *International Conference on Offshore Mechanics and Arctic Engineering*, vol. 58899, p. V010T09A013, American Society of Mechanical Engineers, 2019.
- Joose, P. A., Blanch, M. J., Dutton, A. G., Kouroussis, D. A., Philippidis, T. P., and Vionis, P. S.: Acoustic Emission Monitoring of Small Wind Turbine Blades, *Journal of Solar Energy Engineering*, 124, 446–454, <https://doi.org/10.1115/1.1509769>, 2002.
- 2355 Joshua, A. and Sugumaran, V.: A data driven approach for condition monitoring of wind turbine blade using vibration signals through best-first tree algorithm and functional trees algorithm: A comparative study, *ISA transactions*, 67, 160–172, 2017.
- Kang, J., Sun, L., Sun, H., and Wu, C.: Risk assessment of floating offshore wind turbine based on correlation-FMEA, *Ocean Engineering*, 129, 382–388, 2017.
- 2360 Kang, J., Sun, L., and Soares, C. G.: Fault Tree Analysis of floating offshore wind turbines, *Renewable energy*, 133, 1455–1467, 2019.
- Kenworthy, J., Hart, E., Stirling, J., Stock, A., Keller, J., Guo, Y., Brasseur, J., and Evans, R.: Wind turbine main bearing rating lives as determined by IEC 61400-1 and ISO 281: A critical review and exploratory case study, *Wind Energy*, 27, 179–197, 2024.
- Kestel, K., Peeters, C., Antoni, J., Leclère, Q., Girardin, F., and Helsen, J.: Informed sparsity-based blind filtering in the presence of second-order cyclostationary noise, *Mechanical Systems and Signal Processing*, 199, 110 438, 2023.
- 2365 Kestel, K., Chesterman, X., Jamil, F., Matthys, J. J., Vratisinis, K., Sterckx, J., Peeters, C., and Helsen, J.: Farm-wide dynamic drivetrain event and diagnosis tracking using multi-modal data, *Forschung im Ingenieurwesen*, 89, 1–16, 2025.
- Khan, P. W., Yeun, C. Y., and Byun, Y. C.: Fault detection of wind turbines using SCADA data and genetic algorithm-based ensemble learning, *Engineering Failure Analysis*, 148, 107 209, <https://doi.org/10.1016/j.engfailanal.2023.107209>, 2023.
- Khoshmanesh, S., Watson, S., and Zarouchas, D.: New indicator for damage localization in a thick adhesive joint of a composite material used in a wind turbine blade, *Engineering Structures*, 283, 115 870, <https://doi.org/10.1016/j.engstruct.2023.115870>, 2023.
- 2370 Khoshmanesh, S., Watson, S., and Zarouchas, D.: Early detection of impact fatigue damage in an adhesively-bonded connection using acoustic emission, *Engineering Structures*, 308, 117 973, <https://doi.org/10.1016/j.engstruct.2024.117973>, 2024.

- Kim, K., Parthasarathy, G., Uluyol, O., and Patel, Y.: Use of SCADA Data for Failure Detection in Wind Turbines, *ASME 5th Int. Conf. Energy Sustain.*, p. 2071–2079, 2011.
- 2375 Kirchner, E., Wallmersperger, T., Gwosch, T., Menning, J. D. M., Peters, J., Breimann, R., Kraus, B., Welzbacher, P., Küchenhof, J., Krause, D., Knoll, E., Otto, M., Muhammedi, B., Seltmann, S., Hasse, A., Schäfer, G., Lohrengel, A., Thielen, S., Stiemcke, Y., Koch, O., Ewert, A., Rosenlöcher, T., Schlecht, B., Prokopchuk, A., Henke, E.-F. M., Herbst, F., Matthiesen, S., Riehl, D., Keil, F., Hofmann, K., Pape, F., Konopka, D., Poll, G., Steppeler, T., Ottermann, R., Dencker, F., Wurz, M. C., Puchtler, S., Baszenski, T., Winnertz, M., Jacobs, G., Lehmann, B., and Stahl, K.: A Review on Sensor–Integrating Machine Elements, *Advanced Sensor Research*,
 2380 <https://doi.org/10.1002/adrs.202300113>, 2024.
- Klein, U.: *Schwingungsdiagnostische Beurteilung von Maschinen und Anlagen*, Verl. Stahleisen, Düsseldorf, 3., überarb. Aufl., unveränd. nachdr edn., ISBN 3514006873, 2008.
- Kolerus, J. and Becker, E.: *Condition Monitoring und Instandhaltungsmanagement*, expert verlag, ISBN 9783816984894,
<https://doi.org/10.24053/9783816984894>, 2022.
- 2385 König, F., Jacobs, G., Stratmann, A., and Cornel, D.: Fault detection for sliding bearings using acoustic emission signals and machine learning methods, in: *IOP Conference Series: Materials Science and Engineering*, vol. 1097, p. 012013, IOP Publishing, 2021a.
- König, F., Sous, C., Chaib, A. O., and Jacobs, G.: Machine learning based anomaly detection and classification of acoustic emission events for wear monitoring in sliding bearing systems, *Tribology International*, 155, 106 811, 2021b.
- König, F., Wirsing, F., Jacobs, G., He, R., Tian, Z., and Zuo, M. J.: Bayesian inference-based wear prediction method for plain bearings under
 2390 stationary mixed-friction conditions, *Friction*, 12, 1272–1282, <https://doi.org/10.1007/s40544-023-0814-y>, 2024.
- Kordestani, M., Rezamand, M., Orchard, M. E., Carriveau, R., Ting, D. S., Rueda, L., and Saif, M.: New condition-based monitoring and fusion approaches with a bounded uncertainty for bearing lifetime prediction, *IEEE sensors journal*, 22, 9078–9086, 2022.
- Koukoura, S., Peeters, C., Helsen, J., and Carroll, J.: Investigating parallel multi-step vibration processing pipelines for planetary stage fault detection in wind turbine drivetrains, in: *Journal of Physics: Conference Series*, vol. 1618, p. 022054, IOP Publishing, 2020.
- 2395 Kristensen, O., McGugan, M., Sendrup, P., Rheinländer, J., Rusborg, J., Hansen, A., Debel, C., and Sørensen, B.: Fundamentals for remote structural health monitoring of wind turbine blades - a preproject. Annex E. Full-scale test of wind turbine blade, using sensors and NDT, no. 1333(EN) in Denmark. Forskningscenter Risoe. Risoe-R, Risø National Laboratory, ISBN 87-550-3034-3, 2002.
- Kritzinger, W., Karner, M., Traar, G., Henjes, J., and Sihm, W.: Digital Twin in manufacturing: A categorical literature review and classification, *Ifac-PapersOnline*, 51, 1016–1022, 2018.
- 2400 Kumar, A., Gandhi, C., Zhou, Y., Kumar, R., and Xiang, J.: Latest developments in gear defect diagnosis and prognosis: A review, *Measurement*, 158, 107 735, 2020.
- Kusiak, A. and Li, W.: The prediction and diagnosis of wind turbine faults, *Renewable Energy*, 36, 16–23, 2011.
- Kusiak, A. and Verma, A.: Analyzing bearing faults in wind turbines: A data-mining approach, *Renewable Energy*, 48, 110–116, 2012.
- Lapira, E. R., Al-Atat, H., and Lee, J.: Turbine-to-turbine prognostics technique for wind farms, *uS Patent 8,924,162*, 2014.
- 2405 Leclère, Q., André, H., and Antoni, J.: A multi-order probabilistic approach for Instantaneous Angular Speed tracking debriefing of the CMMNO 14 diagnosis contest, *Mechanical Systems and Signal Processing*, 81, 375–386, 2016.
- Leclère, Q., André, H., Antoni, J., Burel, A., Capdessus, C., Cocconcelli, M., D’elia, G., Daga, A. P., Dion, J.-L., El Badaoui, M., et al.: Video-based diagnosis of a rolling element bearing using a high-speed camera: Feedback on the Survishno 2023 conference contest, *Mechanical Systems and Signal Processing*, 230, 112 601, 2025.

- 2410 Lee, H., Hwang, Y. M., Lee, J., Kim, N.-W., and Ko, S.-K.: A Drone-Driven X-Ray Image-Based Diagnosis of Wind Turbine Blades for Reliable Operation of Wind Turbine, *IEEE Access*, 12, 56 141–56 158, <https://doi.org/10.1109/ACCESS.2024.3388494>, 2024a.
- Lee, J., Wu, F., Zhao, W., Ghaffari, M., Liao, L., and Siegel, D.: Prognostics and health management design for rotary machinery systems—Reviews, methodology and applications, *Mechanical Systems and Signal Processing*, 42, 314–334, <https://doi.org/10.1016/j.ymsp.2013.06.004>, 2014.
- 2415 Lee, Y., Park, C., Kim, N., Ahn, J., and Jeong, J.: LSTM-Autoencoder Based Anomaly Detection Using Vibration Data of Wind Turbines, *Sensors*, 24, <https://www.mdpi.com/1424-8220/24/9/2833>, 2024b.
- Lei, Y., Yang, B., Jiang, X., Jia, F., Li, N., and Nandi, A. K.: Applications of machine learning to machine fault diagnosis: A review and roadmap, *Mechanical systems and signal processing*, 138, 106 587, 2020.
- 2420 Leser, P. E., Warner, J. E., Leser, W. P., Bomarito, G. F., Newman, J. A., and Hochhalter, J. D.: A digital twin feasibility study (Part II): Non-deterministic predictions of fatigue life using in-situ diagnostics and prognostics, *Engineering Fracture Mechanics*, 229, 106 903, <https://doi.org/10.1016/j.engfracmech.2020.106903>, 2020.
- Li, H., Teixeira, A. P., and Soares, C. G.: A two-stage Failure Mode and Effect Analysis of offshore wind turbines, *Renewable Energy*, 162, 1438–1461, 2020a.
- 2425 Li, H., Zhao, W., Zhang, Y., and Zio, E.: Remaining useful life prediction using multi-scale deep convolutional neural network, *Applied Soft Computing*, 89, 106 113, <https://doi.org/10.1016/j.asoc.2020.106113>, 2020b.
- Li, J., Lei, X., Li, H., and Ran, L.: Normal Behavior Models for the Condition Assessment of Wind Turbine Generator Systems, *Electric Power Components and Systems*, 42, 1201–1212, 2014.
- Li, L. and Jian, Q.: Remaining useful life prediction of Wind Turbine Main-Bearing Based on LSTM Optimized Network, *IEEE Sensors Journal*, 2024.
- 2430 Li, M., Kang, J., Sun, L., and Wang, M.: Development of optimal maintenance policies for offshore wind turbine gearboxes based on the non-homogeneous continuous-time Markov process, *Journal of Marine Science and Application*, 18, 93–98, 2019a.
- Li, M., Wang, M., Kang, J., Sun, L., and Jin, P.: An opportunistic maintenance strategy for offshore wind turbine system considering optimal maintenance intervals of subsystems, *Ocean Engineering*, 216, 108 067, 2020c.
- 2435 Li, N., Lei, Y., Yan, T., Li, N., and Han, T.: A Wiener-Process-Model-Based Method for Remaining Useful Life Prediction Considering Unit-to-Unit Variability, *IEEE Transactions on Industrial Electronics*, 66, 2092–2101, <https://doi.org/10.1109/TIE.2018.2838078>, 2019b.
- Li, T., Pei, H., Pang, Z., Si, X., and Zheng, J.: A Sequential Bayesian Updated Wiener Process Model for Remaining Useful Life Prediction, *IEEE Access*, 8, 5471–5480, <https://doi.org/10.1109/ACCESS.2019.2962502>, 2020d.
- Li, X., Li, X., Liang, W., and Chen, L.: regularized minimum entropy deconvolution for ultrasonic NDT & E, *NDT & E International*, 47, 80–87, <https://doi.org/10.1016/j.ndteint.2011.12.005>, 2012.
- 2440 Li, Y. and Wu, Z.: A condition monitoring approach of multi-turbine based on VAR model at farm level, *Renewable Energy*, 166, 66–80, 2020.
- Liang, X., Zuo, M. J., and Feng, Z.: Dynamic modeling of gearbox faults: A review, *Mechanical Systems and Signal Processing*, 98, 852–876, 2018.
- 2445 Lindner, G., Schmitt, M., Schubert, J., Krempel, S., and Faustmann, H.: Measuring lubricant viscosity at a surface and in a bearing film using shear-horizontal surface acoustic waves, *IEEE transactions on ultrasonics, ferroelectrics, and frequency control*, <https://doi.org/10.1109/TUFFC.2010.1388>, 2010.

- Ling, M., Ng, H., and Tsui, K.: Bayesian and likelihood inferences on remaining useful life in two-phase degradation models under gamma process, *Reliability Engineering & System Safety*, 184, 77–85, <https://doi.org/10.1016/j.res.2017.11.017>, impact of Prognostics and Health Management in Systems Reliability and Maintenance Planning, 2019.
- 2450 Liu, H., Wang, Y., Zeng, T., Wang, H., Chan, S.-C., and Ran, L.: Wind turbine generator failure analysis and fault diagnosis: A review, *IET Renewable Power Generation*, 18, 3127–3148., 2024a.
- Liu, J., Yang, G., Li, X., Wang, Q., He, Y., and Yang, X.: Wind turbine anomaly detection based on SCADA: A deep autoencoder enhanced by fault instances, *ISA Transactions*, 139, 586–605, <https://doi.org/10.1016/j.isatra.2023.03.045>, 2023.
- Liu, X., Chen, G., Cheng, Z., Wei, X., and Wang, H.: Convolution neural network based particle filtering for remaining useful life prediction of rolling bearing, *Advances in Mechanical Engineering*, 14, 16878132221100631, <https://doi.org/10.1177/16878132221100631>, 2022.
- 2455 Liu, Y., Liu, C., and Hermans, K.: Enabling self calibration for the wind turbine digital twin: a blending-function learning algorithm, in: *Journal of Physics: Conference Series*, vol. 2767, p. 032035, IOP Publishing, 2024b.
- Liu, Z. and Zhang, L.: A review of failure modes, condition monitoring and fault diagnosis methods for large-scale wind turbine bearings, *Measurement*, 149, 107002, 2020.
- 2460 Liu, Z., Zhang, L., and Carrasco, J.: Vibration analysis for large-scale wind turbine blade bearing fault detection with an empirical wavelet thresholding method, *Renewable Energy*, 146, 99–110, 2020.
- Lizaranzu, M., Lario, A., Chiminelli, A., and Amenabar, I.: Non-destructive testing of composite materials by means of active thermography-based tools, *Infrared Physics and Technology*, 71, 113 – 120, <https://doi.org/10.1016/j.infrared.2015.02.006>, 2015.
- Lu, L., He, Y., Ruan, Y., and Yuan, W.: Wind turbine planetary gearbox condition monitoring method based on wireless sensor and deep learning approach, *IEEE transactions on instrumentation and measurement*, 70, 1–16, 2020.
- 2465 Lu, W. and Chu, F.: Shaft crack identification based on vibration and AE signals, *Shock and Vibration*, 18, 115–126, 2011.
- Lucassen, M., Decker, T., Guzmán, F. G., Lehmann, B., Bosse, D., and Jacobs, G.: Simulation methodology for the identification of critical operating conditions of planetary journal bearings in wind turbines, *Forschung im Ingenieurwesen*, 87, 147–157, <https://doi.org/10.1007/s10010-023-00626-1>, 2023.
- 2470 Lucassen, M., Jacobs, G., and Lehmann, B.: Efficient dynamic simulations of planetary journal bearings in wind turbine gearboxes, *Forschung im Ingenieurwesen*, 89, <https://doi.org/10.1007/s10010-025-00787-1>, 2025.
- Lyu, J., Ying, R., Lu, N., and Zhang, B.: Remaining useful life estimation with multiple local similarities, *Engineering Applications of Artificial Intelligence*, 95, 103849, <https://doi.org/10.1016/j.engappai.2020.103849>, 2020.
- Ma, Z., Zhao, M., Luo, M., Gou, C., and Xu, G.: An integrated monitoring scheme for wind turbine main bearing using acoustic emission, *Signal Processing*, 205, 108867, 2023.
- 2475 Malik, T. H. and Bak, C.: Full-scale wind turbine performance assessment using the turbine performance integral (TPI) method: a study of aerodynamic degradation and operational influences, *Wind Energy Science*, 9, 2017–2037, 2024.
- Mansouri, M., Fezai, R., Trabelsi, M., Mansour, H., Nounou, H., and Nounou, M.: Fault diagnosis of wind energy conversion systems using Gaussian process regression-based multi-class random forest, *IFAC-PapersOnLine*, 55, 127–132, 2022.
- 2480 Maron, J., Anagnostos, D., Brodbeck, B., and Meyer, A.: Artificial intelligence-based condition monitoring and predictive maintenance framework for wind turbines, *Journal of Physics: Conference Series*, 2151, 1–9, 2022.
- Marti-Puig, P. and Núñez-Vilaplana, C.: Dynamic Clustering of Wind Turbines Using SCADA Signal Analysis, *Energies*, 17, 2024.
- Marti-Puig, P., Blanco-M., A., Serra-Serra, M., and Solé-Casals, J.: Wind Turbine Prognosis Models Based on SCADA Data and Extreme Learning Machines, *Applied Sciences*, 11, 590, 2021.

- 2485 Marti-Puig, P., Cusidó, J., Lozano, F. J., Serra-Serra, M., Caiafa, C. F., and Solé-Casals, J.: Detection of wind turbine failures through cross-information between neighbouring turbines, *Applied Sciences*, 12, 9491, 2022.
- Mazidi, P., Bertling, L., and Sanz-Bobi, M. A.: Performance Analysis and Anomaly Detection in Wind Turbines based on Neural Networks and Principal Component Analysis, pp. 1–9, 2017.
- McDonald, G. L. and Zhao, Q.: Multipoint optimal minimum entropy deconvolution and convolution fix: Application to vibration fault
2490 detection, *Mechanical Systems and Signal Processing*, 82, 461–477, 2017.
- McDonald, G. L., Zhao, Q., and Zuo, M. J.: Maximum correlated Kurtosis deconvolution and application on gear tooth chip fault detection, *Mechanical Systems and Signal Processing*, 33, 237–255, <https://doi.org/10.1016/j.ymssp.2012.06.010>, 2012.
- McKinnon, C., Carroll, J., McDonald, A., Koukoura, S., Infield, D., and Soraghan, C.: Comparison of New Anomaly Detection Technique for Wind Turbine Condition Monitoring Using Gearbox SCADA Data, *Energies*, 13, 1–19, 2020.
- 2495 McMorland, J., Collu, M., McMillan, D., and Carroll, J.: Operation and maintenance for floating wind turbines: A review, *Renewable and Sustainable Energy Reviews*, 163, 112 499, 2022.
- Mehlan, F. C. and Nejad, A. R.: On the Uncertainty of Digital Twin Models for Load Monitoring and Fatigue Assessment in Wind Turbine Drivetrains, *Wind Energy Science Discussions*, 2024, 1–28, 2024.
- Mehlan, F. C., Nejad, A. R., and Gao, Z.: Digital twin based virtual sensor for online fatigue damage monitoring in offshore wind turbine
2500 drivetrains, *Journal of Offshore Mechanics and Arctic Engineering*, 144, 060 901, 2022.
- Mehlan, F. C., Keller, J., and Nejad, A. R.: Virtual sensing of wind turbine hub loads and drivetrain fatigue damage, *Forschung im Ingenieurwesen*, 87, 207–218, 2023.
- Merainani, B., Benazzouz, D., and Rahmoune, C.: Early detection of tooth crack damage in gearbox using empirical wavelet transform combined by Hilbert transform, *Journal of Vibration and Control*, 23, 1623–1634, 2017.
- 2505 Meyer, A.: Early fault detection with multi-target neural networks, *CoRR*, abs/2106.08957, <https://arxiv.org/abs/2106.08957>, 2021.
- Miele, E. S., Bonacina, F., and Corsini, A.: Deep anomaly detection in horizontal axis wind turbines using Graph Convolutional Autoencoders for Multivariate Time series, *Energy and AI*, 8, 100 145, 2022.
- Mishnaevsky, L.: Root Causes and Mechanisms of Failure of Wind Turbine Blades: Overview, *Materials*, 15, <https://doi.org/10.3390/MA15092959>, 2022.
- 2510 Mitchell, L.: Detection of a misaligned disk coupling using spectrum analysis, *Journal of vibration, acoustics, stress, and reliability in design*, 106, 9, 1984.
- Mokhtari, N.: Überwachung hydrodynamischer Gleitlager basierend auf der Körperschallanalyse: Dissertation, vol. 7 of *Advances in Automation Engineering*, ISBN 978-3-7983-3184-6, 2020.
- Mokhtari, N., Pelham, J. G., Nowoisky, S., Bote-Garcia, J.-L., and Gühmann, C.: Friction and Wear Monitoring Methods
2515 for Journal Bearings of Geared Turbofans Based on Acoustic Emission Signals and Machine Learning, *Lubricants*, 8, 29, <https://doi.org/10.3390/lubricants8030029>, 2020.
- Momber, A. W., Möller, T., Langenkämper, D., Nattkemper, T. W., and Brün, D.: A Digital Twin concept for the prescriptive maintenance of protective coating systems on wind turbine structures, *Wind Engineering*, 46, 949–971, 2022.
- Muñoz, C. Q. G., Marquez, F. P. G., Crespo, B. H., and Makaya, K.: Structural health monitoring for delamination detection and location in
2520 wind turbine blades employing guided waves, *Wind Energy*, 22, 698 – 711, <https://doi.org/10.1002/we.2316>, 2019.
- Natili, F., Castellani, F., Astolfi, D., and Becchetti, M.: Video-tachometer methodology for wind turbine rotor speed measurement, *Sensors*, 20, 7314, 2020.

- Nejad, A. R., Keller, J., Guo, Y., Sheng, S., Polinder, H., Watson, S., Dong, J., Qin, Z., Ebrahimi, A., Schelenz, R., et al.: Wind turbine drivetrains: state-of-the-art technologies and future development trends, *Wind Energy Science*, 7, 387–411, 2022.
- 2525 NREL: Gearbox Reliability Database, <https://grd.nrel.gov/>, 2018.
- Olabi, A. G., Wilberforce, T., Elsaid, K., Sayed, E. T., Salameh, T., Abdelkareem, M. A., and Baroutaji, A.: A review on failure modes of wind turbine components, *Energies*, 14, 5241, 2021.
- Oliveira-Filho, A., Comeau, M., Cave, J., Nasr, C., Côté, P., and Tahan, A.: Wind Turbine SCADA Data Imbalance: A Review of Its Impact on Health Condition Analyses and Mitigation Strategies, *Energies*, 18, <https://doi.org/10.3390/en18010059>, 2025.
- 2530 Pacheco-Blazquez, R., Garcia-Espinosa, J., Di Capua, D., and Pastor Sanchez, A.: A Digital Twin for Assessing the Remaining Useful Life of Offshore Wind Turbine Structures, *Journal of Marine Science and Engineering*, 12, 573, 2024.
- Paeßens, J., Kratz, K.-H., Gemmeke, T., Kauth, K., Baszenski, T., Lehmann, B., and Jacobs, G.: Design of a fully integrated sensor system of a plain bearing, *Forschung im Ingenieurwesen*, 88, <https://doi.org/10.1007/s10010-024-00740-8>, 2024.
- Pan, H., Zheng, J., Yang, Y., and Cheng, J.: Nonlinear sparse mode decomposition and its application in planetary gearbox fault diagnosis, 2535 *Mechanism and Machine Theory*, 155, 104 082, 2021.
- Pandit, R., Astolfi, D., Hong, J., Infield, D., and Santos, M.: SCADA data for wind turbine data-driven condition/performance monitoring: A review on state-of-art, challenges and future trends, *Wind Engineering*, 47, 422–441, <https://doi.org/10.1177/0309524X221124031>, 2023.
- Pang, B., Tian, T., and Tang, G.-J.: Fault state recognition of wind turbine gearbox based on generalized multi-scale dynamic time warping, *Structural Health Monitoring*, 20, 3007–3023, 2021.
- 2540 Paquette, J., Williams, M., Clarke, R., Devin, M., Sheng, S., Constant, C., Clark, C., Fields, J., Gevorgian, V., Hall, M., Jonkman, J., Keller, J., Robertson, A., Sethuraman, L., and van Dam, J.: An Operations and Maintenance Roadmap for U.S. Offshore Wind: Enabling a Cost-Effective and Sustainable U.S. Offshore Wind Energy Industry Through Innovative Operations and Maintenance, <https://doi.org/10.2172/2361054>, 2024.
- Patel, T. H. and Darpe, A. K.: Vibration response of a cracked rotor in presence of rotor–stator rub, *Journal of Sound and Vibration*, 317, 2545 841–865, 2008.
- Patel, T. H. and Darpe, A. K.: Experimental investigations on vibration response of misaligned rotors, *Mechanical Systems and Signal Processing*, 23, 2236–2252, 2009a.
- Patel, T. H. and Darpe, A. K.: Vibration response of misaligned rotors, *Journal of sound and vibration*, 325, 609–628, 2009b.
- Patrick-Aldaco, R.: A model based framework for fault diagnosis and prognosis of dynamical systems with an application to helicopter 2550 transmissions, <https://api.semanticscholar.org/CorpusID:114937037>, 2007.
- Peeters, C., Guillaume, P., and Helsen, J.: Vibration data pre-processing techniques for rolling element bearing fault detection, in: *Proceedings of the 23rd international conference on sound & vibration*, 2016.
- Peeters, C., Guillaume, P., and Helsen, J.: A comparison of cepstral editing methods as signal pre-processing techniques for vibration-based bearing fault detection, *Mechanical Systems and Signal Processing*, 91, 354–381, 2017a.
- 2555 Peeters, C., Leclere, Q., Antoni, J., Guillaume, P., and Helsen, J.: Vibration-based angular speed estimation for multi-stage wind turbine gearboxes, in: *Journal of Physics: Conference Series*, vol. 842, p. 012053, IOP Publishing, 2017b.
- Peeters, C., Antoni, J., Gioia, N., Guillaume, P., and Helsen, J.: A novel multiharmonic demodulation technique for instantaneous speed estimation, in: *Conference on Noise and Vibration Engineering*, 2018a.
- Peeters, C., Guillaume, P., and Helsen, J.: Vibration-based bearing fault detection for operations and maintenance cost reduction in wind 2560 energy, *Renewable Energy*, 116, 74–87, 2018b.

- Peeters, C., Leclere, Q., Antoni, J., Lindahl, P., Donnal, J., Leeb, S., and Helsen, J.: Review and comparison of tacholeless instantaneous speed estimation methods on experimental vibration data, *Mechanical Systems and Signal Processing*, 129, 407–436, 2019.
- Peeters, C., Antoni, J., Daems, P.-J., and Helsen, J.: Separation of vibration signal content using an improved discrete-random separation method, in: *Proceedings of the ISMA*, pp. 22–24, 2020a.
- 2565 Peeters, C., Antoni, J., and Helsen, J.: Blind filters based on envelope spectrum sparsity indicators for bearing and gear vibration-based condition monitoring, *Mechanical Systems and Signal Processing*, 138, 106 556, 2020b.
- Peeters, C., Antoni, J., Leclère, Q., Verstraeten, T., and Helsen, J.: Multi-harmonic phase demodulation method for instantaneous angular speed estimation using harmonic weighting, *Mechanical Systems and Signal Processing*, 167, 108 533, 2022.
- Peeters, C., Wang, W., Blunt, D., Verstraeten, T., and Helsen, J.: Fatigue crack detection in planetary gears: Insights from the HUMS2023 data challenge, *Mechanical Systems and Signal Processing*, 212, 111 292, 2024.
- 2570 Peeters, C., Antoni, J., and Helsen, J.: A multi-delay extension of the Discrete/Random Separation method, *Mechanical Systems and Signal Processing*, 235, 112 322, 2025.
- Peng, D., Liu, C., Desmet, W., and Gryllias, K.: Deep Unsupervised Transfer Learning for Health Status Prediction of a Fleet of Wind Turbines with Unbalanced Data, *Annual Conference of the PHM Society*, 13, 1–11, 2021.
- 2575 Perez-Sanjines, F., Peeters, C., Verstraeten, T., Antoni, J., Nowé, A., and Helsen, J.: Fleet-based early fault detection of wind turbine gearboxes using physics-informed deep learning based on cyclic spectral coherence, *Mechanical Systems and Signal Processing*, 185, 109 760, 2023.
- Pichika, S. N., Meganaa, G., Rajasekharan, S. G., and Malapati, A.: Multi-component fault classification of a wind turbine gearbox using integrated condition monitoring and hybrid ensemble method approach, *Applied Acoustics*, 195, 108 814, 2022.
- 2580 Poozesh, P., Aizawa, K., Niezrecki, C., Baqersad, J., Inalpolat, M., and Heilmann, G.: Structural health monitoring of wind turbine blades using acoustic microphone array, *Structural Health Monitoring*, 16, 471–485, <https://doi.org/10.1177/1475921716676871>, 2017.
- Protopapadakis, G., Peeters, C., Leclère, Q., Antoni, J., and Helsen, J.: Enhancing instantaneous angular speed estimation with an adaptive Multi-Order Probabilistic Approach, *Mechanical Systems and Signal Processing*, 226, 112 322, 2025.
- Puente León, F.: *Ereignisdiskrete Systeme: Modellierung und Steuerung Verteilter Systeme*, Walter de Gruyter GmbH, Berlin/München/Boston, 3rd ed. edn., ISBN 9783486769715, <https://ebookcentral.proquest.com/lib/kxp/detail.action?docID=1346409>, 2013.
- 2585 Purcell, E., Nejad, A. R., Böhm, A., Sapp, L., Lund, J., von Bock und Polach, F., Nickerson, B. M., Bekker, A., Gilges, M., Saleh, A., et al.: On Methodology for a Digital Twin of Ship Propulsion Under Harsh Environmental Conditions, in: *International Conference on Offshore Mechanics and Arctic Engineering*, vol. 87844, p. V006T07A024, American Society of Mechanical Engineers, 2024.
- 2590 Raad, A., Antoni, J., and Sidahmed, M.: Indicators of cyclostationarity: Theory and application to gear fault monitoring, *Mechanical Systems and Signal Processing*, 22, 574–587, 2008.
- Randall, R., Smith, W., Borghesani, P., and Peng, Z.: A new angle-domain cepstral method for generalised gear diagnostics under constant and variable speed operation, *Mechanical Systems and Signal Processing*, 178, 109 313, 2022.
- Randall, R. B.: A history of cepstrum analysis and its application to mechanical problems, *Mechanical Systems and Signal Processing*, 97, 3–19, 2017.
- 2595 Randall, R. B.: *Vibration-based condition monitoring: industrial, automotive and aerospace applications*, John Wiley & Sons, 2021.
- Randall, R. B. and Antoni, J.: Rolling element bearing diagnostics—A tutorial, *Mechanical systems and signal processing*, 25, 485–520, 2011.

- Randall, R. B., Antoni, J., and Chobsaard, S.: The relationship between spectral correlation and envelope analysis in the diagnostics of bearing faults and other cyclostationary machine signals, *Mechanical systems and signal processing*, 15, 945–962, 2001.
- 2600 Randall, R. B., Sawalhi, N., and Coats, M.: A comparison of methods for separation of deterministic and random signals, *International Journal of Condition Monitoring*, 1, 11–19, 2011.
- Renström, N., Bangalore, P., and Highcock, E.: System-wide anomaly detection in wind turbines using deep autoencoders, *Renewable Energy*, 157, 647–659, 2020.
- 2605 Rezamand, M., Kordestani, M., Orchard, M. E., Carriveau, R., Ting, D. S.-K., and Saif, M.: Improved remaining useful life estimation of wind turbine drivetrain bearings under varying operating conditions, *IEEE Transactions on Industrial Informatics*, 17, 1742–1752, 2020.
- Ritschel, U. and Beyer, M.: *Designing Wind Turbines, Synthesis Lectures*, 2022.
- Rodriguez, P. C., Marti-Puig, P., Caiafa, C. F., Serra-Serra, M., Cusidó, J., and Solé-Casals, J.: Exploratory Analysis of SCADA Data from Wind Turbines Using the K-Means Clustering Algorithm for Predictive Maintenance Purposes, *Machines*, 11, 2023.
- 2610 Salameh, J. P., Cauet, S., Etien, E., Sakout, A., and Rambault, L.: Gearbox condition monitoring in wind turbines: A review, *Mechanical Systems and Signal Processing*, 111, 251–264, 2018.
- Sawalhi, N., Randall, R. B., and Forrester, D.: Separation and enhancement of gear and bearing signals for the diagnosis of wind turbine transmission systems, *Wind Energy*, 17, 729–743, 2014.
- Scheu, M. N., Tremps, L., Smolka, U., Kolios, A., and Brennan, F.: A systematic Failure Mode Effects and Criticality Analysis for offshore wind turbine systems towards integrated condition based maintenance strategies, *Ocean Engineering*, 176, 118–133, 2019.
- 2615 Schlechtingen, M. and Santos, I. F.: Condition Monitoring With Wind Turbine SCADA Data Using Neuro-Fuzzy Normal Behavior Models, *Turbo Expo: Power for Land, Sea, and Air*, 6, 717–726, 2012.
- Schlechtingen, M. and Santos, I. F.: Wind turbine condition monitoring based on SCADA data using normal behavior models. Part 2: Application examples, *Applied Soft Computing*, 14, 447–460, 2014.
- 2620 Schlechtingen, M., Santos, I. F., and Achiche, S.: Wind turbine condition monitoring based on SCADA data using normal behavior models. Part 1: System description, *Applied Soft Computing*, 13, 259–270, 2013.
- Schröder, L., Dimitrov, N. K., Verelst, D. R., and Sørensen, J. A.: Wind turbine site-specific load estimation using artificial neural networks calibrated by means of high-fidelity load simulations, in: *Journal of Physics: Conference Series*, vol. 1037, p. 062027, IOP Publishing, 2018.
- 2625 Schroeder, K., Ecke, W., Apitz, J., Lembke, E., and Lenschow, G.: A fibre Bragg grating sensor system monitors operational load in a wind turbine rotor blade, *Measurement Science and Technology*, 17, 1167, <https://doi.org/10.1088/0957-0233/17/5/S39>, 2006.
- Sheiati, S., Jia, X., McGugan, M., Branner, K., and Chen, X.: Artificial intelligence-based blade identification in operational wind turbines through similarity analysis aided drone inspection, *Engineering Applications of Artificial Intelligence*, 137, 109234, <https://doi.org/10.1016/j.engappai.2024.109234>, 2024.
- 2630 Sheng, S.: Monitoring of Wind Turbine Gearbox Condition through Oil and Wear Debris Analysis: A Full-Scale Testing Perspective, *Tribology Transactions*, 59, 149–162, <https://doi.org/10.1080/10402004.2015.1055621>, 2016.
- Sheng, S. and O'Connor, R.: Chapter 14 - Reliability of wind turbines, in: *Wind Energy Engineering (Second Edition)*, edited by Letcher, T. M., pp. 195–211, Academic Press, second edition edn., ISBN 978-0-323-99353-1, <https://doi.org/10.1016/B978-0-323-99353-1.00016-5>, 2023.
- 2635 Shi, Y., Liu, Y., and Gao, X.: Study of Wind Turbine Fault Diagnosis and Early Warning Based on SCADA Data, *IEEE Access*, 9, 124600–124615, <https://doi.org/10.1109/ACCESS.2021.3110909>, 2021.

- Shutin, D., Bondarenko, M., Polyakov, R., Stebakov, I., and Savin, L.: Method for On-Line Remaining Useful Life and Wear Prediction for Adjustable Journal Bearings Utilizing a Combination of Physics-Based and Data-Driven Models: A Numerical Investigation, *Lubricants*, 11, <https://www.mdpi.com/2075-4442/11/1/33>, 2023.
- 2640 Si, X.-S., Wang, W., Hu, C.-H., and Zhou, D.-H.: Remaining useful life estimation – A review on the statistical data driven approaches, *European Journal of Operational Research*, 213, 1–14, <https://doi.org/10.1016/j.ejor.2010.11.018>, 2011.
- Siegel, D., Zhao, W., Lapira, E., AbuAli, M., and Lee, J.: A comparative study on vibration-based condition monitoring algorithms for wind turbine drive trains, *Wind energy*, 17, 695–714, 2014.
- Sierra-Pérez, J., Torres-Arredondo, M. A., and Güemes, A.: Damage and nonlinearities detection in wind turbine blades based on strain field pattern recognition. FBGs, OBR and strain gauges comparison, *Composite Structures*, 135, 156–166, <https://doi.org/10.1016/J.COMPSTRUCT.2015.08.137>, 2016.
- 2645 Singleton, R. K., Strangas, E. G., and Aviyente, S.: Extended Kalman Filtering for Remaining-Useful-Life Estimation of Bearings, *IEEE Transactions on Industrial Electronics*, 62, 1781–1790, <https://doi.org/10.1109/TIE.2014.2336616>, 2015.
- Sivalingam, K., Sepulveda, M., Spring, M., and Davies, P.: A review and methodology development for remaining useful life prediction of offshore fixed and floating wind turbine power converter with digital twin technology perspective, in: 2018 2nd international conference on green energy and applications (ICGEA), pp. 197–204, IEEE, 2018.
- 2650 Soares, M. N., Gyselinck, J., Mollet, Y., Peeters, C., Gioia, N., and Helsen, J.: Vibration-Based Rotor-Side-Converter Open-Switch-Fault Detection in DFIGs for Wind Turbines, in: 2018 IEEE International Conference on Prognostics and Health Management (ICPHM), pp. 1–6, IEEE, 2018.
- 2655 Solimine, J., Niezrecki, C., and Inalpolat, M.: An experimental investigation into passive acoustic damage detection for structural health monitoring of wind turbine blades, *Structural Health Monitoring*, 19, 1711–1725, <https://doi.org/10.1177/1475921719895588>, 2020.
- Solman, H., Kirkegaard, J. K., Smits, M., Van Vliet, B., and Bush, S.: Digital twinning as an act of governance in the wind energy sector, *Environmental Science & Policy*, 127, 272–279, 2022.
- Soni, S. and Vakharia, D. P.: Performance Analysis of Short Journal Bearing under Thin Film Lubrication, *ISRN Mechanical Engineering*, 2014, 1–8, <https://doi.org/10.1155/2014/281021>, 2014.
- 2660 SpectX: Autonomous Industrial Inspections | SpectX, <https://www.spectx.nl/>.
- Stammler, M., Menck, O., Guo, Y., and Keller, J.: Wind turbine design guideline dg03: Yaw and pitch bearings, 2024.
- Stefani, A., Yazidi, A., Rossi, C., Filippetti, F., Casadei, D., and Capolino, G.-A.: Doubly Fed Induction Machines Diagnosis Based on Signature Analysis of Rotor Modulating Signals, *IEEE Transactions on Industry Applications*, 44, 1711–1721, 2008.
- 2665 Stetco, A., Dinmohammadi, F., Zhao, X., Robu, V., Flynn, D., Barnes, M., Keane, J., and Nenadic, G.: Machine learning methods for wind turbine condition monitoring: A review, *Renewable energy*, 133, 620–635, 2019.
- Stone, E., Giani, S., Zappalá, D., and Crabtree, C.: Convolutional neural network framework for wind turbine electromechanical fault detection, *Wind Energy*, 26, 1082–1097, 2023.
- Struggl, S., Berbyuk, V., and Johansson, H.: Review on wind turbines with focus on drive train system dynamics, *Wind Energy*, 18, 567–590, 2015.
- 2670 Su, Y., Meng, L., Kong, X., Xu, T., Lan, X., and Li, Y.: Generative adversarial networks for gearbox of wind turbine with unbalanced data sets in fault diagnosis, *IEEE Sensors Journal*, 22, 13 285–13 298, 2022a.
- Su, Y., Meng, L., Kong, X., Xu, T., Lan, X., and Li, Y.: Small sample fault diagnosis method for wind turbine gearbox based on optimized generative adversarial networks, *Engineering Failure Analysis*, 140, 106 573, 2022b.

- 2675 Sun, P., Li, J., Wang, C., and Lei, X.: A generalized model for wind turbine anomaly identification based on SCADA data, *Applied Energy*, 168, 550–567, 2016.
- Sun, X., Xue, D., Li, R., Li, X., Cui, L., Zhang, X., and Wu, W.: Research on Condition Monitoring of Key Components in wind Turbine based on Cointegration Analysis, *IOP Conference Series: Materials Science and Engineering*, 575, 012 015, <https://doi.org/10.1088/1757-899X/575/1/012015>, 2019.
- 2680 Surucu, O., Gadsden, S. A., and Yawney, J.: Condition monitoring using machine learning: A review of theory, applications, and recent advances, *Expert Systems with Applications*, 221, 119 738, 2023.
- Swansson, N.: Application of vibration signal analysis techniques to condition monitoring, in: *Conference on Lubrication, Friction and Wear in Engineering 1980*, Melbourne: Preprints of Papers, pp. 262–267, Institution of Engineers, Australia Barton, ACT, 1980.
- Tang, J., Soua, S., Mares, C., and Gan, T.-H.: An experimental study of acoustic emission methodology for in service condition monitoring of wind turbine blades, *Renewable Energy*, 99, 170–179, <https://doi.org/10.1016/j.renene.2016.06.048>, 2016.
- 2685 Tang, Y., Chang, Y., and Li, K.: Applications of K-nearest neighbor algorithm in intelligent diagnosis of wind turbine blades damage, *Renewable Energy*, 212, 855–864, 2023.
- Tao, T., Liu, Y., Qiao, Y., Gao, L., Lu, J., Zhang, C., and Wang, Y.: Wind turbine blade icing diagnosis using hybrid features and Stacked-XGBoost algorithm, *Renewable Energy*, 180, 1004–1013, 2021.
- 2690 Tartt, K., Kazemi-Amiri, A., Nejad, A., McDonald, A., and Carroll, J.: Development of a vulnerability map of wind turbine power converters, in: *Journal of Physics: Conference Series*, vol. 2265, p. 032052, IOP Publishing, 2022.
- Tautz-Weinert, J. and Watson, S. J.: Using SCADA data for wind turbine condition monitoring – a review, *IET Renewable Power Generation*, 11, 382–394, 2017.
- Tavner, P., Ran, L., and Crabtree, C.: *Condition Monitoring of Rotating Electrical Machines*, IET, 2020.
- 2695 Texas Instruments: TMP117 High-Accuracy, Low-Power, Digital Temperature Sensor With SMBus™- and I2C-Compatible Interface datasheet (Rev. D), https://www.ti.com/lit/ds/symlink/tmp117.pdf?ts=1740392415609&ref_url=https%253A%252F%252Fwww.ti.com%252Fproduct%252Fde-de%252FTMP117, 2018.
- Thirumurugan, R. and Gnanasekar, N.: Influence of finite element model, load-sharing and load distribution on crack propagation path in spur gear drive, *Engineering Failure Analysis*, 110, 104 383, <https://doi.org/10.1016/j.engfailanal.2020.104383>, 2020.
- 2700 Traylor, C., DiPaola, M., Willis, D. J., and Inalpolat, M.: A computational investigation of airfoil aeroacoustics for structural health monitoring of wind turbine blades, *Wind Energy*, 23, 795–809, <https://doi.org/10.1002/we.2459>, 2020.
- Trizoglou, P., Liu, X., and Lin, Z.: Fault detection by an ensemble framework of Extreme Gradient Boosting (XGBoost) in the operation of offshore wind turbines, *Renewable Energy*, 179, 945–962, <https://doi.org/10.1016/j.renene.2021.07.085>, 2021.
- Tuerxun, W., Chang, X., Hongyu, G., Zhijie, J., and Huajian, Z.: Fault diagnosis of wind turbines based on a support vector machine optimized by the sparrow search algorithm, *Ieee Access*, 9, 69 307–69 315, 2021.
- 2705 Turnbull, A., Carroll, J., and McDonald, A.: Combining SCADA and vibration data into a single anomaly detection model to predict wind turbine component failure, *Wind Energy*, 24(3), 197–211, 2021.
- Tyreas, G., Dwyer-Joyce, R. S., Notay, R. S., and Durham, D. J.: Measuring lubricant viscosity at a surface and in a bearing film using shear-horizontal surface acoustic waves, *Proceedings of the Institution of Mechanical Engineers*, <https://doi.org/10.1177/13506501221092867>, 2022.
- 2710 Udo, W. and Yar, M.: Data-Driven Predictive Maintenance of Wind Turbine Based on SCADA Data, *IEEE Access*, 9, 162 370–162 388, 2021.

- Verma, A., Zappalá, D., Sheng, S., and Watson, S. J.: Wind turbine gearbox fault prognosis using high-frequency SCADA data, *Journal of Physics: Conference Series*, 2265, 032 067, 2022.
- 2715 Verstraeten, T., Marulanda, F. G., Peeters, C., Daems, P.-J., Nowé, A., and Helsen, J.: Edge computing for advanced vibration signal processing, in: *Surveillance, Vishno and AVE conferences*, 2019.
- Vieira, J. L. d. M., Farias, F. C., Ochoa, A. A. V., de Menezes, F. D., Costa, A. C. A. d., da Costa, J. Â. P., de Novaes Pires Leite, G., Vilela, O. d. C., de Souza, M. G. G., and Michima, P. S. A.: Remaining Useful Life Estimation Framework for the Main Bearing of Wind Turbines Operating in Real Time, *Energies*, 17, 1430, 2024.
- 2720 Vraetz, T.: Entwicklung und Anwendung eines innovativen Konzepts zur Inline-Charakterisierung von Stoffgemischen in kontinuierlichen Massenströmen mittels der Acoustic Emission Technologie, *Dissertation*, Ralf Zillekens, 2018.
- Wada, R., Nejad, A. R., Iijima, K., Shimazaki, J., Ibrion, M., Wanaka, S., Nomura, H., Mizushima, Y., Nakashima, T., and Takagi, K.: Floating offshore wind in Japan: addressing the challenges, efforts, and research gaps for large-scale commercialization, *Wind Energy Science*, 11, 1013–1056, <https://doi.org/10.5194/wes-11-1013-2026>, 2026.
- 2725 Wadhvani, M., Deshmukh, S., and Dhiman, H. S.: Digital Twin Framework For Time To Failure Forecasting Of Wind Turbine Gearbox: A Concept, *arXiv preprint arXiv:2205.03513*, 2022.
- Wagg, D., Worden, K., Barthorpe, R., and Gardner, P.: Digital twins: state-of-the-art and future directions for modeling and simulation in engineering dynamics applications, *ASCE-ASME Journal of Risk and Uncertainty in Engineering Systems, Part B: Mechanical Engineering*, 6, 030 901, 2020.
- 2730 Walgern, J., Fischer, K., Hentschel, P., and Kolios, A.: Reliability of electrical and hydraulic pitch systems in wind turbines based on field-data analysis, *Energy Reports*, 9, 3273–3281, 2023.
- Wang, D., Zhong, J., Li, C., and Peng, Z.: Box-Cox sparse measures: A new family of sparse measures constructed from kurtosis and negative entropy, *Mechanical Systems and Signal Processing*, 160, 107930, <https://doi.org/10.1016/j.ymssp.2021.107930>, 2021a.
- Wang, H., Xu, J., Sun, C., Yan, R., and Chen, X.: Intelligent fault diagnosis for planetary gearbox using time-frequency representation and deep reinforcement learning, *IEEE/ASME Transactions on Mechatronics*, 27, 985–998, 2021b.
- 2735 Wang, L., Jia, S., Yan, X., Ma, L., and Fang, J.: A SCADA-data-driven condition monitoring method of wind turbine generators, *IEEE Access*, 10, 67 532–67 540, 2022a.
- Wang, S., Vidal, Y., and Pozo, F.: Recent advances in wind turbine condition monitoring using SCADA data: A state-of-the-art review, *Reliability Engineering System Safety*, 267, 111 838, <https://doi.org/https://doi.org/10.1016/j.res.2025.111838>, 2026.
- 2740 Wang, T., Han, Q., Chu, F., and Feng, Z.: Vibration based condition monitoring and fault diagnosis of wind turbine planetary gearbox: A review, *Mechanical Systems and Signal Processing*, 126, 662–685, 2019.
- Wang, W., Xue, Y., He, C., and Zhao, Y.: Review of the Typical Damage and Damage-Detection Methods of Large Wind Turbine Blades, *Energies*, 15, <https://doi.org/10.3390/en15155672>, 2022b.
- Wang, X., Liu, Z., Zhang, L., and Heath, W. P.: Wavelet package energy transmissibility function and its application to wind turbine blade fault detection, *IEEE Transactions on Industrial Electronics*, 69, 13 597–13 606, 2022c.
- 2745 Wang, Y., Egner, F. S., Willems, T., Kirchner, M., and Desmet, W.: Camera-based experimental modal analysis with impact excitation: Reaching high frequencies thanks to one accelerometer and random sampling in time, *Mechanical Systems and Signal Processing*, 170, 108 879, 2022d.

- Wang, Z.-Q., Hu, C.-H., Si, X.-S., and Zio, E.: Remaining useful life prediction of degrading systems subjected to imperfect maintenance: Application to draught fans, *Mechanical Systems and Signal Processing*, 100, 802–813, <https://doi.org/10.1016/j.ymssp.2017.08.016>, 2018.
- Wei, S., Wang, D., Peng, Z., and Feng, Z.: Variational nonlinear component decomposition for fault diagnosis of planetary gearboxes under variable speed conditions, *Mechanical Systems and Signal Processing*, 162, 108 016, 2022.
- Wilkinson, M., Darnell, B., van Delft, T., and Harman, K.: Comparison of methods for wind turbine condition monitoring with SCADA data, *IET Renewable Power Generation*, 8, 390–397, 2014.
- WindEurope: Wind energy in Europe: 2024 Statistics and the outlook for 2025-2030, Tech. rep., WindEurope, <https://windeurope.org/intelligence-platform/product/wind-energy-in-europe-2024-statistics-and-the-outlook-for-2025-2030/>, 2025.
- Wu, Y., Tang, B., Deng, L., and Shen, Y.: Hardware-Resource-Constrained Neural Architecture Search for Edge-Side Fault Diagnosis of Wind-Turbine Gearboxes, *IEEE Transactions on Industrial Electronics*, 2023.
- Xiang, L., Yang, X., Hu, A., Su, H., and Wang, P.: Condition monitoring and anomaly detection of wind turbine based on cascaded and bidirectional deep learning networks, *Applied Energy*, 305, 117 925, 2022.
- Xiao, X., Liu, J., Liu, D., Tang, Y., Qin, S., and Zhang, F.: A normal behavior-based condition monitoring method for wind turbine main bearing using dual attention mechanism and Bi-LSTM, *Energies*, 15, 8462, 2022a.
- Xiao, X., Liu, J., Liu, D., Tang, Y., and Zhang, F.: Condition monitoring of wind turbine main bearing based on multivariate time series forecasting, *Energies*, 15, 1951, 2022b.
- Xu, D., Wen, C., and Liu, J.: Wind turbine blade surface inspection based on deep learning and UAV-taken images, *Journal of Renewable and Sustainable Energy*, 11, 053 305, <https://doi.org/10.1063/1.5113532>, 2019.
- Xu, M., Li, J., Wang, S., Yang, N., and Hao, H.: Damage detection of wind turbine blades by Bayesian multivariate cointegration, *Ocean Engineering*, 258, 111 603, <https://doi.org/10.1016/j.oceaneng.2022.111603>, 2022.
- Yang, L. and Zhang, Z.: Wind turbine gearbox failure detection based on SCADA data: A deep learning-based approach, *IEEE Transactions on Instrumentation and Measurement*, 70, 1–11, 2020.
- Yang, W. and Jiang, D.: Wind Turbine Fault Diagnosis System Based on A Fuzzy Expert System, in: *Proceedings of the 2015 International Power, Electronics and Materials Engineering Conference*, pp. 524–529, Atlantis Press, ISBN 978-94-62520-73-8, ISSN 2352-5401, <https://doi.org/10.2991/ipemec-15.2015.98>, 2015/05.
- Yang, W., Court, R., and Jiang, J.: Wind turbine condition monitoring by the approach of SCADA data analysis, *Renewable Energy*, 53, 365–376, 2013.
- Yang, Y., Bai, Y., Li, C., and Yang, Y.-N.: Application Research of ARIMA Model in Wind Turbine Gearbox Fault Trend Prediction, in: *2018 International Conference on Sensing, Diagnostics, Prognostics, and Control (SDPC)*, pp. 520–526, <https://doi.org/10.1109/SDPC.2018.8664793>, 2018.
- Yazidi, A., Henao, H., Capolino, G.-A., and Betin, F.: Rotor inter-turn short circuit fault detection in wound rotor induction machines, in: *The XIX International Conference on Electrical Machines - ICEM 2010*, pp. 1–6, IEEE, 2010.
- Yoon, J., He, D., Van Hecke, B., Nostrand, T. J., Zhu, J., and Bechhoefer, E.: Vibration-based wind turbine planetary gearbox fault diagnosis using spectral averaging, *Wind Energy*, 19, 1733–1747, 2016.
- Yu, J., He, Y., Liu, H., Zhang, F., Li, J., Sun, G., Zhang, X., Yang, R., Wang, P., and Wang, H.: An Improved U-Net Model for Infrared Image Segmentation of Wind Turbine Blade, *IEEE Sensors Journal*, 23, 1318–1327, <https://doi.org/10.1109/JSEN.2022.3224837>, 2023.

- Zaher, A., McArthur, S., Infield, D., and Patel, Y.: Online wind turbine fault detection through automated SCADA data analysis, *Wind Energy*, 12, 574–593, 2009.
- Zappalá, Sarma, N., Djurović, S., Crabtree, C., Mohammad, A., and Tavner, P.: Electrical mechanical diagnostic indicators of wind turbine induction generator rotor faults, *Renewable Energy*, 131, 14–24, 2019.
- 2790 Zraggen, J., Ulmer, M., Jarlskog, E., Pizza, G., and Huber, L. G.: Transfer learning approaches for wind turbine fault detection using deep learning, in: *PHM Society European Conference*, vol. 6, pp. 12–12, 2021.
- Zhang, C., Wen, C., and Liu, J.: Mask-MRNet: A deep neural network for wind turbine blade fault detection, *Journal of Renewable and Sustainable Energy*, 12, 053 302, <https://doi.org/10.1063/5.0014223>, 2020.
- Zhang, L., Fan, Q., Lin, J., Zhang, Z., Yan, X., and Li, C.: A nearly end-to-end deep learning approach to fault diagnosis of wind turbine gearboxes under nonstationary conditions, *Engineering applications of artificial intelligence*, 119, 105 735, 2023a.
- 2795 Zhang, X., Sun, L., Sun, H., Guo, Q., and Bai, X.: Floating offshore wind turbine reliability analysis based on system grading and dynamic FTA, *Journal of Wind Engineering and Industrial Aerodynamics*, 154, 21–33, 2016.
- Zhang, Y., Avallone, F., and Watson, S.: Wind turbine blade trailing edge crack detection based on airfoil aerodynamic noise: An experimental study, *Applied Acoustics*, 191, 108 668, <https://doi.org/10.1016/j.apacoust.2022.108668>, 2022.
- 2800 Zhang, Y., Fang, L., Qi, Z., and Deng, H.: A Review of Remaining Useful Life Prediction Approaches for Mechanical Equipment, *IEEE Sensors Journal*, 23, 29 991–30 006, <https://doi.org/10.1109/JSEN.2023.3326487>, 2023b.
- Zhao, H., Liu, H., Hu, W., and Yan, X.: Anomaly detection and fault analysis of wind turbine components based on deep learning network, *Renewable Energy*, 127, 825–834, 2018.
- Zhao, W., Zhang, C., Wang, J., Peyrano, O. G., Gu, F., Wang, S., and Lv, D.: Research on main bearing life prediction of direct-drive wind turbine based on digital twin technology, *Measurement Science and Technology*, 34, 025 013, 2022.
- 2805 Zhao, Y., Li, D., Dong, A., Kang, D., Lv, Q., and Shang, L.: Fault Prediction and Diagnosis of Wind Turbine Generators Using SCADA Data, *Energies*, 10, 3–9, 2017.
- Zhao, Z.-h., Wang, Q., Shao, C.-s., Chen, N., Liu, X.-y., and Wang, G.-b.: A state detection method of offshore wind turbines' gearbox bearing based on the transformer and GRU, *Measurement Science and Technology*, 35, 025 903, 2023.
- 2810 Zhi-Ling, Y., Bin, W., Xing-Hui, D., and Hao, L.: Expert System of Fault Diagnosis for Gear Box in Wind Turbine, *Systems Engineering Procedia*, 4, 189–195, <https://doi.org/10.1016/j.sepro.2011.11.065>, *information Engineering and Complexity Science - Part II*, 2012.
- Zhongshan, H., Ling, T., Dong, X., Sichao, L., and Yaozhong, W.: Condition monitoring of wind turbine based on copula function and autoregressive neural network, *MATEC Web of Conferences*, 198, 1–5, 2018.
- Zhu, Y., Zhu, C., Tan, J., Song, C., Chen, D., and Zheng, J.: Fault detection of offshore wind turbine gearboxes based on deep adaptive networks via considering Spatio-temporal fusion, *Renewable Energy*, 200, 1023–1036, 2022a.
- 2815 Zhu, Y., Zhu, C., Tan, J., Tan, Y., and Rao, L.: Anomaly detection and condition monitoring of wind turbine gearbox based on LSTM-FS and transfer learning, *Renewable Energy*, 189, 90–103, 2022b.
- Zhu, Y., Xie, B., Wang, A., and Qian, Z.: Fault diagnosis of wind turbine gearbox under limited labeled data through temporal predictive and similarity contrast learning embedded with self-attention mechanism, *Expert Systems with Applications*, 245, 123 080, 2024.
- 2820 Ziaran, S. and Darula, R.: Determination of the state of wear of high contact ratio gear sets by means of spectrum and cepstrum analysis, *Journal of Vibration and Acoustics*, 135, 021 008, 2013.
- Zimroz, R., Urbanek, J., Barszcz, T., Bartelmus, W., Millioz, F., and Martin, N.: Measurement of instantaneous shaft speed by advanced vibration signal processing-application to wind turbine gearbox, *MTA Review/Military Technical Academy Review*, 18, 701–712, 2011.

- Zio, E.: Prognostics and Health Management (PHM): Where are we and where do we (need to) go in theory and practice, *Reliability Engineering & System Safety*, 218, 108 119, 2022.
- 2825 Łukasz Doliński, Krawczuk, M., and Zak, A.: Detection of Delamination in Laminate Wind Turbine Blades Using One-Dimensional Wavelet Analysis of Modal Responses, *Shock and Vibration*, 2018, 4507 879, <https://doi.org/10.1155/2018/4507879>, 2018.